


Bendigo Regulators
 Set Bendigo regulators to Manual & all to Neutral Tap Position (0) before closing bypass ABS 55366

To 58019-D

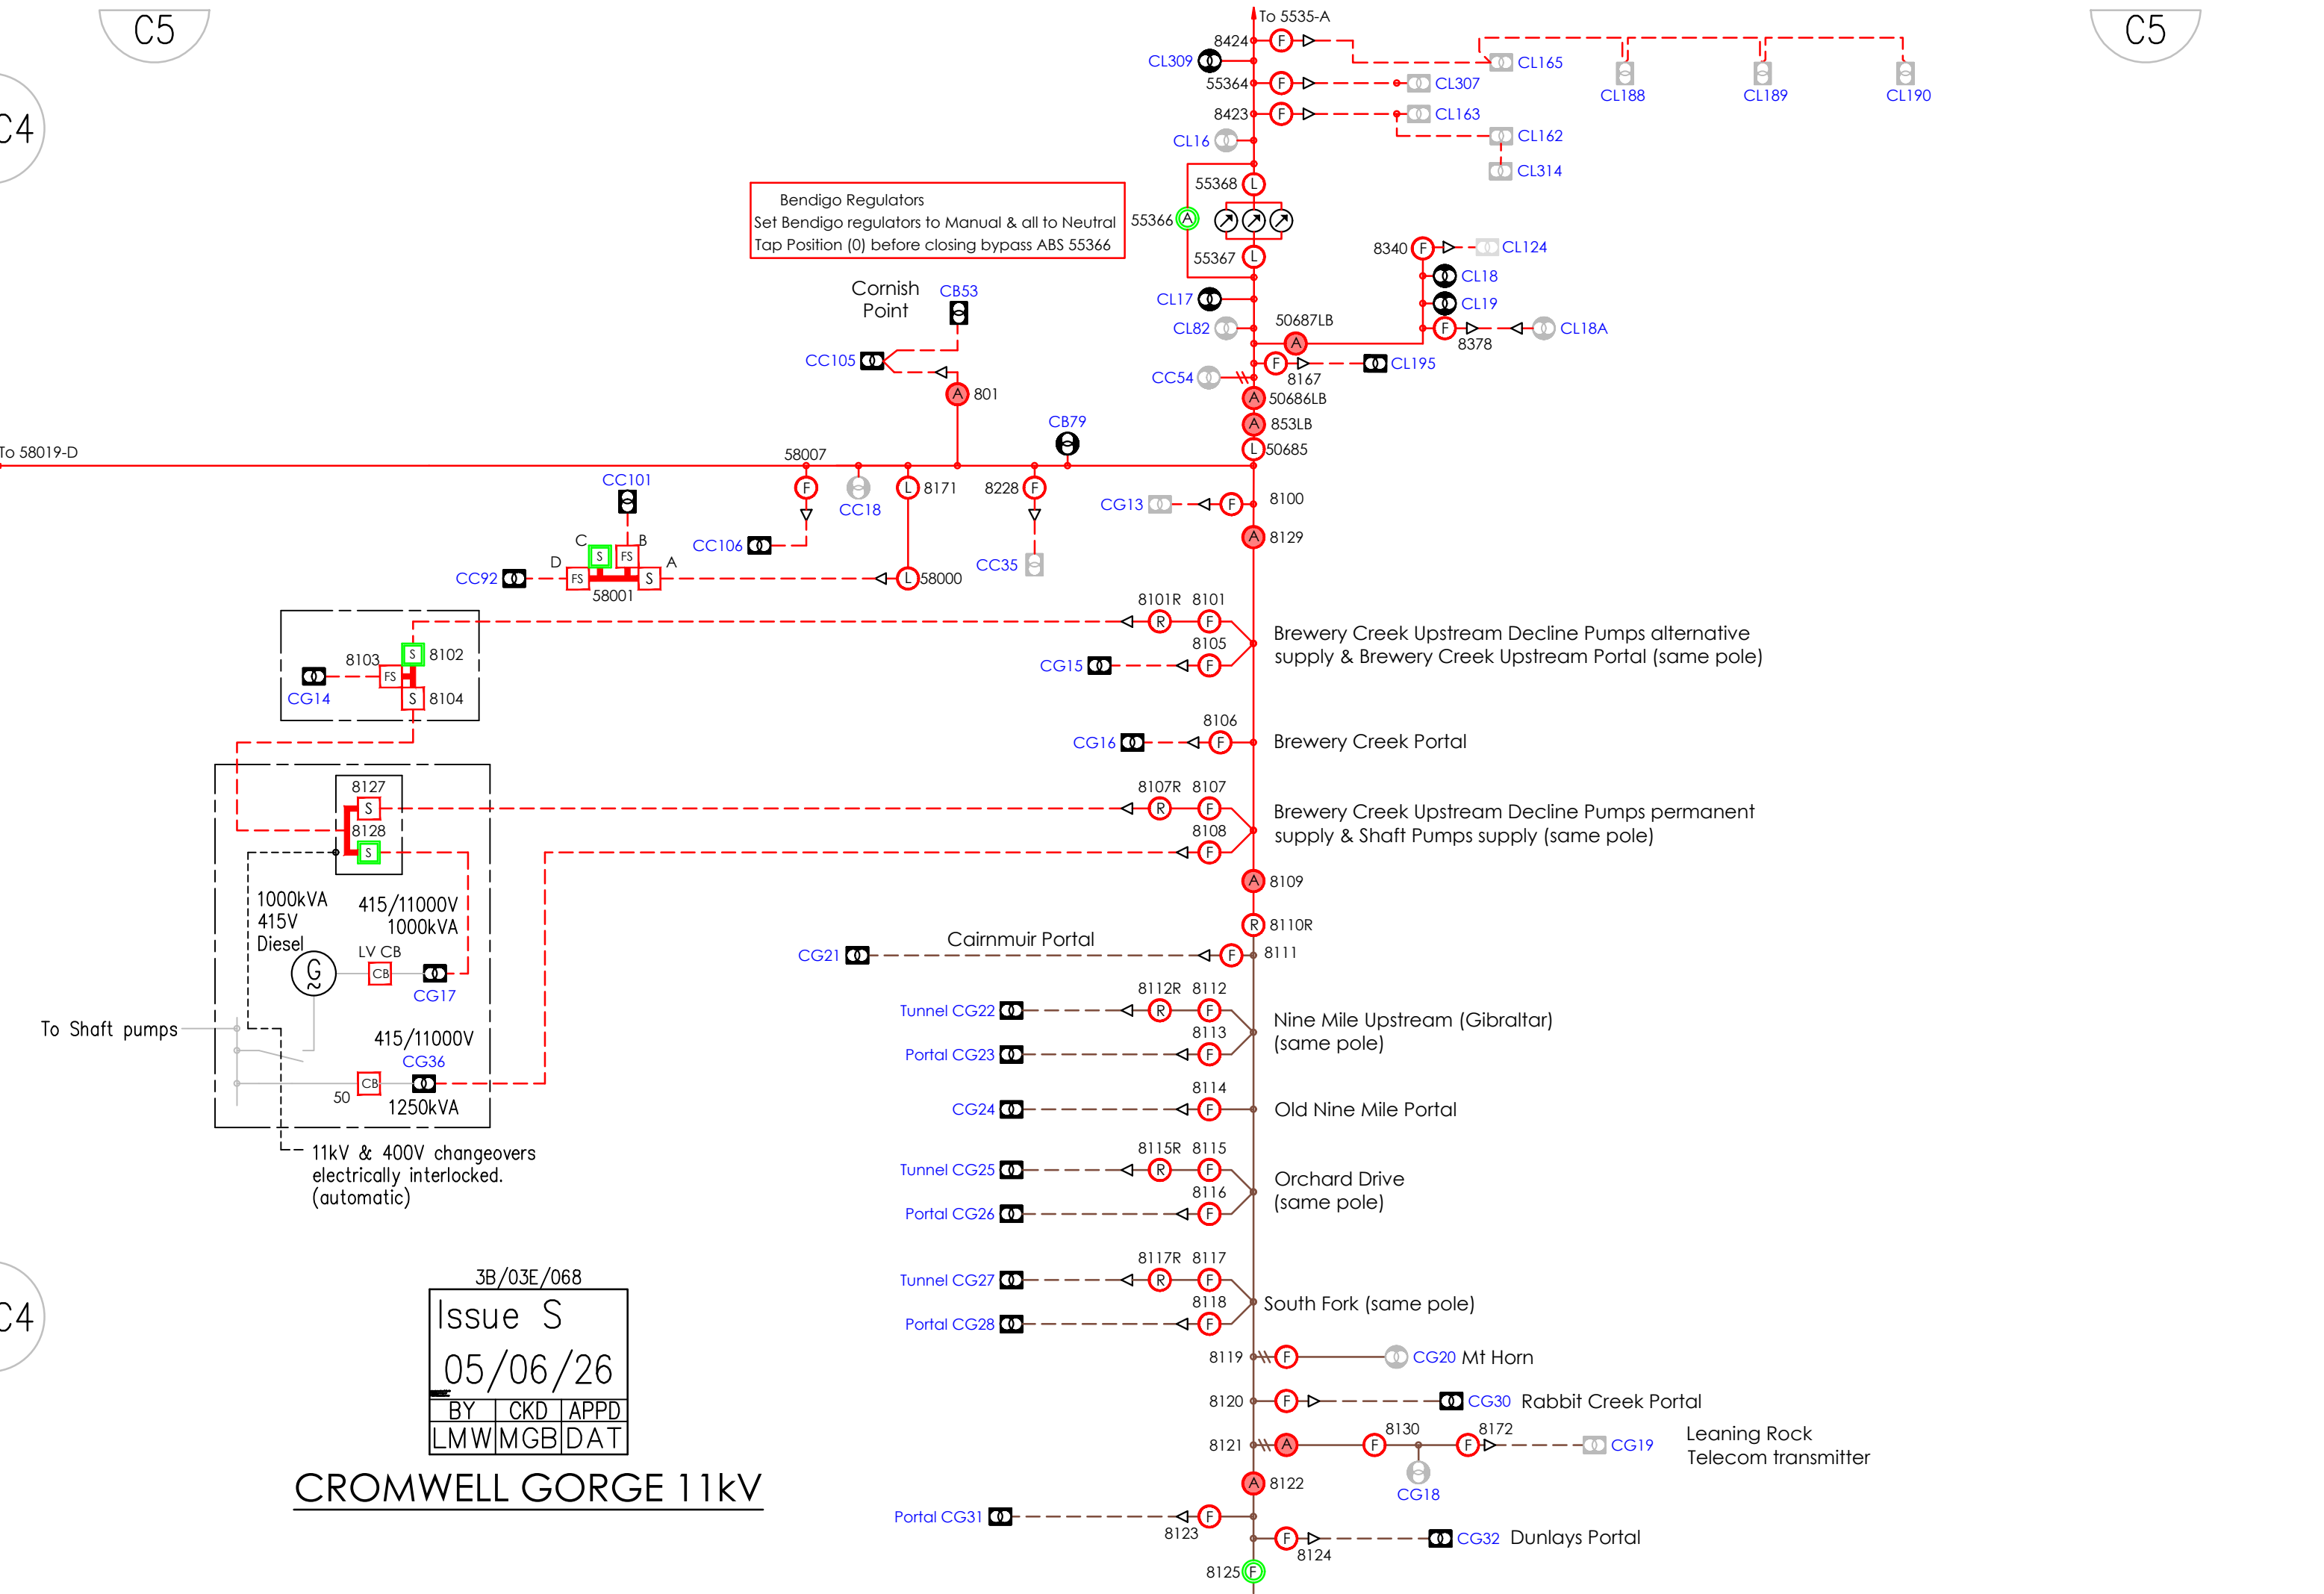

CROMWELL GORGE 11kV