


W5


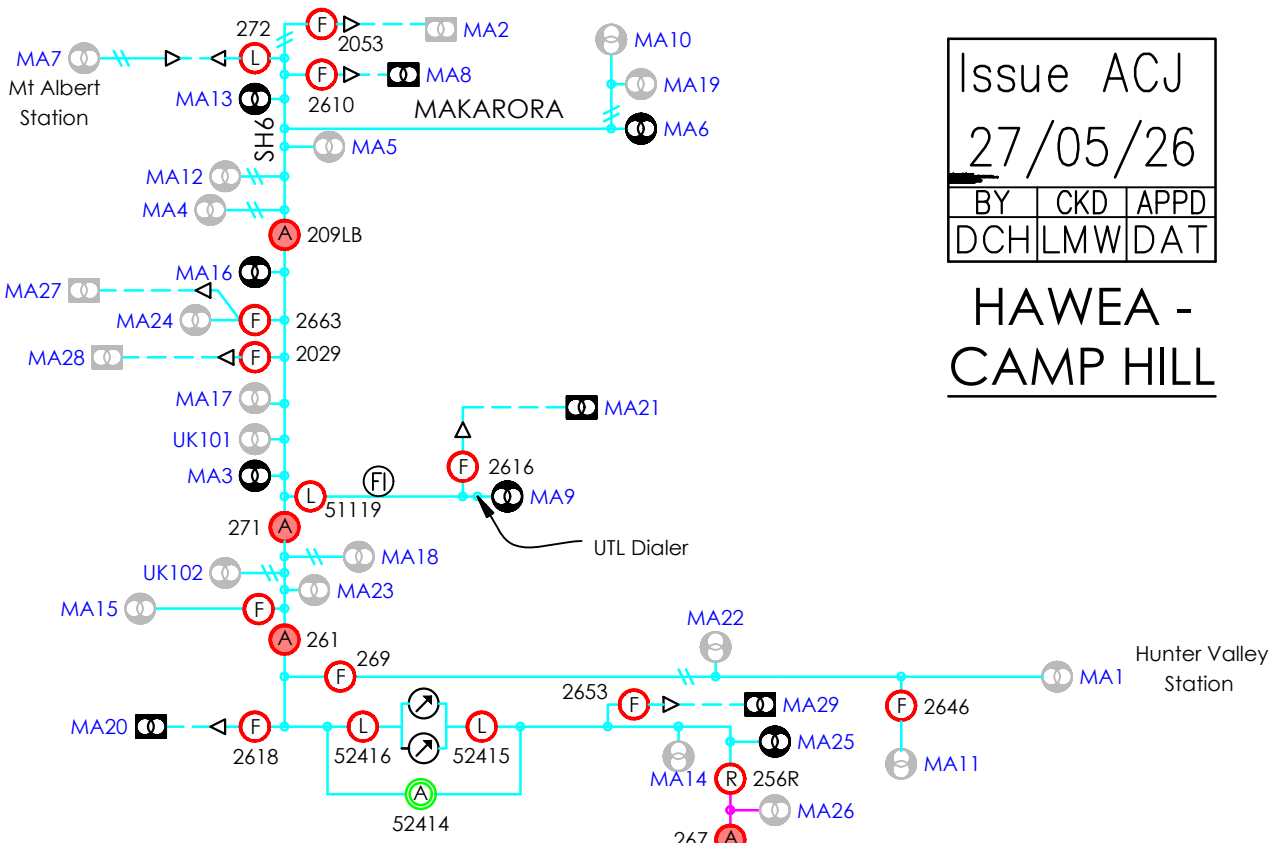


Issue ACJ  
27/05/26  
BY CKD APPD  
DCH LMWDAT

**HAWEA -  
CAMP HILL**

The Neck Regulators  
Set regulators to neutral (zero tap)  
before closing bypass switch

**PRIVATE NETWORK**  
UM75

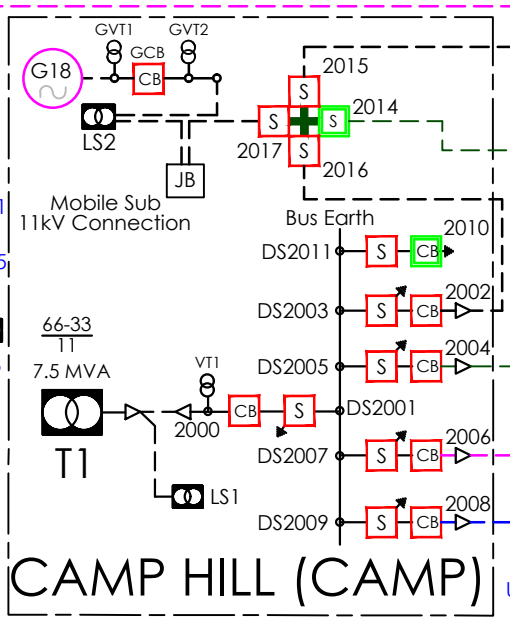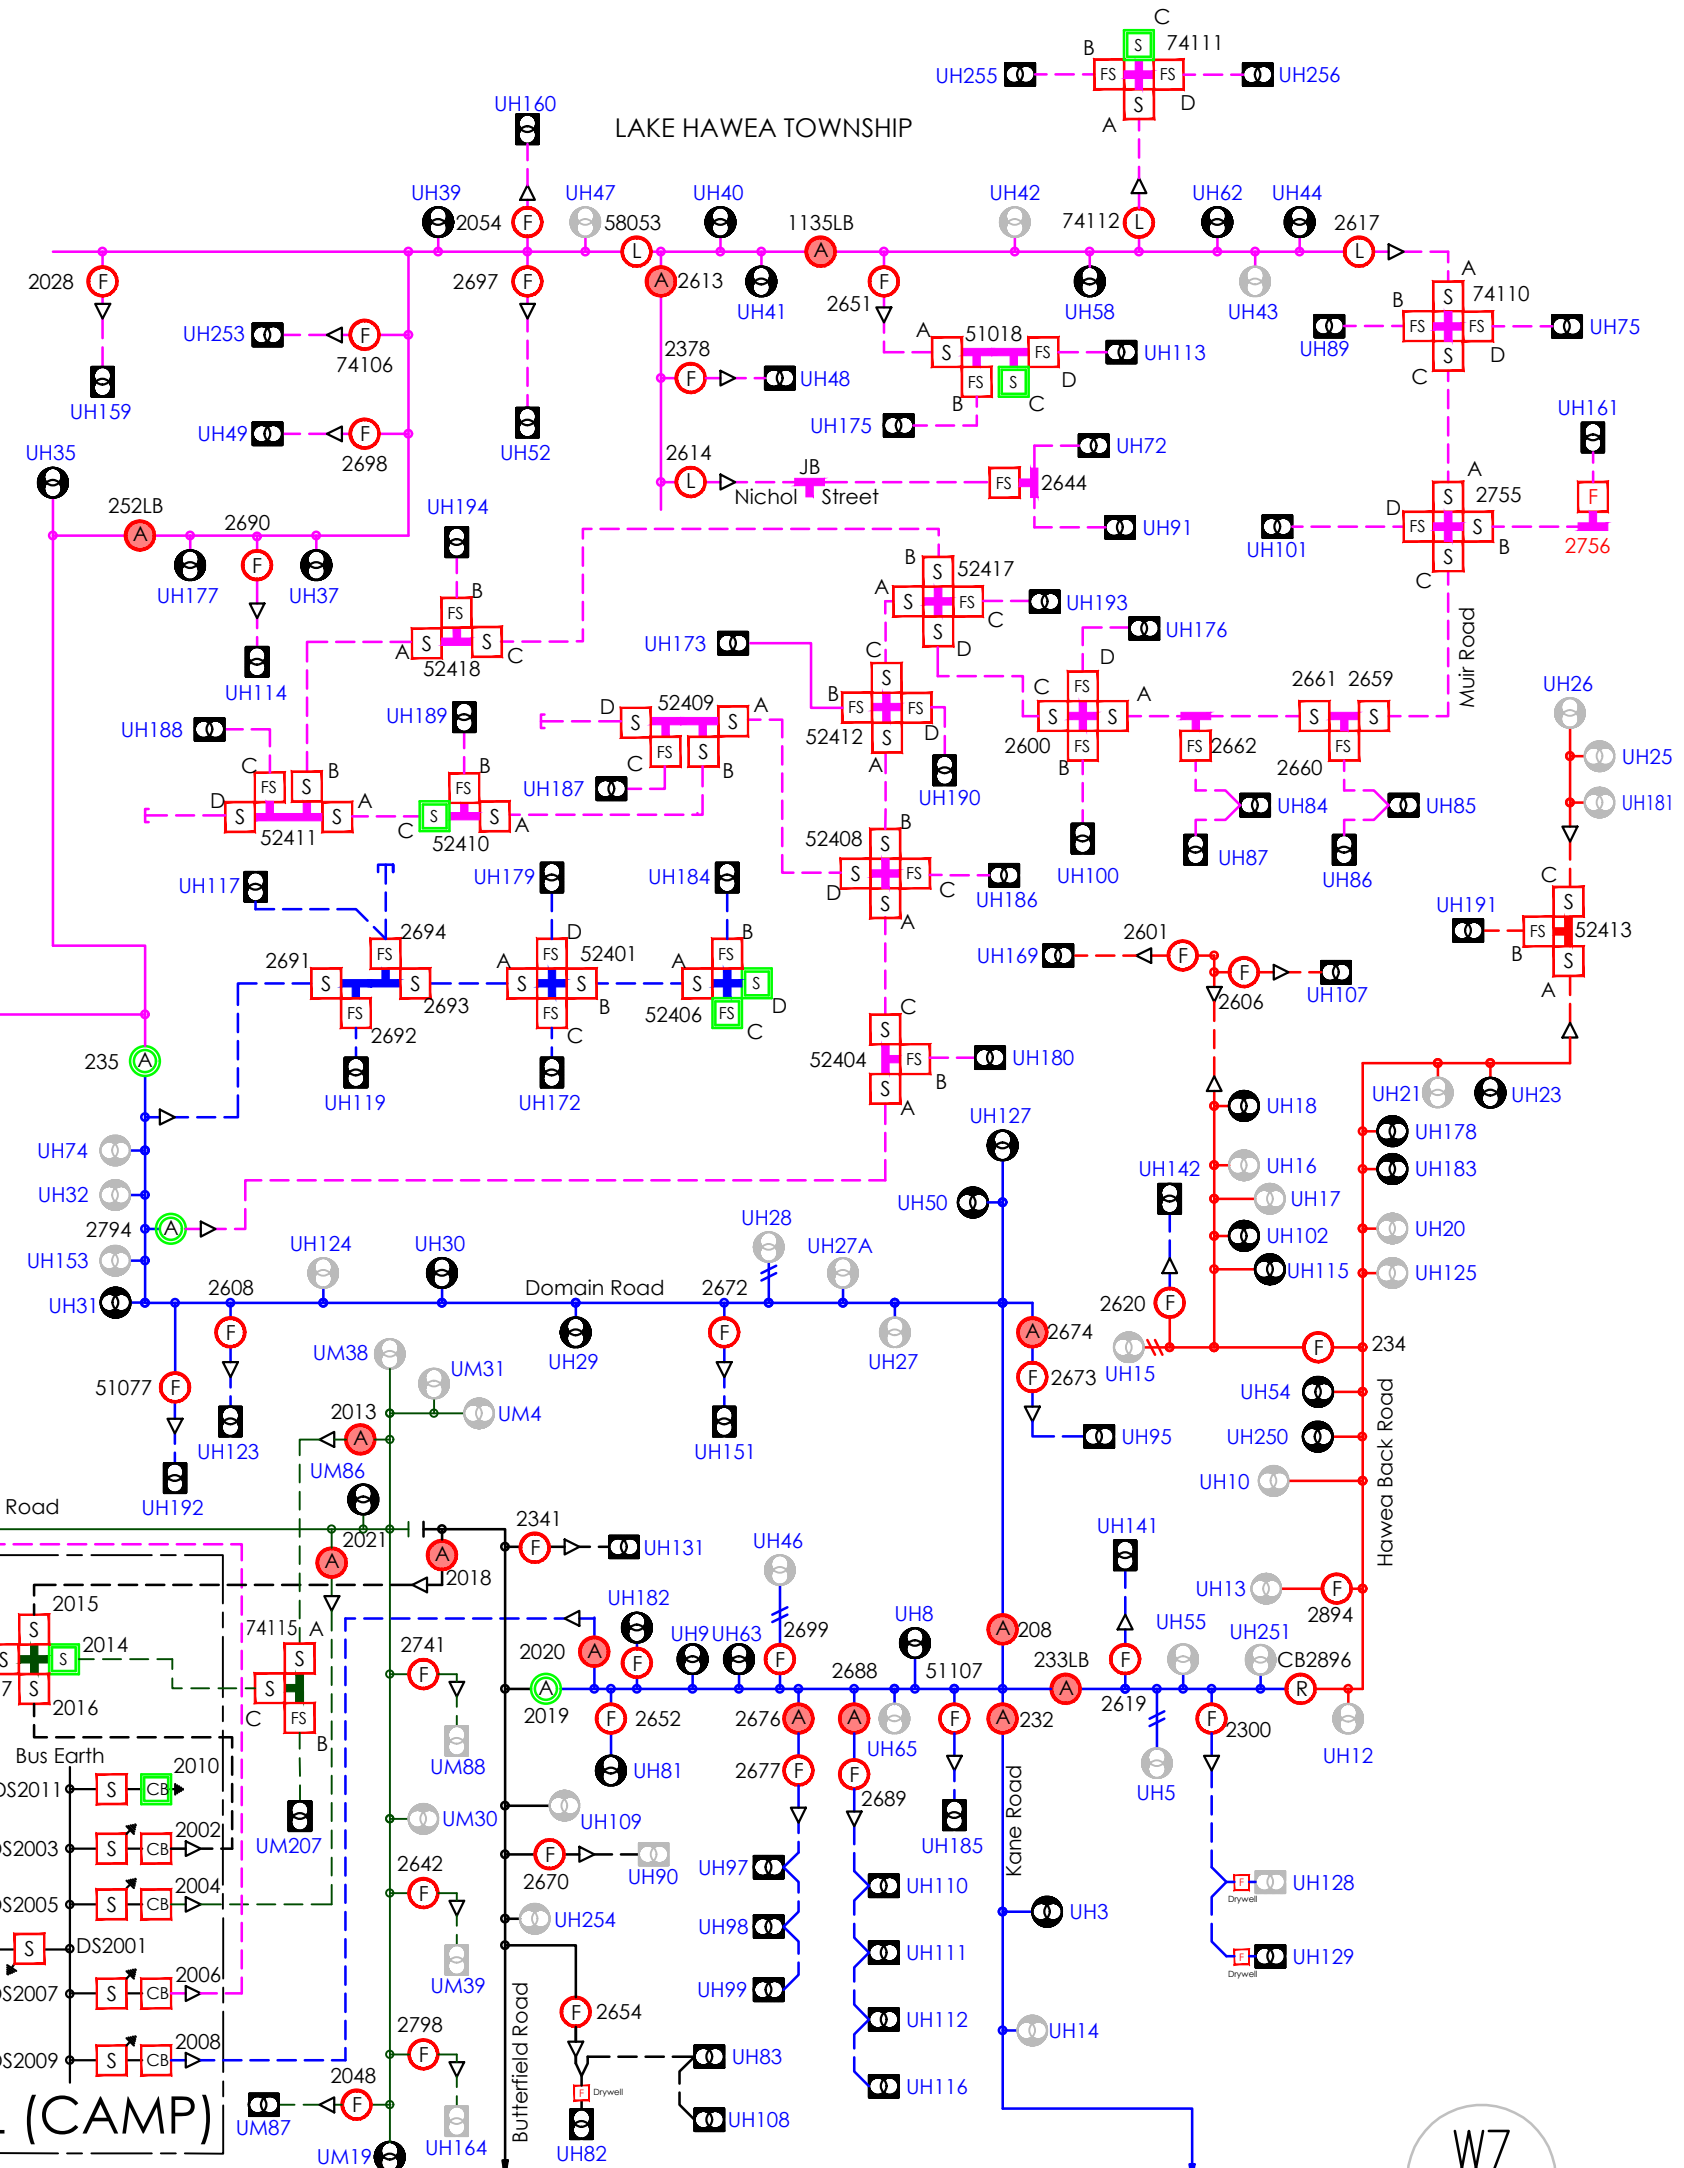

Dublin Bay Regulators  
Set regulators to neutral (zero tap)  
before closing switch 2752

W5

W7