

W9

Issue AR
13/05/26
BY CKD APPD
DCH MGB DAT


LINDIS 11kV

To ABS2407

To ABS8158LB
Maori Point Rd

Tarras Regulators
Set regulators to neutral (zero tap)
before closing switch 8160LB

Set Tarras regulators to neutral (zero tap)
before closing switch 8160LB

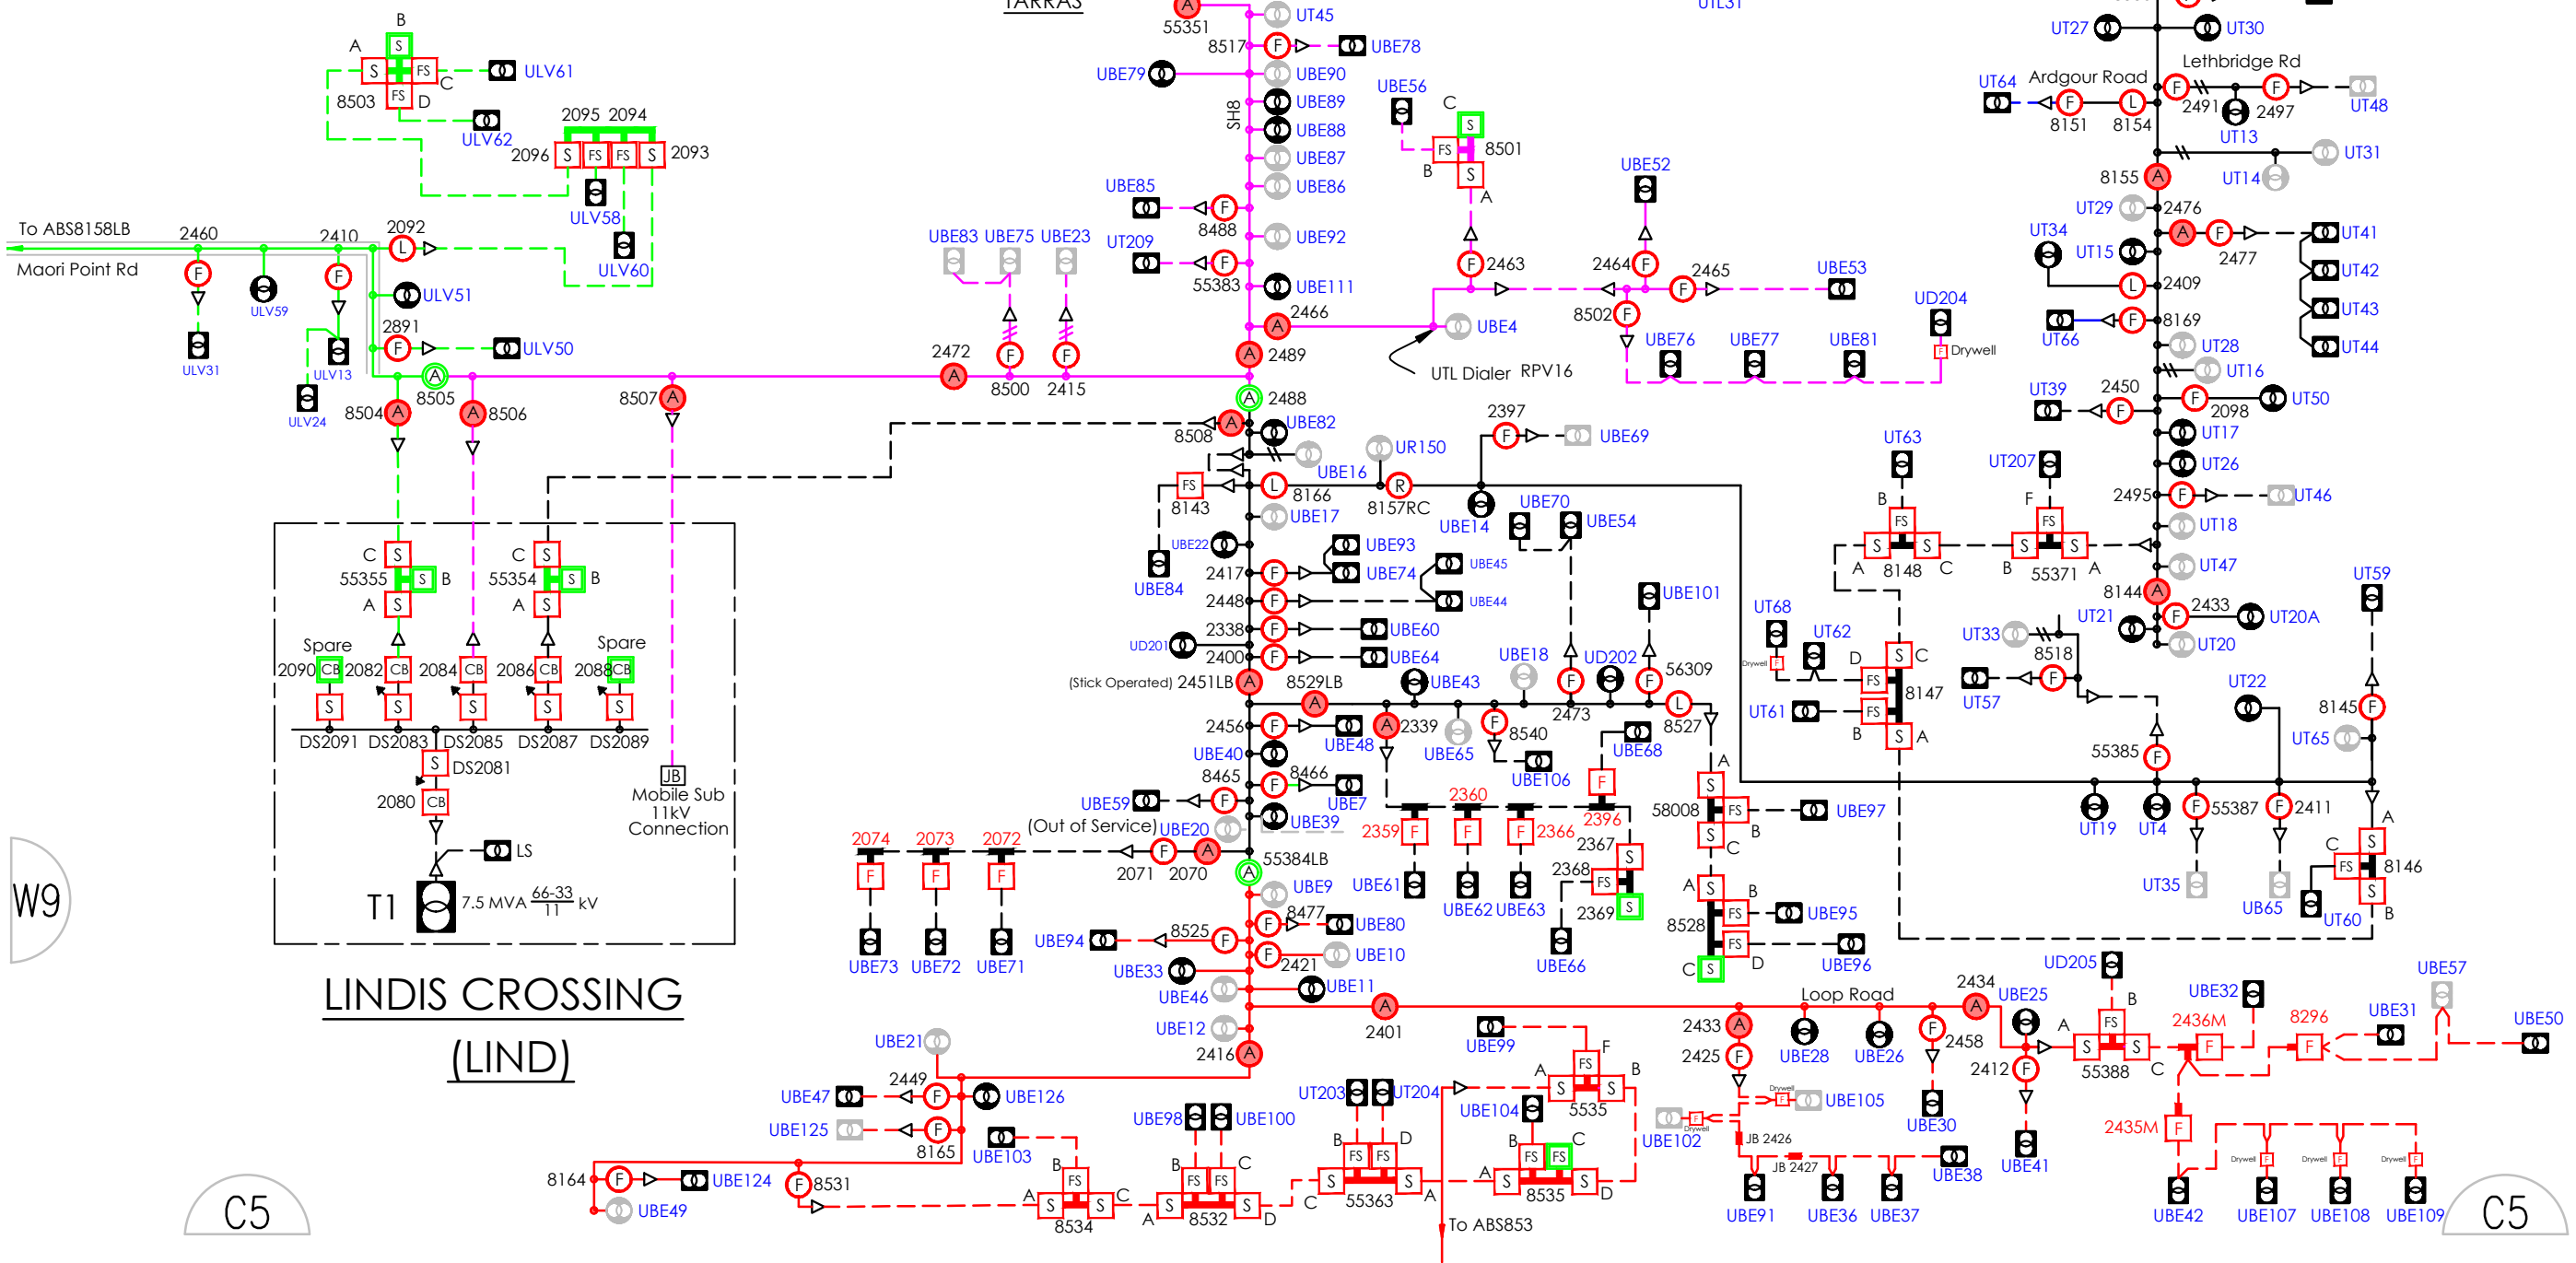

W9

LINDIS CROSSING (LIND)

C5

C5

To ABS853