


Set Dublin Bay regulators to neutral (zero tap) before closing switch 2732

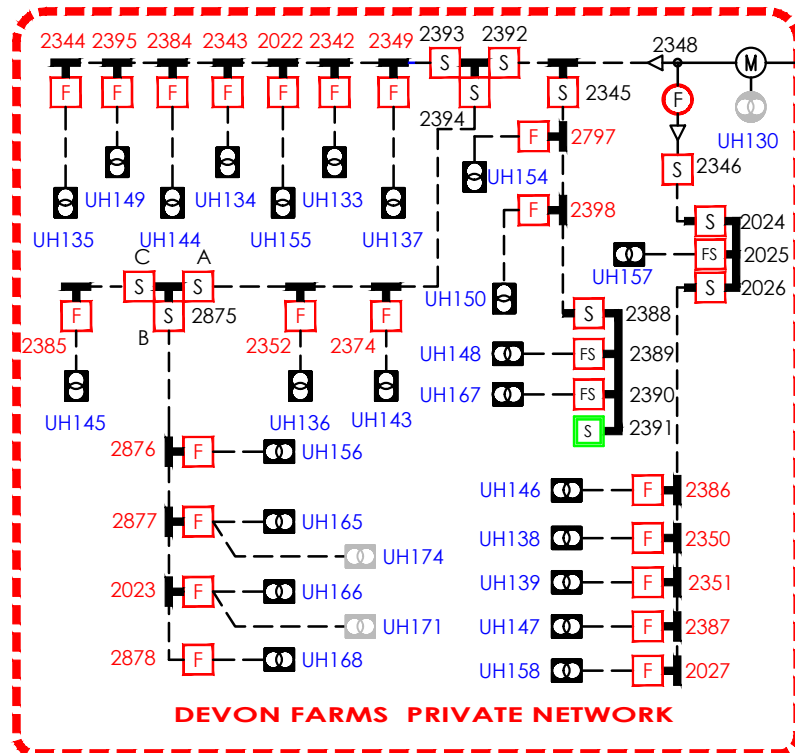

3B/03E/063
Issue ABV
05/02/26
BY CKD APPD
DCH/MGB/DAT

LUGGATE 11kV

W7

W8

To ABS2439

Luggate-Cromwell

W8

W6

W6

To ABS242 (UC No.1 - 66kV)

To ABS237 Mt Barker Road

Live End Cap

Live End Seal

Live End Seal

LUGGATE