

DALEFIELD (DALE)




FRANKTON 11kV SHEET 1

Issue ABS
11/06/26
BY CKD APPD
DCH MGB DAT

Coronet Peak
Private Network
Faults within this
network, refer the
consumer to the
network owner

CORONET PEAK (COPK)

FRANKTON (FRAN)

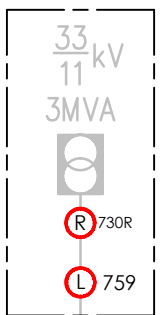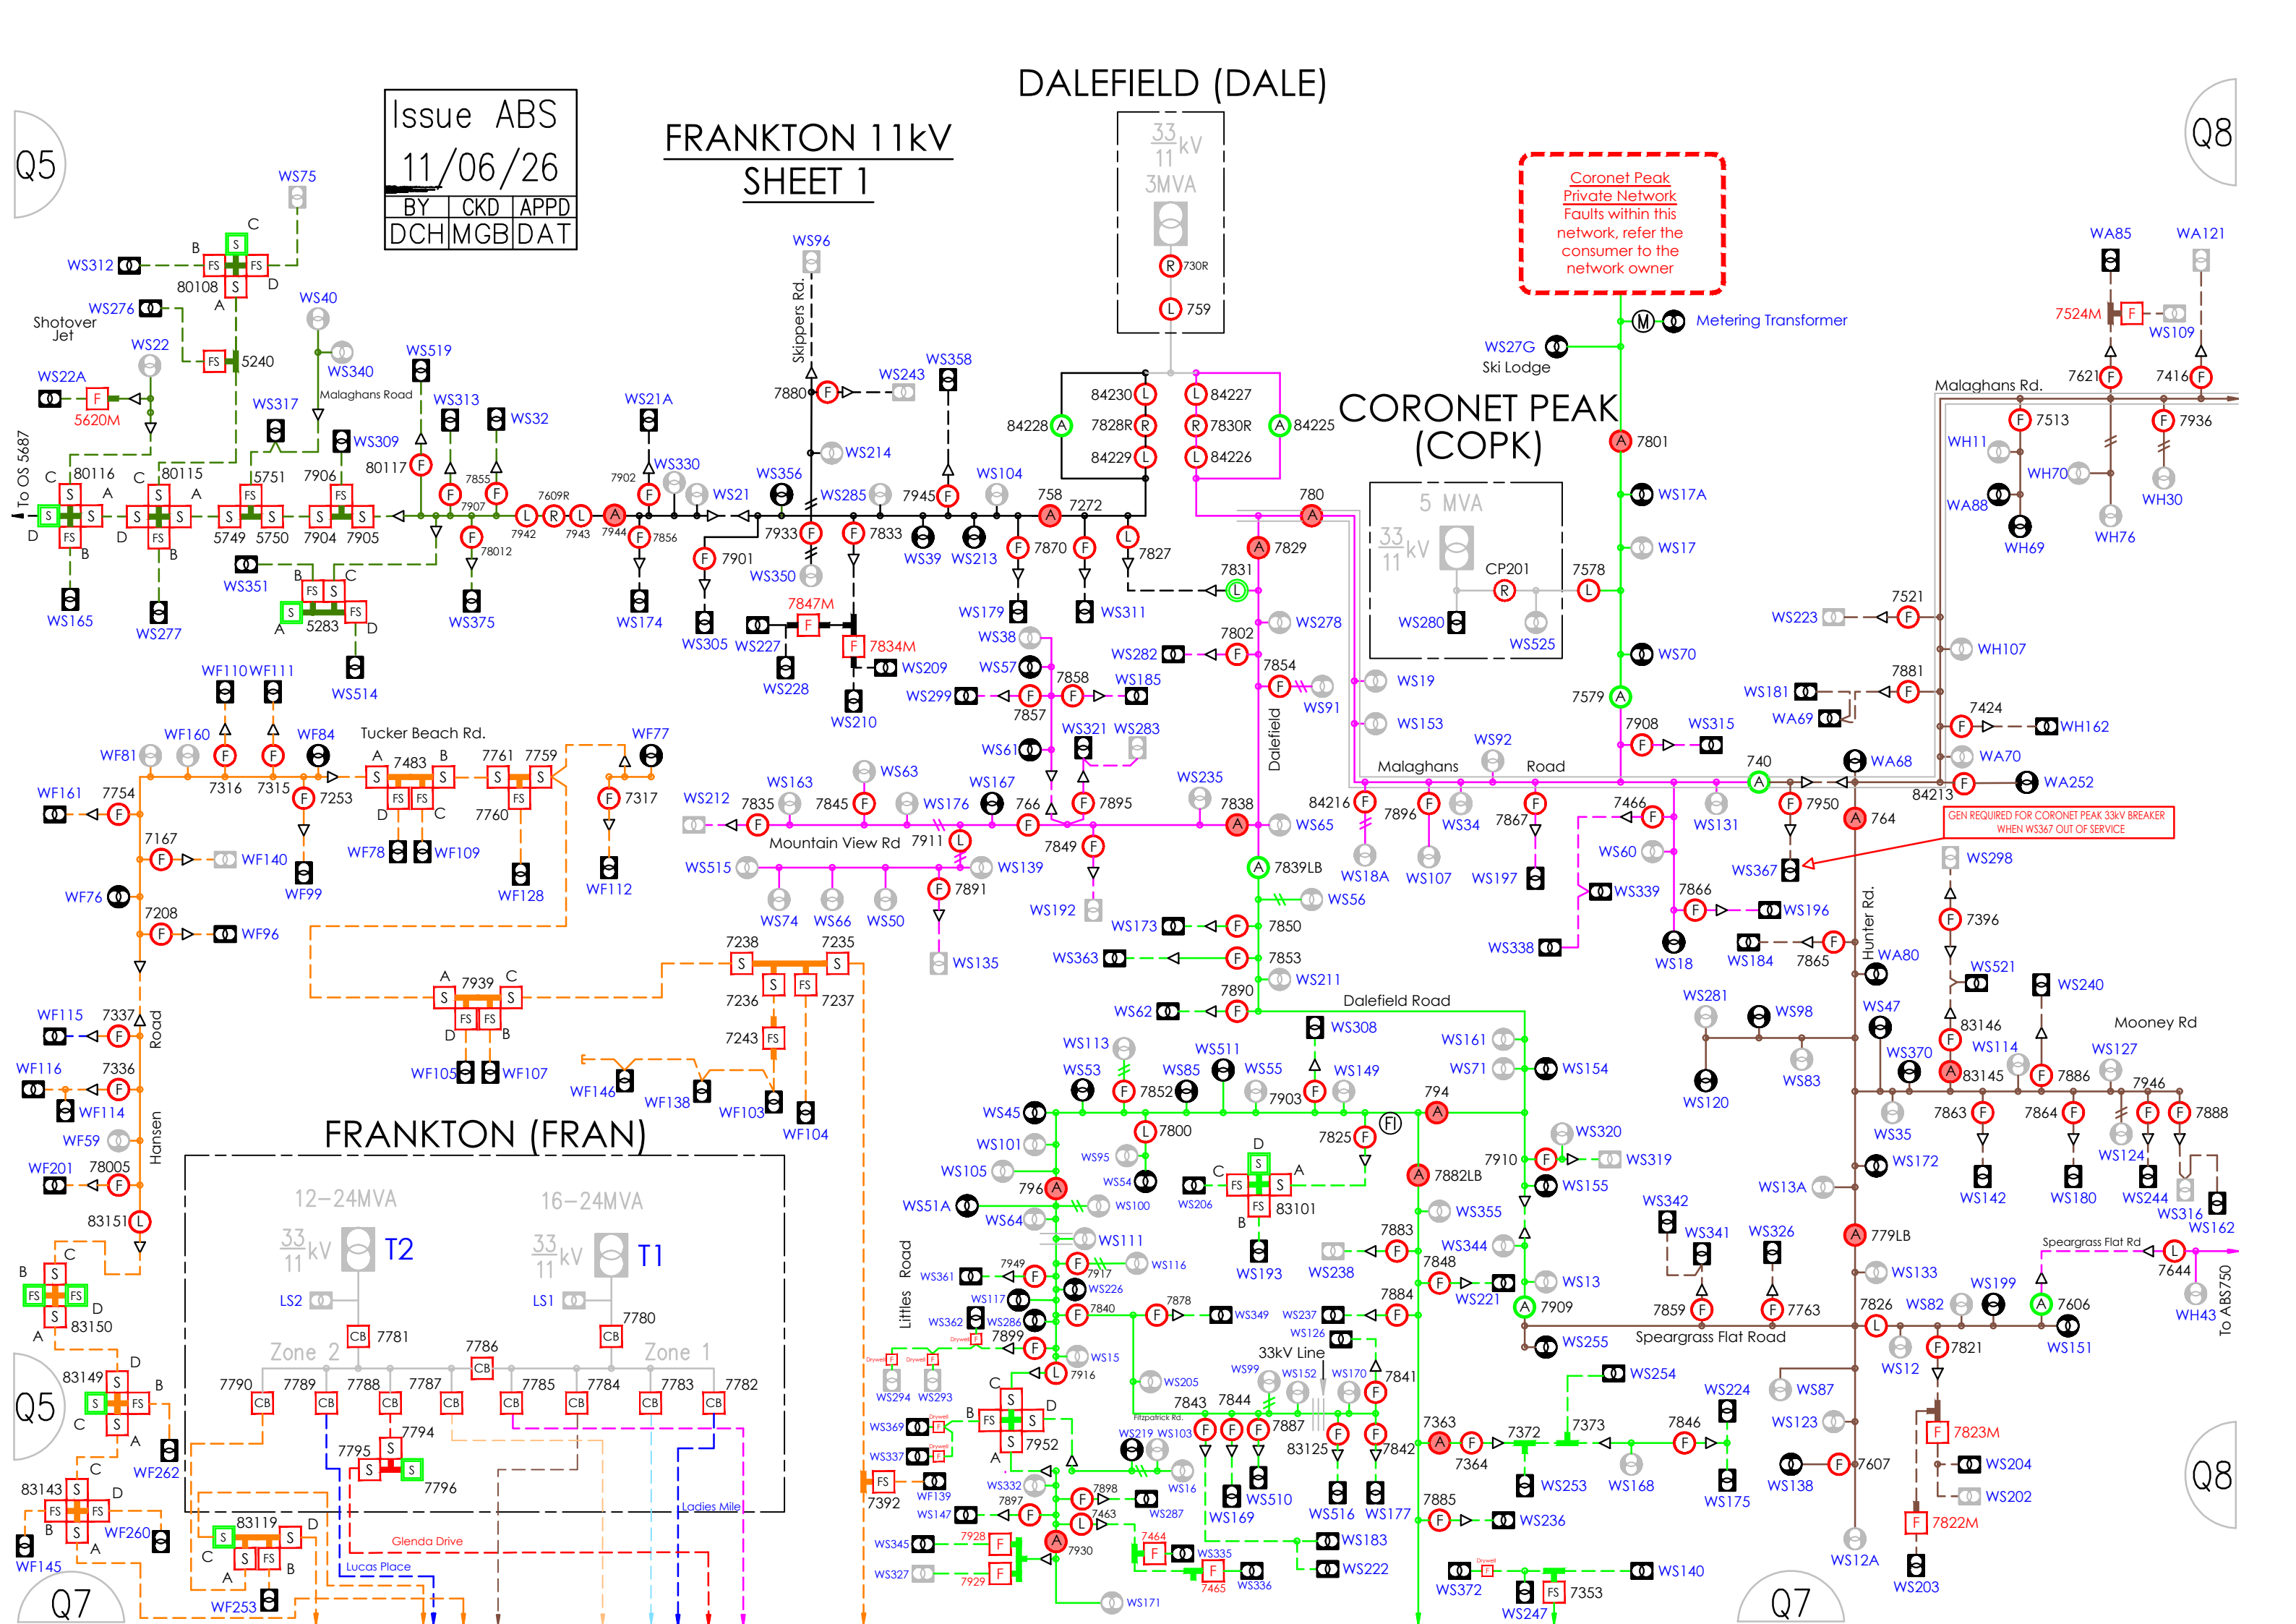

GEN REQUIRED FOR CORONET PEAK 33kV BREAKER
WHEN WS367 OUT OF SERVICE

Q7

Q8

Q5

Q8

Q5

Q7