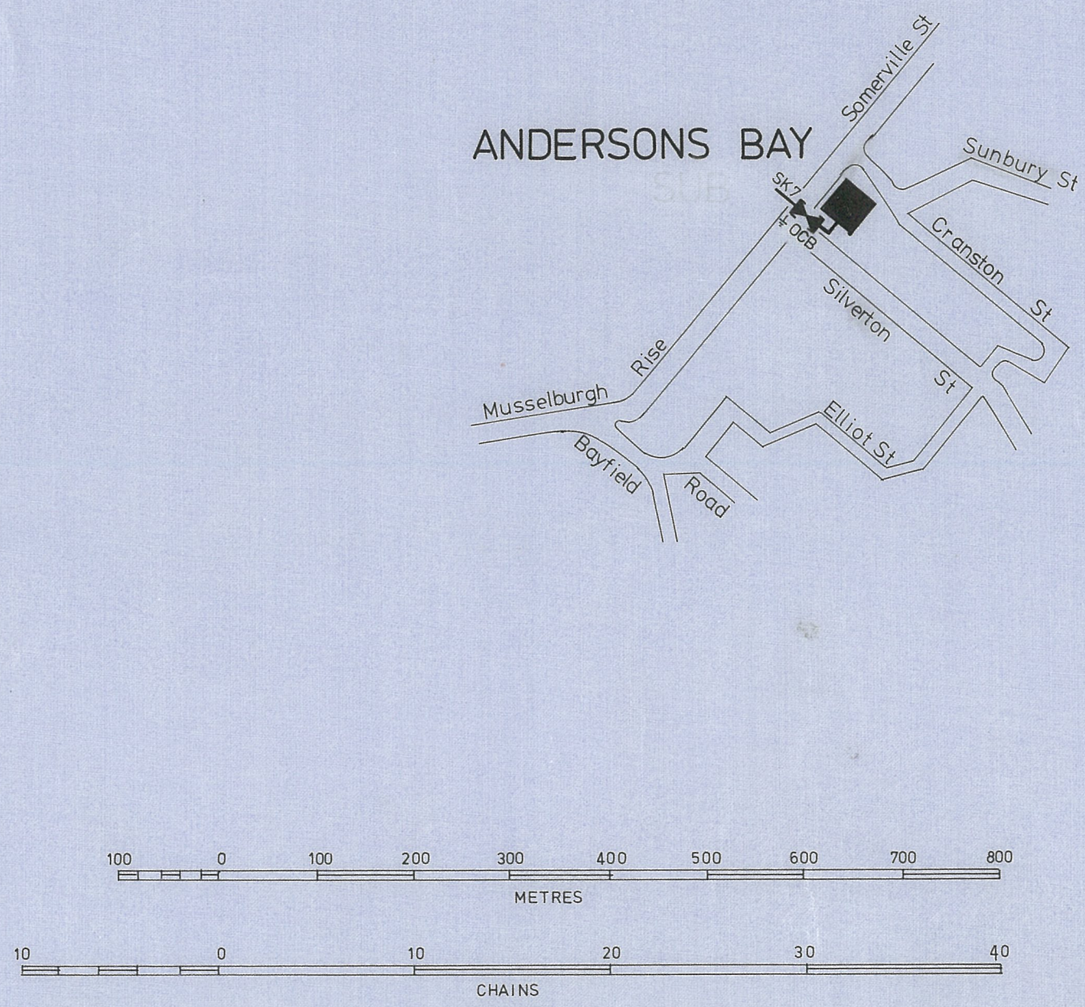

REVISION	A	B
COMP. NO.	2744	–
DATE	16·12·81	2·7·86
CHECKED		LRM

DRAWN J.E.P. 11·6·81
TRACED G.D. 11·6·81
CHECKED 11·6·81
DES.ENG.

CHIEF ENGINEER

D.C.C. Electricity DEPT.

ANDERSONS BAY N°12 6·6 kV FEEDERS

DATE ISSUED

PAGE A12

T+P