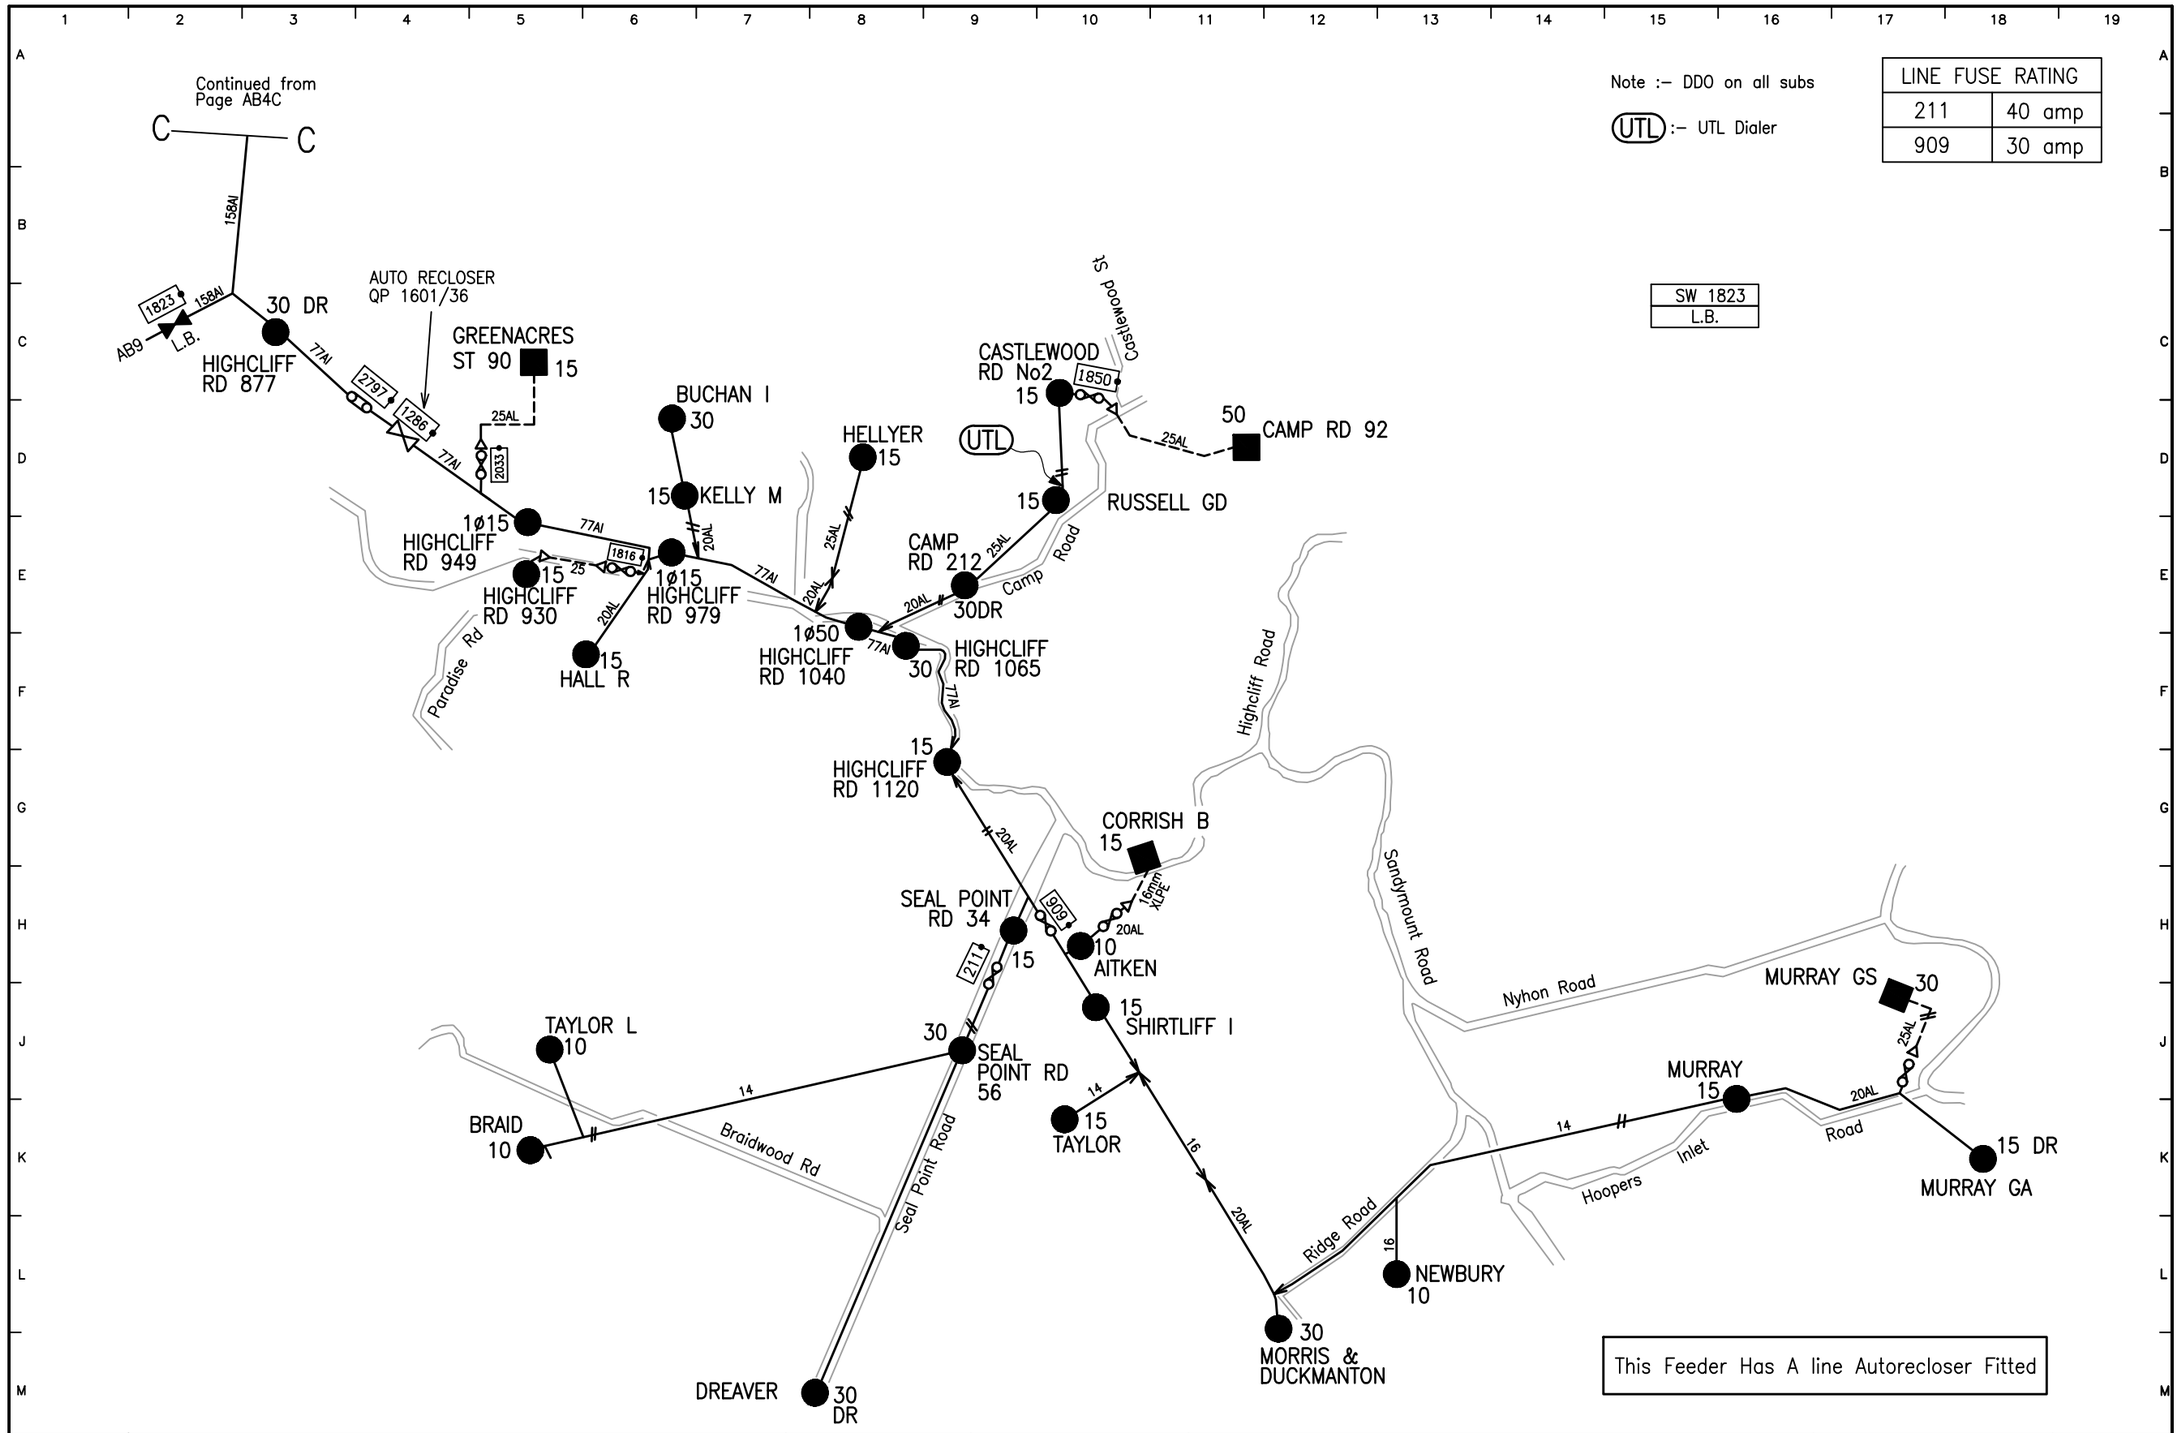

Note :– DDO on all subs

UTL :– UTL Dialer

LINE FUSE RATING	
211	40 amp
909	30 amp

SW 1823
L.B.

This Feeder Has A line Autorecloser Fitted

REVISION	U	V	W	X	Y	Z		Q	R	S	T	DRAWN G D	05/78
COMP. NO	–	CFR 11248	CFR 13703	–	–	–		–	CFR 6195	–	–	TRACED T J A	11/05
DATE	12/21	04/22	10/25	03/26	05/26	05/26		10/11	05/12	12/12	01/20	CHECKED D L P	11/05
CHECKED	RWO	NH	DCH	DCH	LMW	DCH		SJM	SJM		CS	DES.ENG	

Aurora

ANDERSONS BAY No4 6.6kV FEEDER

DATE ISSUED 15/05/26

PAGE AB 4D