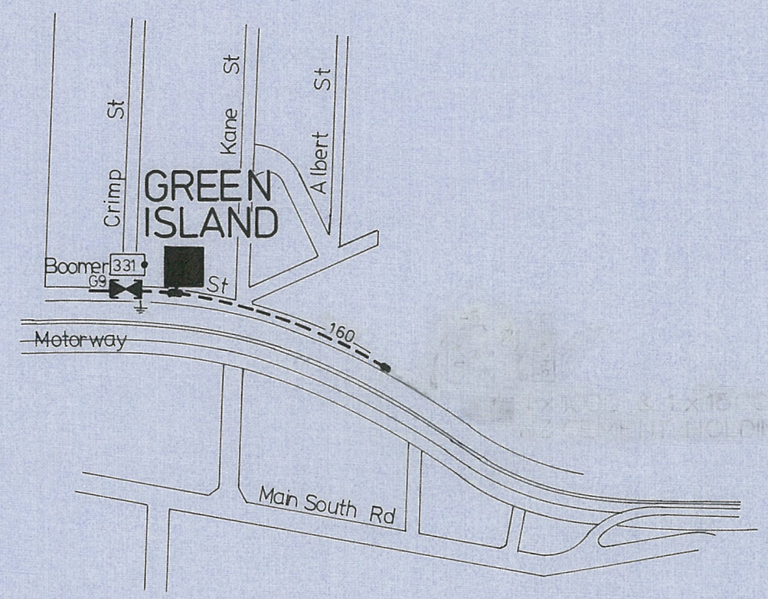

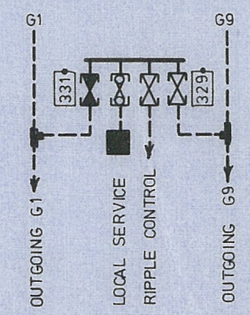

Detail of auxiliary switchgear at Green Island Substation.

REVISION	A	B	C	D	E	F
COMP. NO.	4045	4051	-	-	-	6864
DATE	19·12·83	17·1·84	3·7·85	7·7·86	9·9·87	14·3·91
CHECKED	[illegible]	[illegible]	KB	LRM	LRM	[illegible]

DRAWN P.U.
TRACED S.D. 20·4·79
CHECKED LRM 25·5·79
DES. ENG. NLA
R.C. Hones
CHIEF ENGINEER

D.C.C. Electricity DEPT.

GREEN ISLAND N°1 6·6kV FEEDER

DATE ISSUED

PAGE G1