



Note :- DDO on all subs

LINE FUSE RATING	
313	30amp

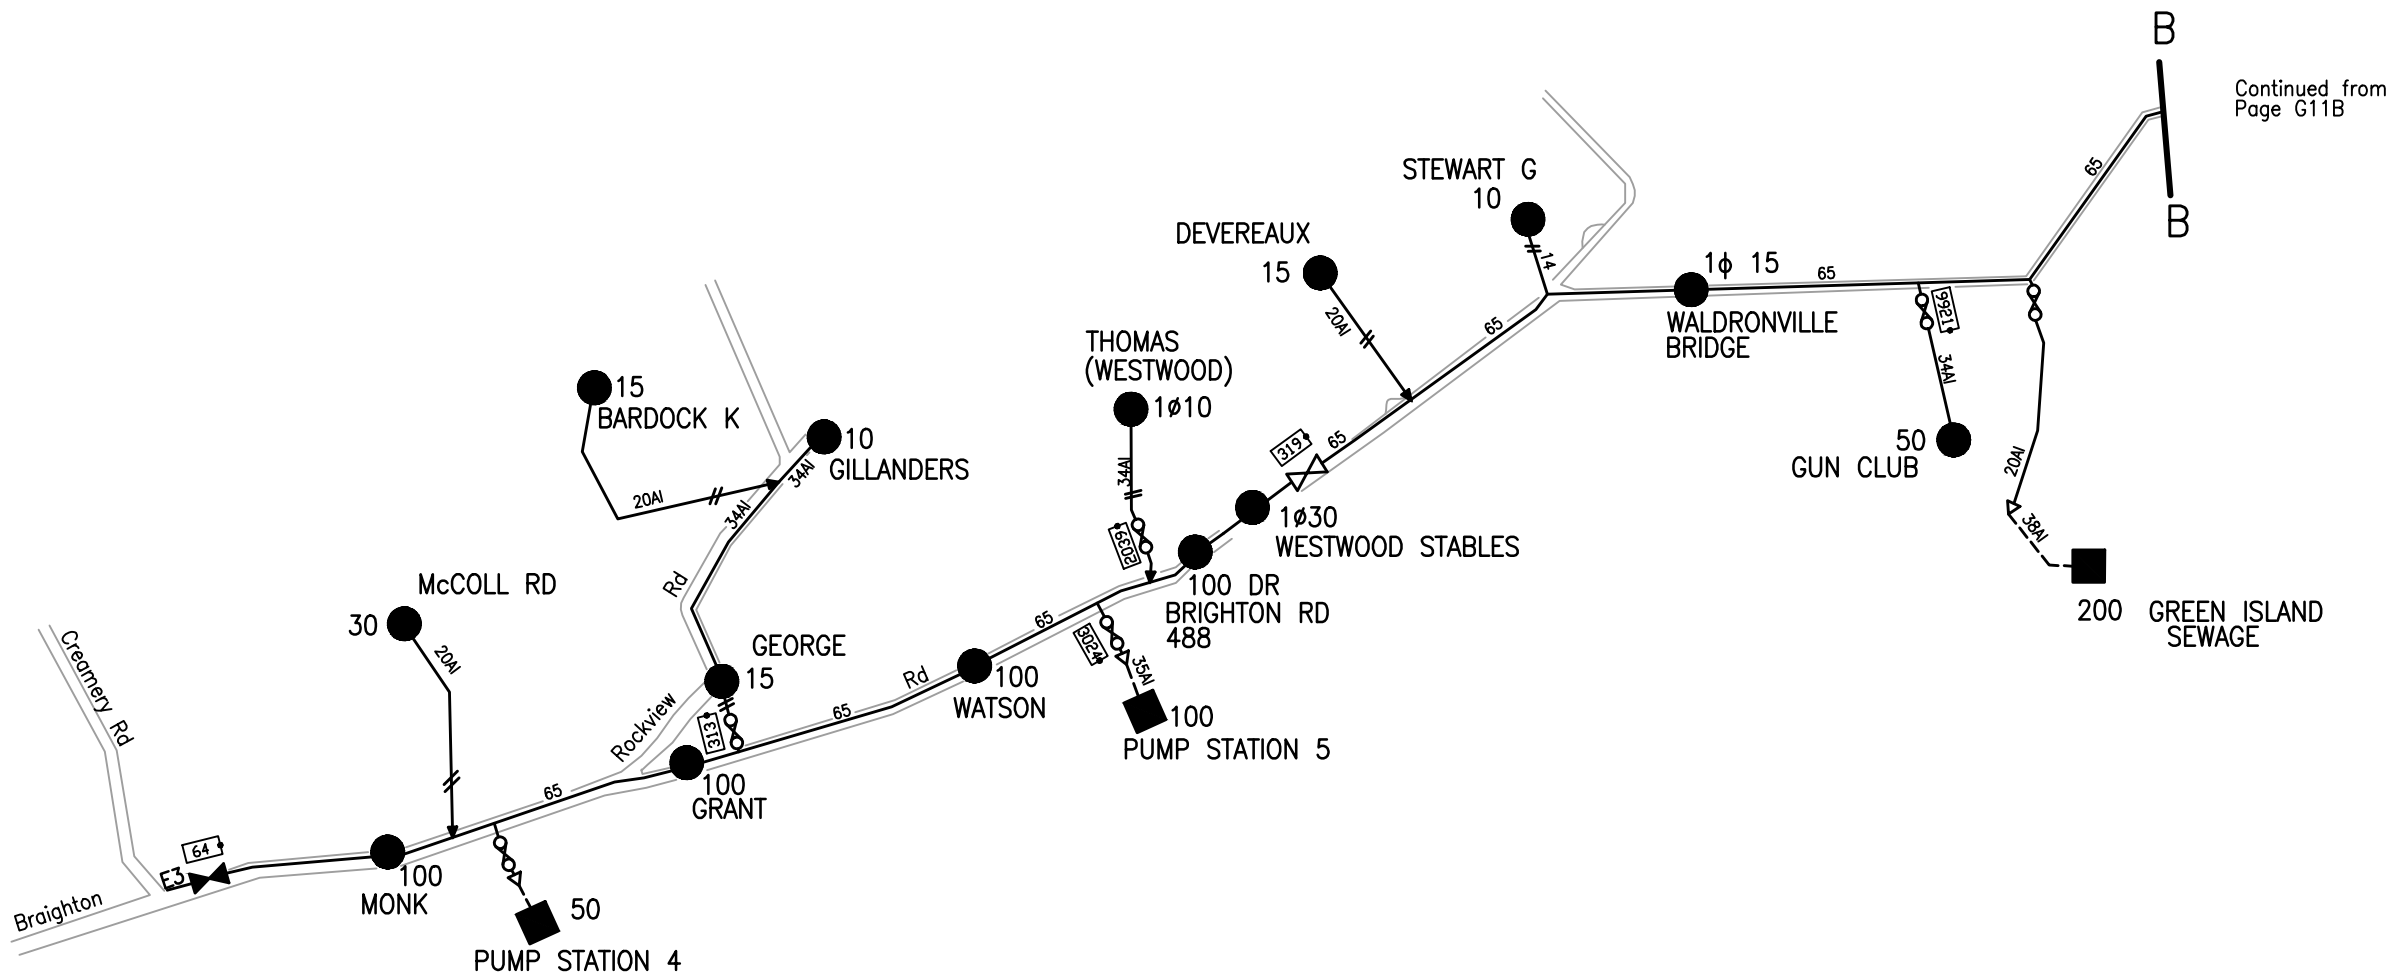

Continued from Page G11B



REVISION	X		O	P	Q	R	S	T	U	V	W	DRAWN	P	R	D	-
COMP. NO	CFR 12476		1392	-	-	-	-	-	-	-	CFR 12476	TRACED	C	A	S	01/07
DATE	02/24		09/97	6/00	09/07	09/09	04/11	11/12	05/21	08/23	02/24	CHECKED				
CHECKED	MB		KTB	KTB	SJM	SJM	SJM		CBP	MB	DCH	DES.ENG				



GREEN ISLAND No11 6.6kV FEEDER

DATE ISSUED	PAGE
23/02/24	G11C