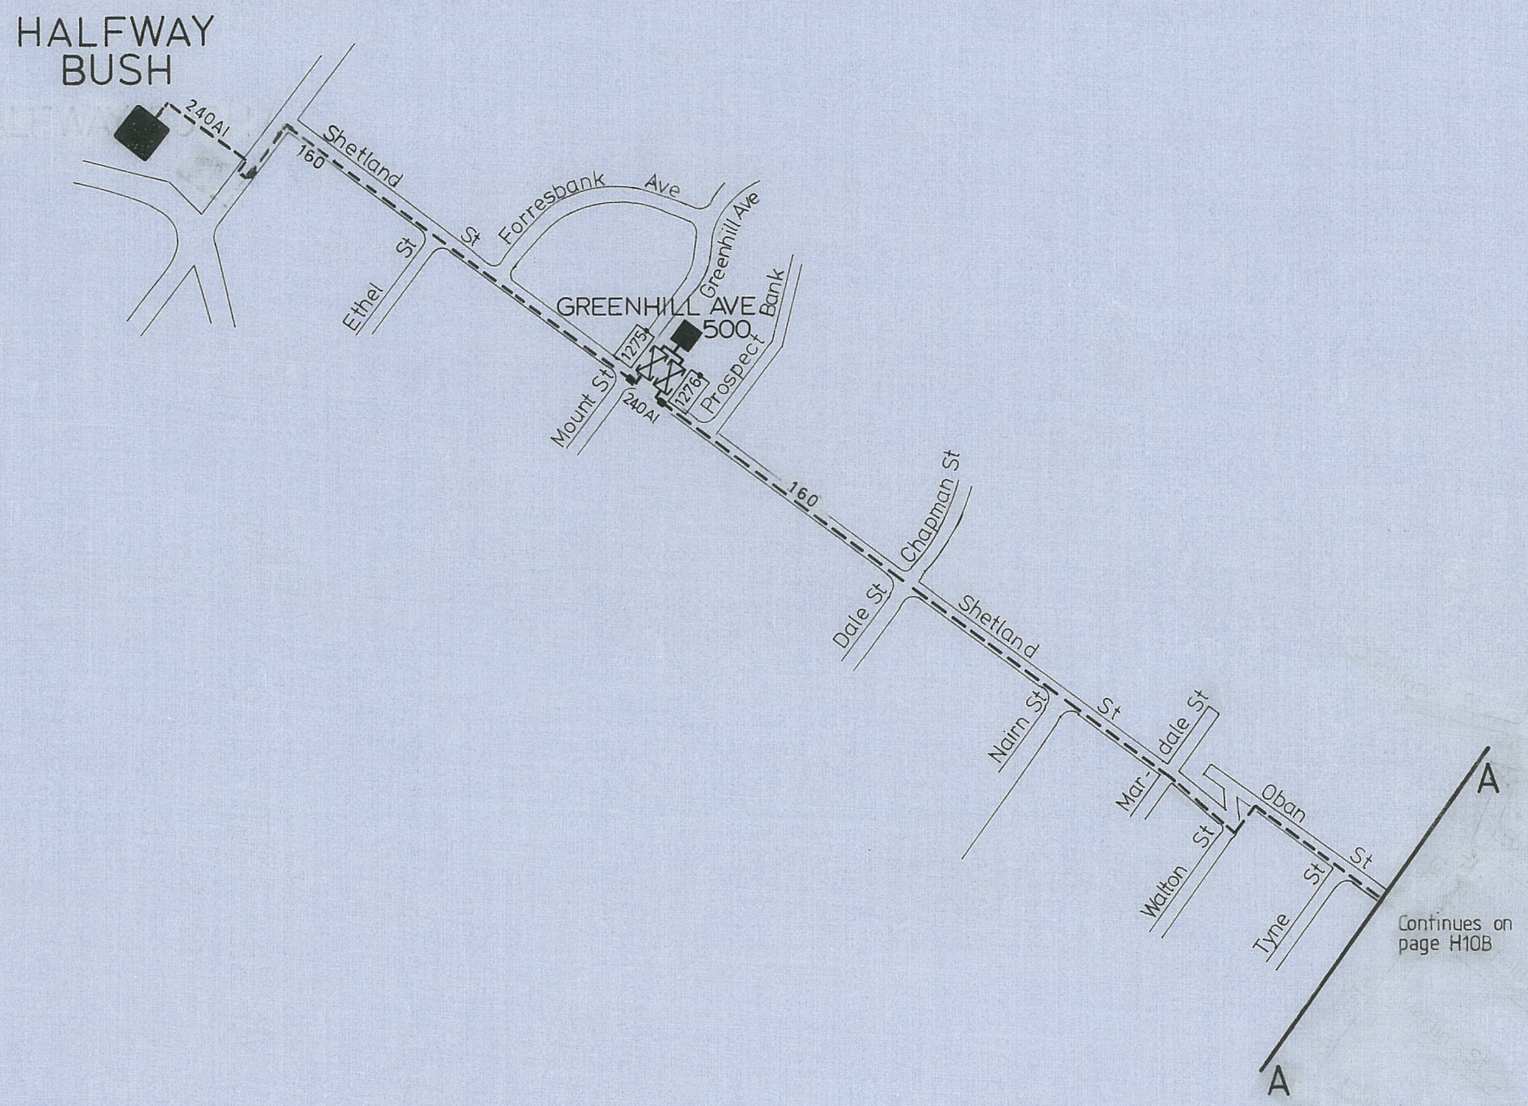

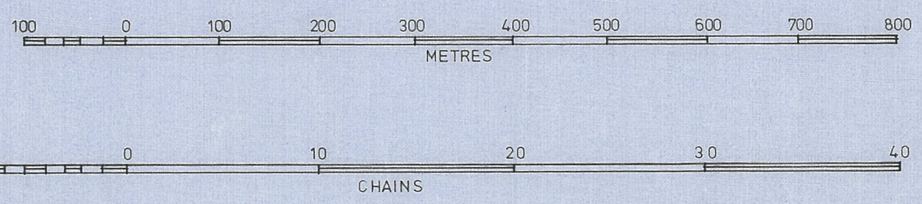

REVISION	A	B	C
COMP. NO.	4805	5174	6539
DATE	11-4-86	24-4-87	12-7-90
CHECKED	LRM	LRM	

DRAWN
TRACED G.D 16-3-79
CHECKED LRM
DES.ENG. NLA
CHIEF ENGINEER

D.C.C. Electricity DEPT.

HALFWAY BUSH N° 10 6·6kV FEEDER

DATE ISSUED

PAGE H10A