



1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19

Note :- DDO on all subs

This Feeder Has a Line Autorecloser Fitted

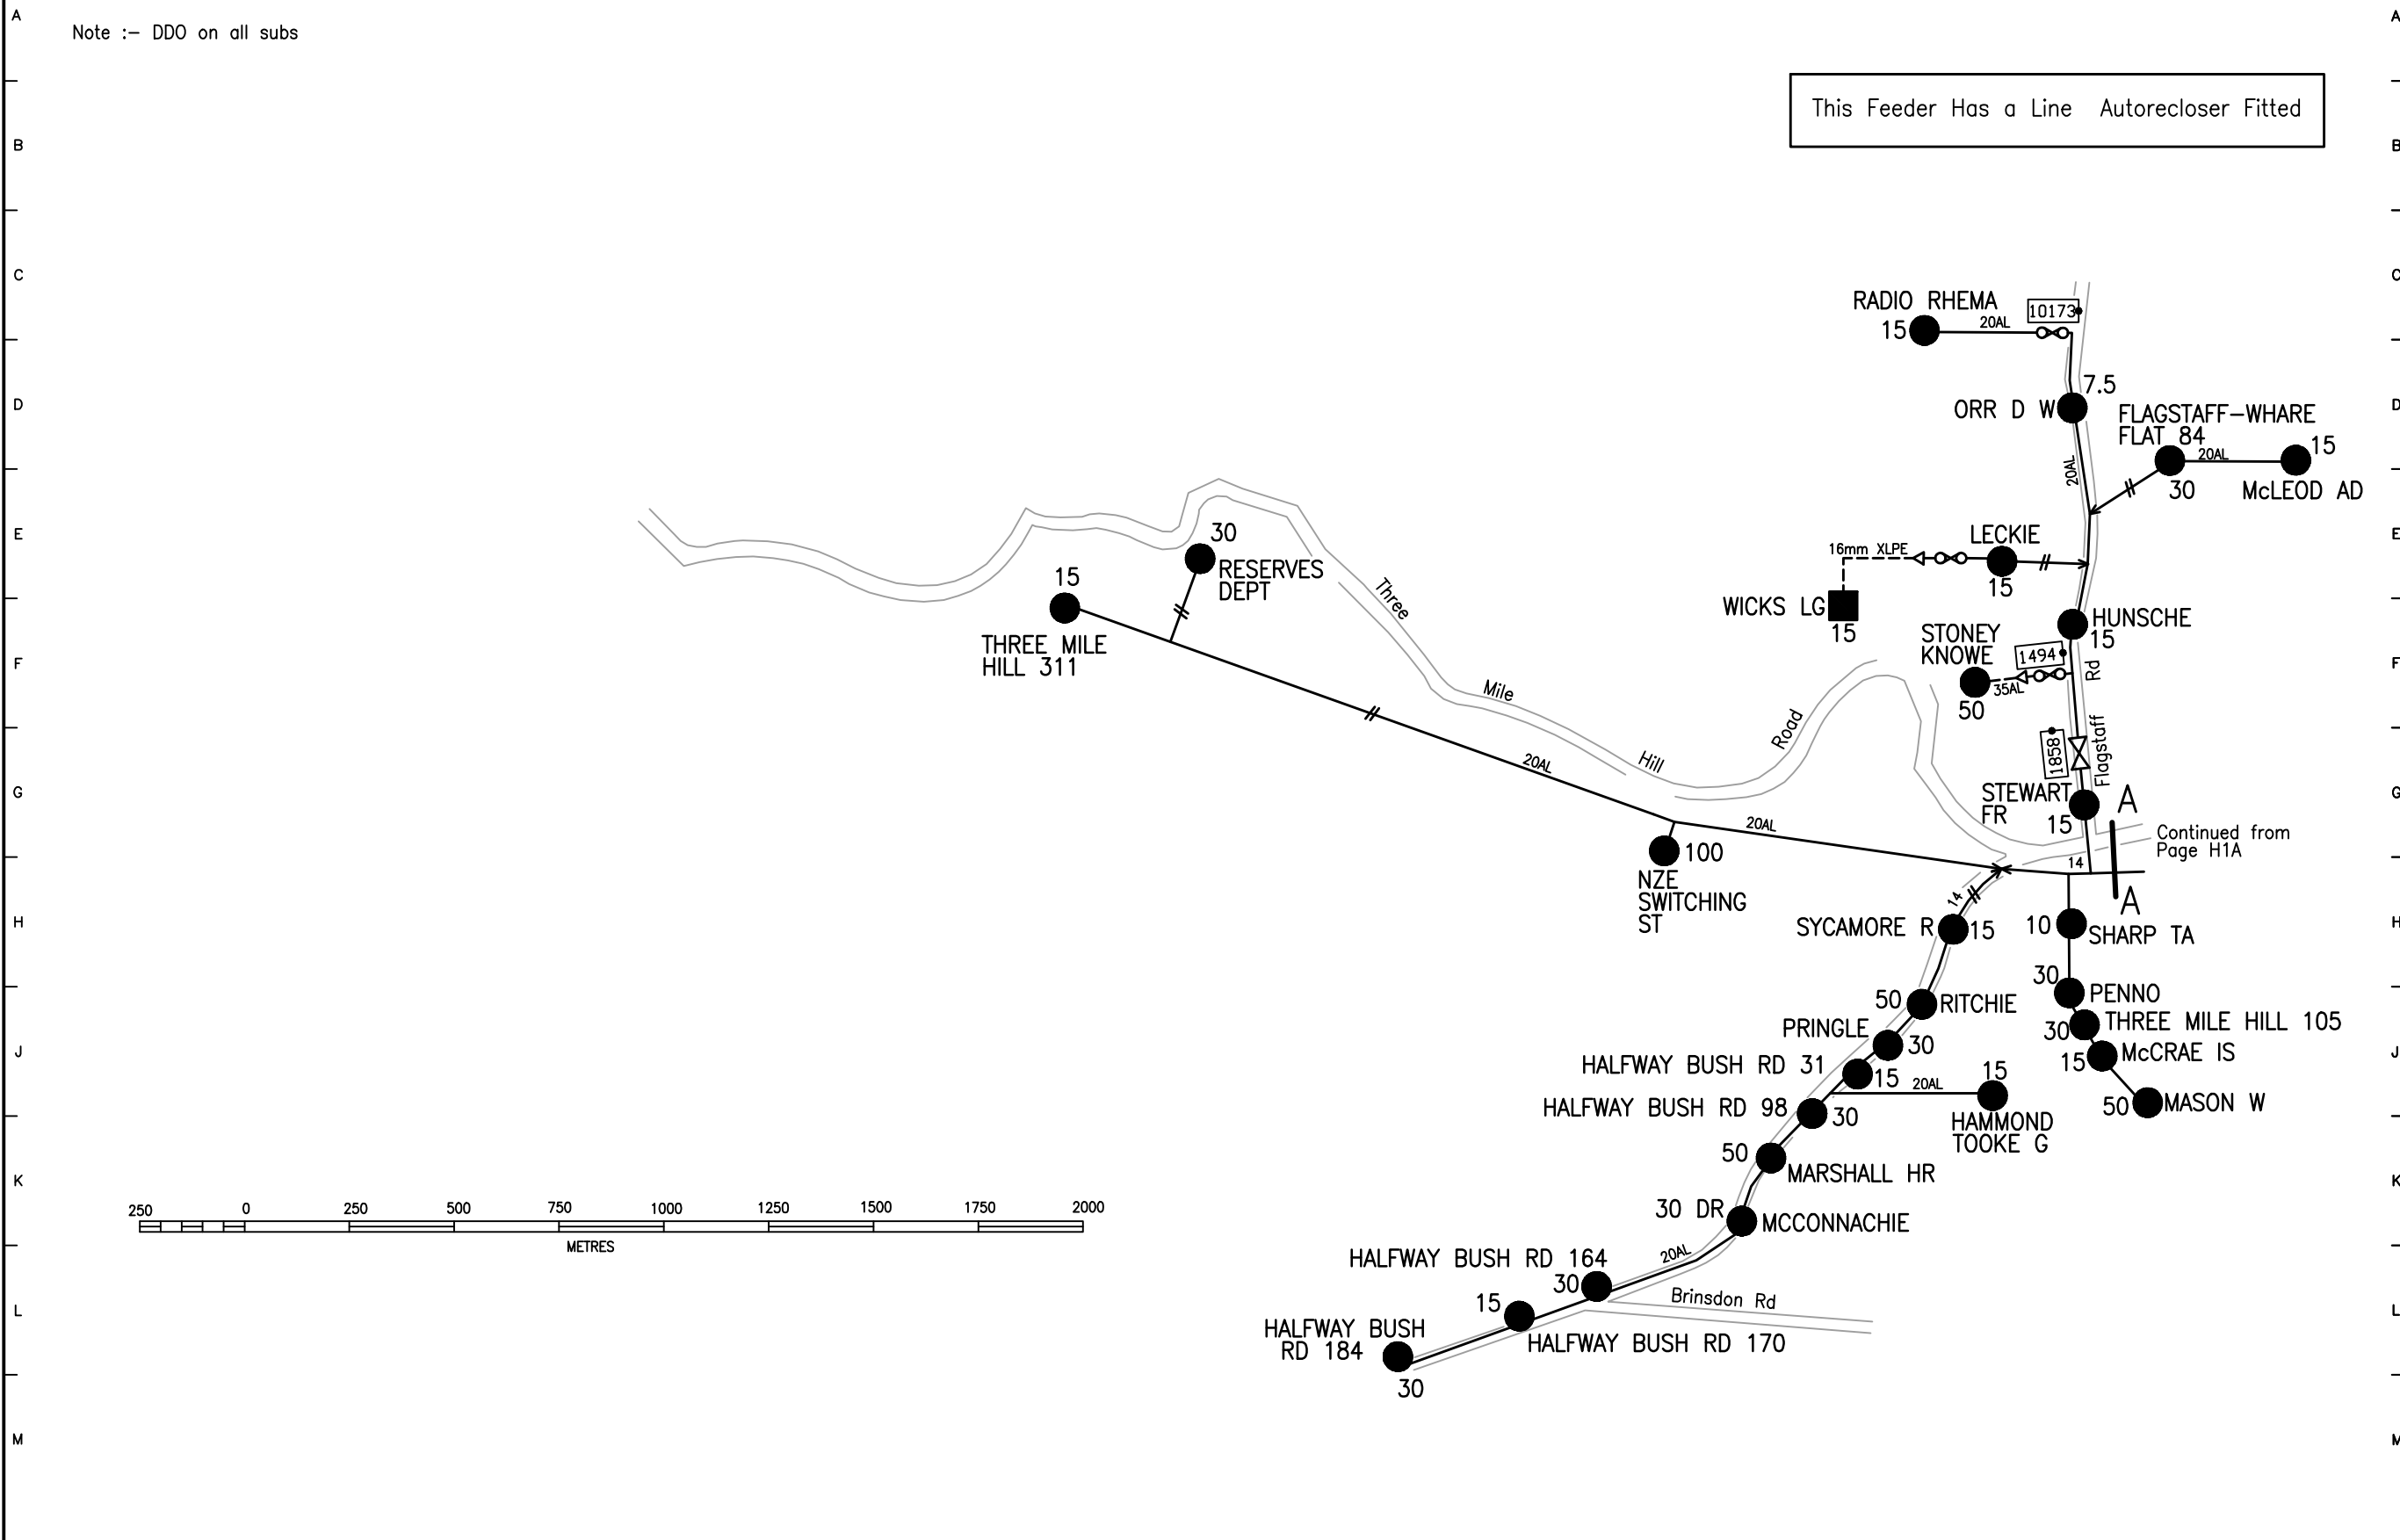

REVISION		L	M	N	O	P	Q	R	S	T	U	DRAWN	D S P	03/79
COMP. NO		1051	CFR 2859	CFR 4270	-	-	-	-	-	FAULT	-	TRACED	T J A	02/06
DATE		12/96	02/06	08/08	05/13	08/13	04/19	09/22	09/22	02/23	03/25	CHECKED	D L P	02/06
CHECKED		DLP	DLP	SJM	SJM		CJ	CBP	MB	DH	MGB	DES.ENG		



# HALFWAY BUSH No1 6.6kV FEEDER

DATE ISSUED  
**01/04/25**

PAGE  
**HB 1B**