Note :– DDO Fuses beyond Switch 367.

SW 10
L.B.

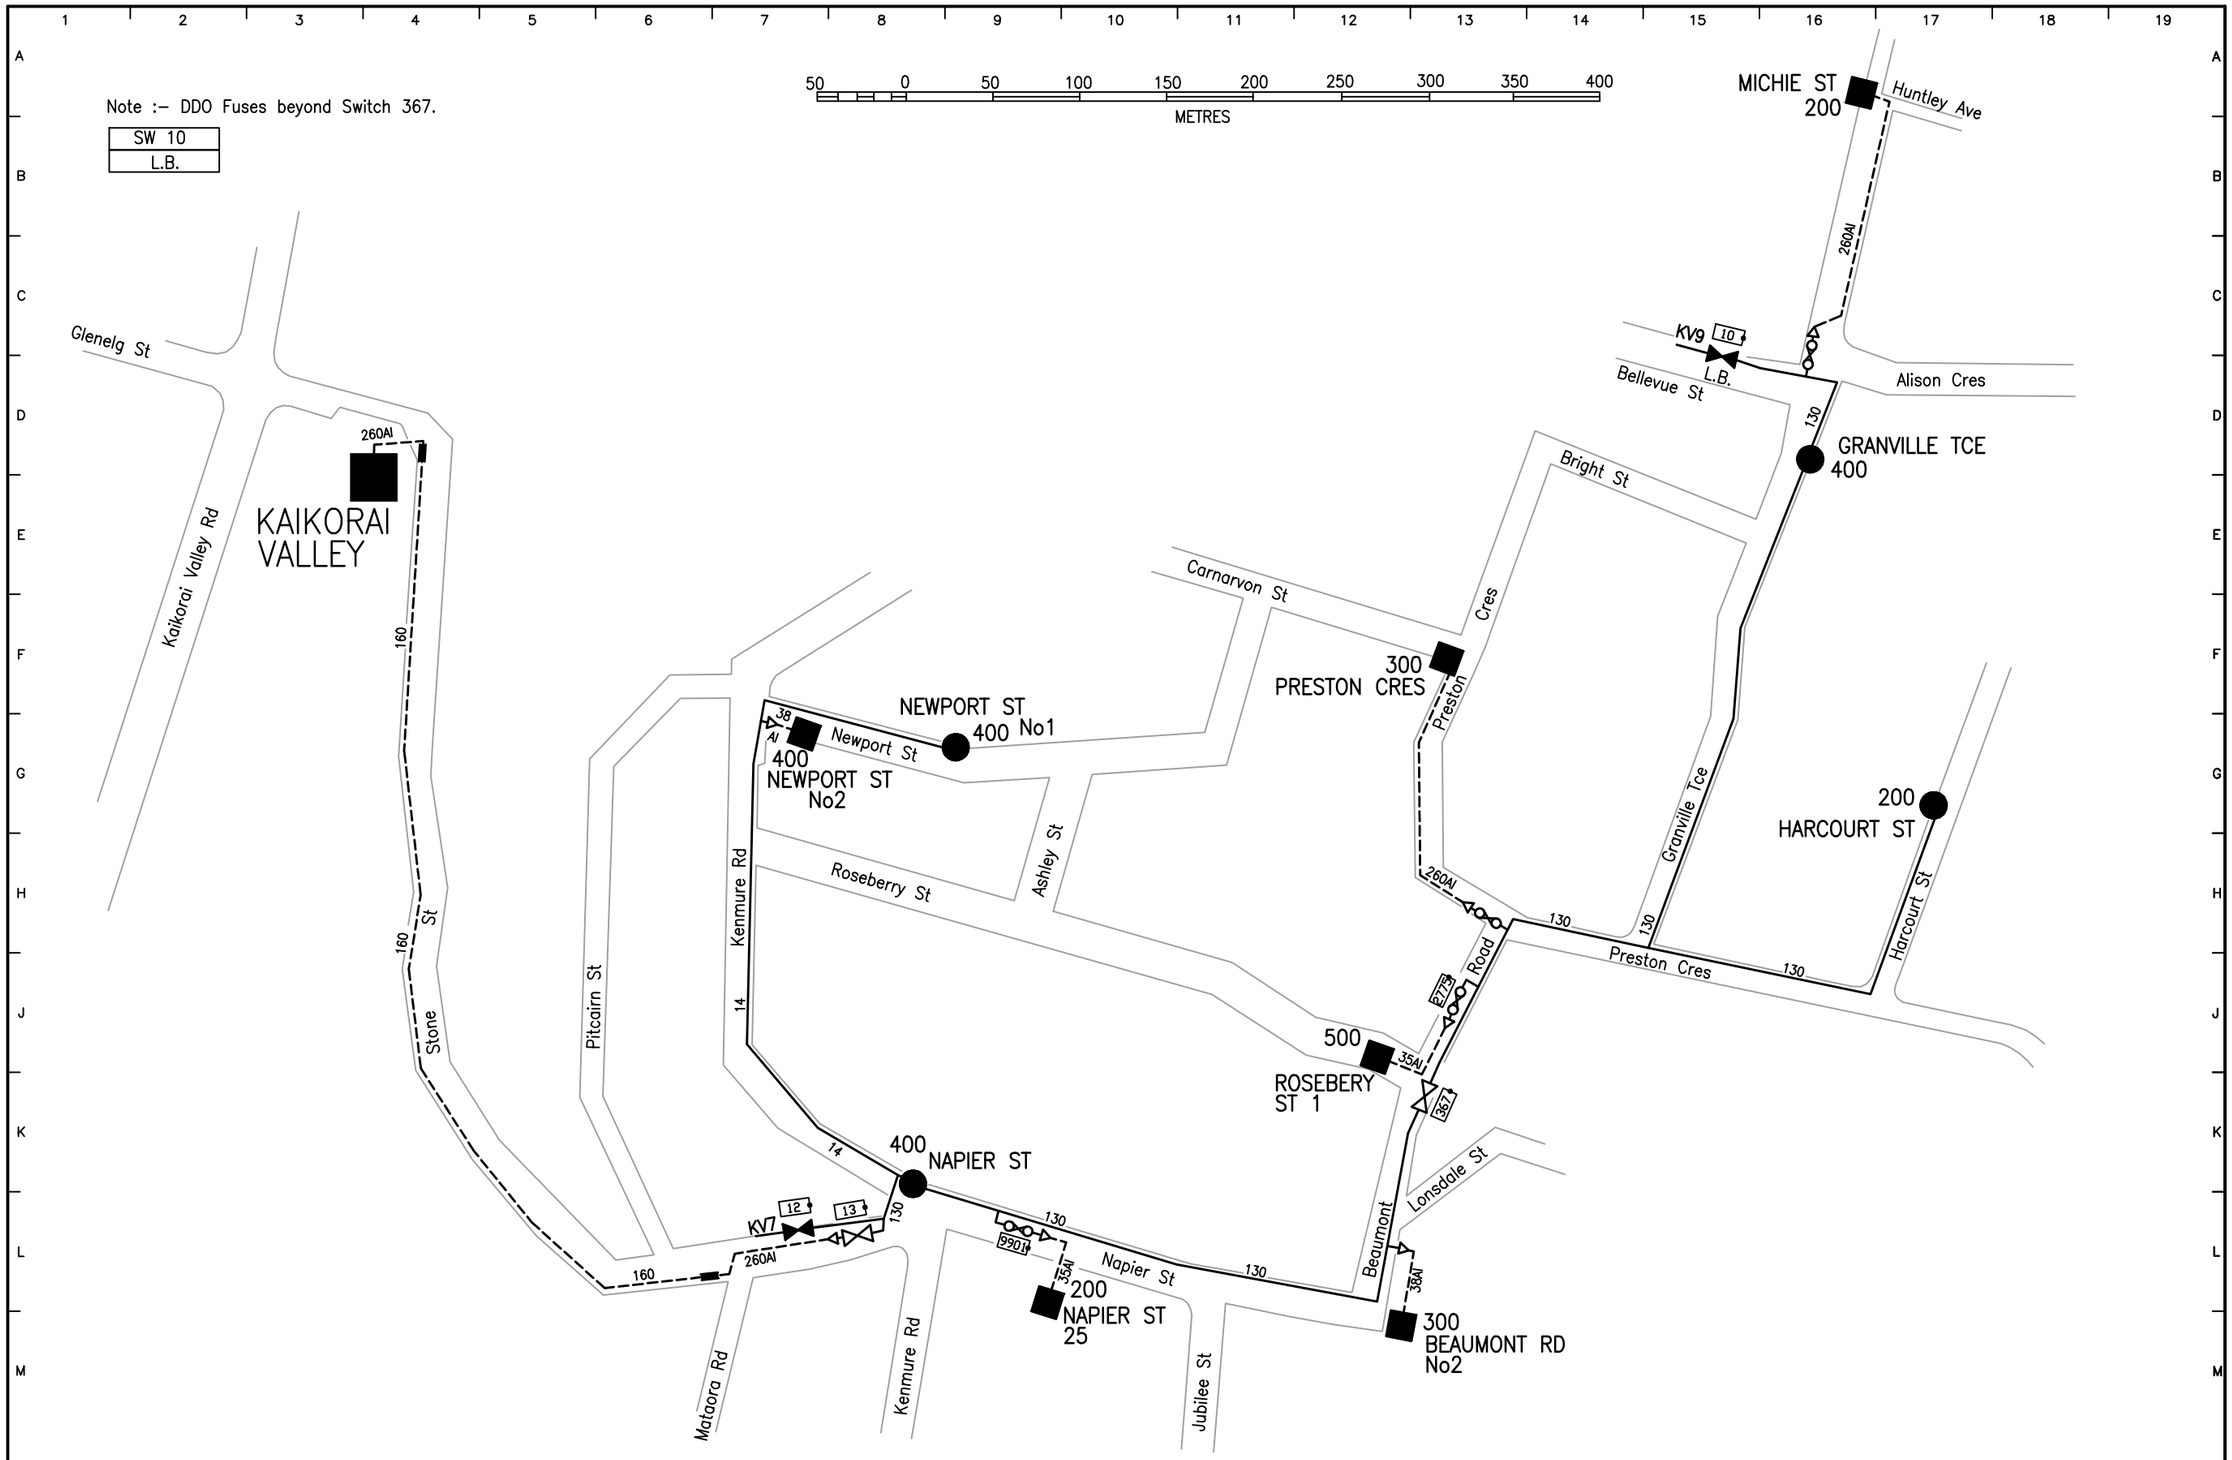

REVISION	A	B	C	D	E	F						DRAWN	D S P	–
COMP. NO	5400	–	–	–	–	CFR 12792						TRACED	C A S	01/07
DATE	05/88	–	09/20	09/21	11/21	01/24						CHECKED		
CHECKED	–	–	CS	NH	MB	NH						DES.ENG		

Aurora

KAIKORAI VALLEY No2 6.6kV FEEDER

DATE ISSUED
25/01/24

PAGE
KV 2