


Note :- DDO on all subs

Access to Moore, Wenta & Chandler transformers from the Mt Allen Rd.

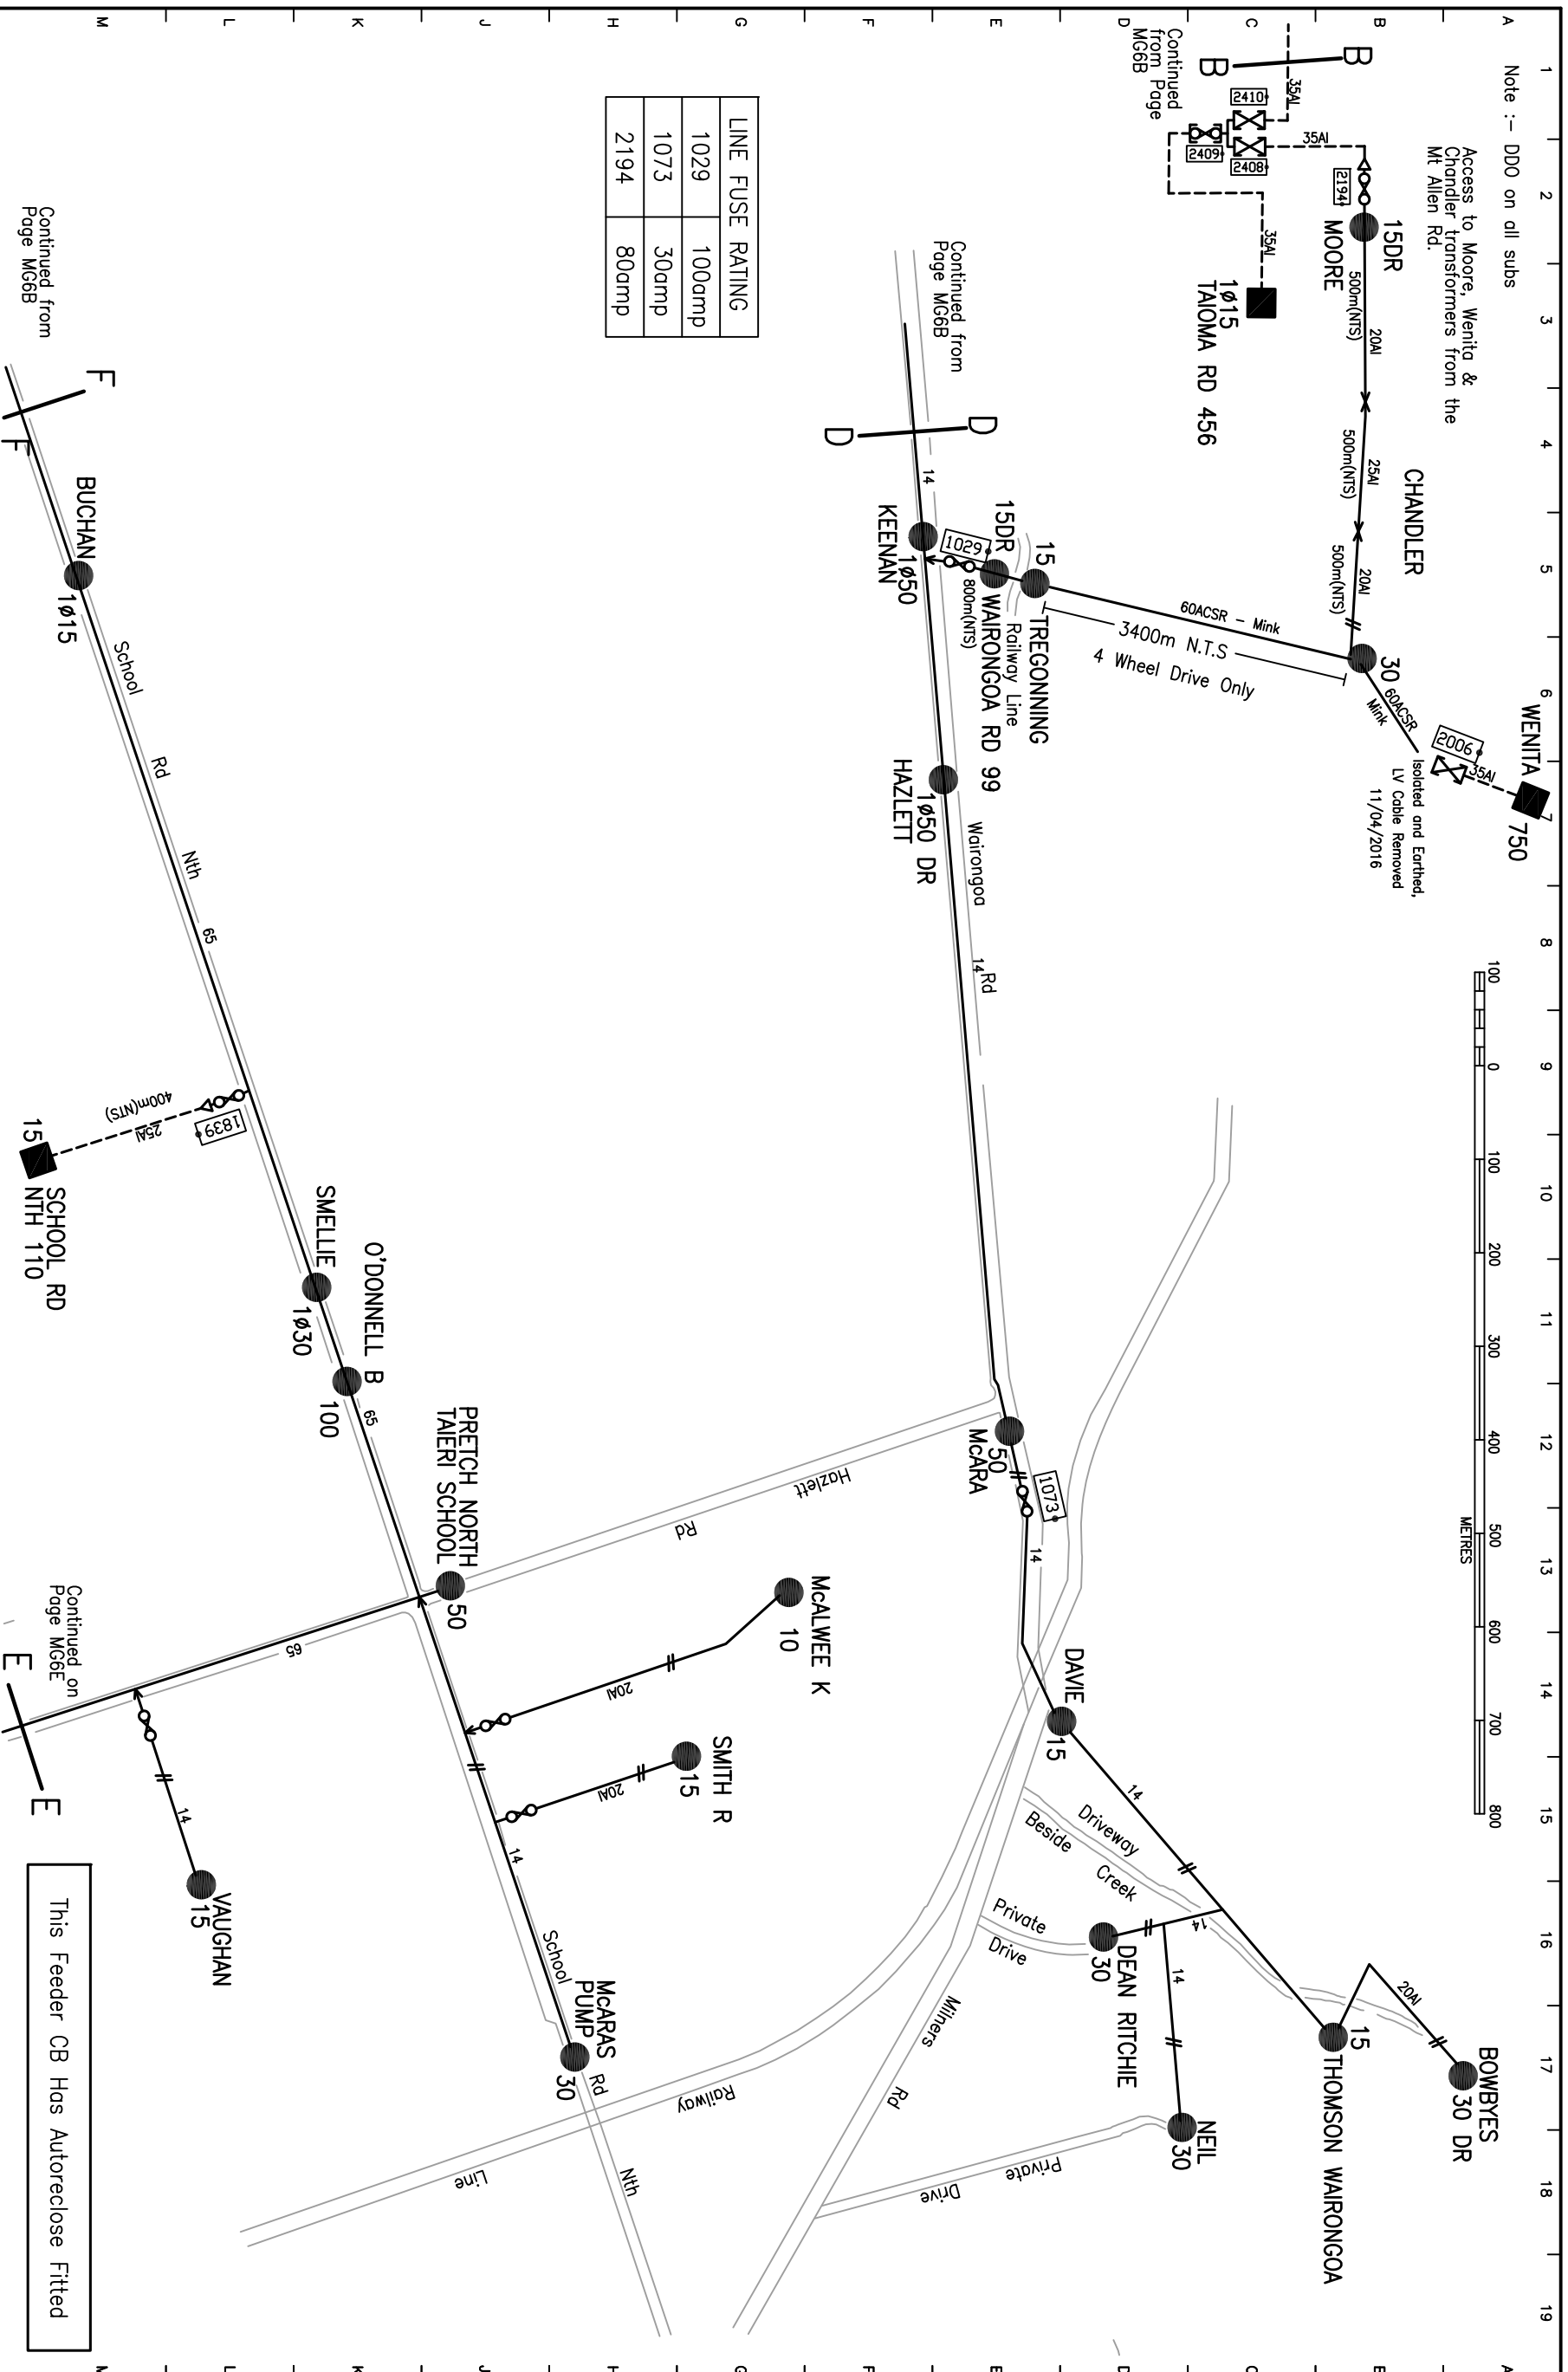

LINE FUSE RATING	
1029	100amp
1073	30amp
2194	80amp

REVISION	X	Y	Z	AA	AB	AC	AD	U	V	W	DRAWN	R L J	08/78
COMP. NO	-	-	-	CFR	-	-	-	CFR	CFR	-	TRACED	T J A	04/06
DATE	11/09	07/12	08/15	02/16	04/16	08/17	07/20	09/06	01/09	02/09	CHECKED		
CHECKED	SJM	SJM	JDP	JDP	JDP	CS		SJM	SJM	SJM	DES.ENG		



MOSGIEL No6 11kV FEEDER

DATE ISSUED
14/07/20

This Feeder CB Has Autoreclose Fitted