Note :– Any tie switch shown thus 1574 & 2089 must be used for parralleling only as indicated in Operating Instructions QP1601/32

Note: All sub names prefixed with UNIVERSITY

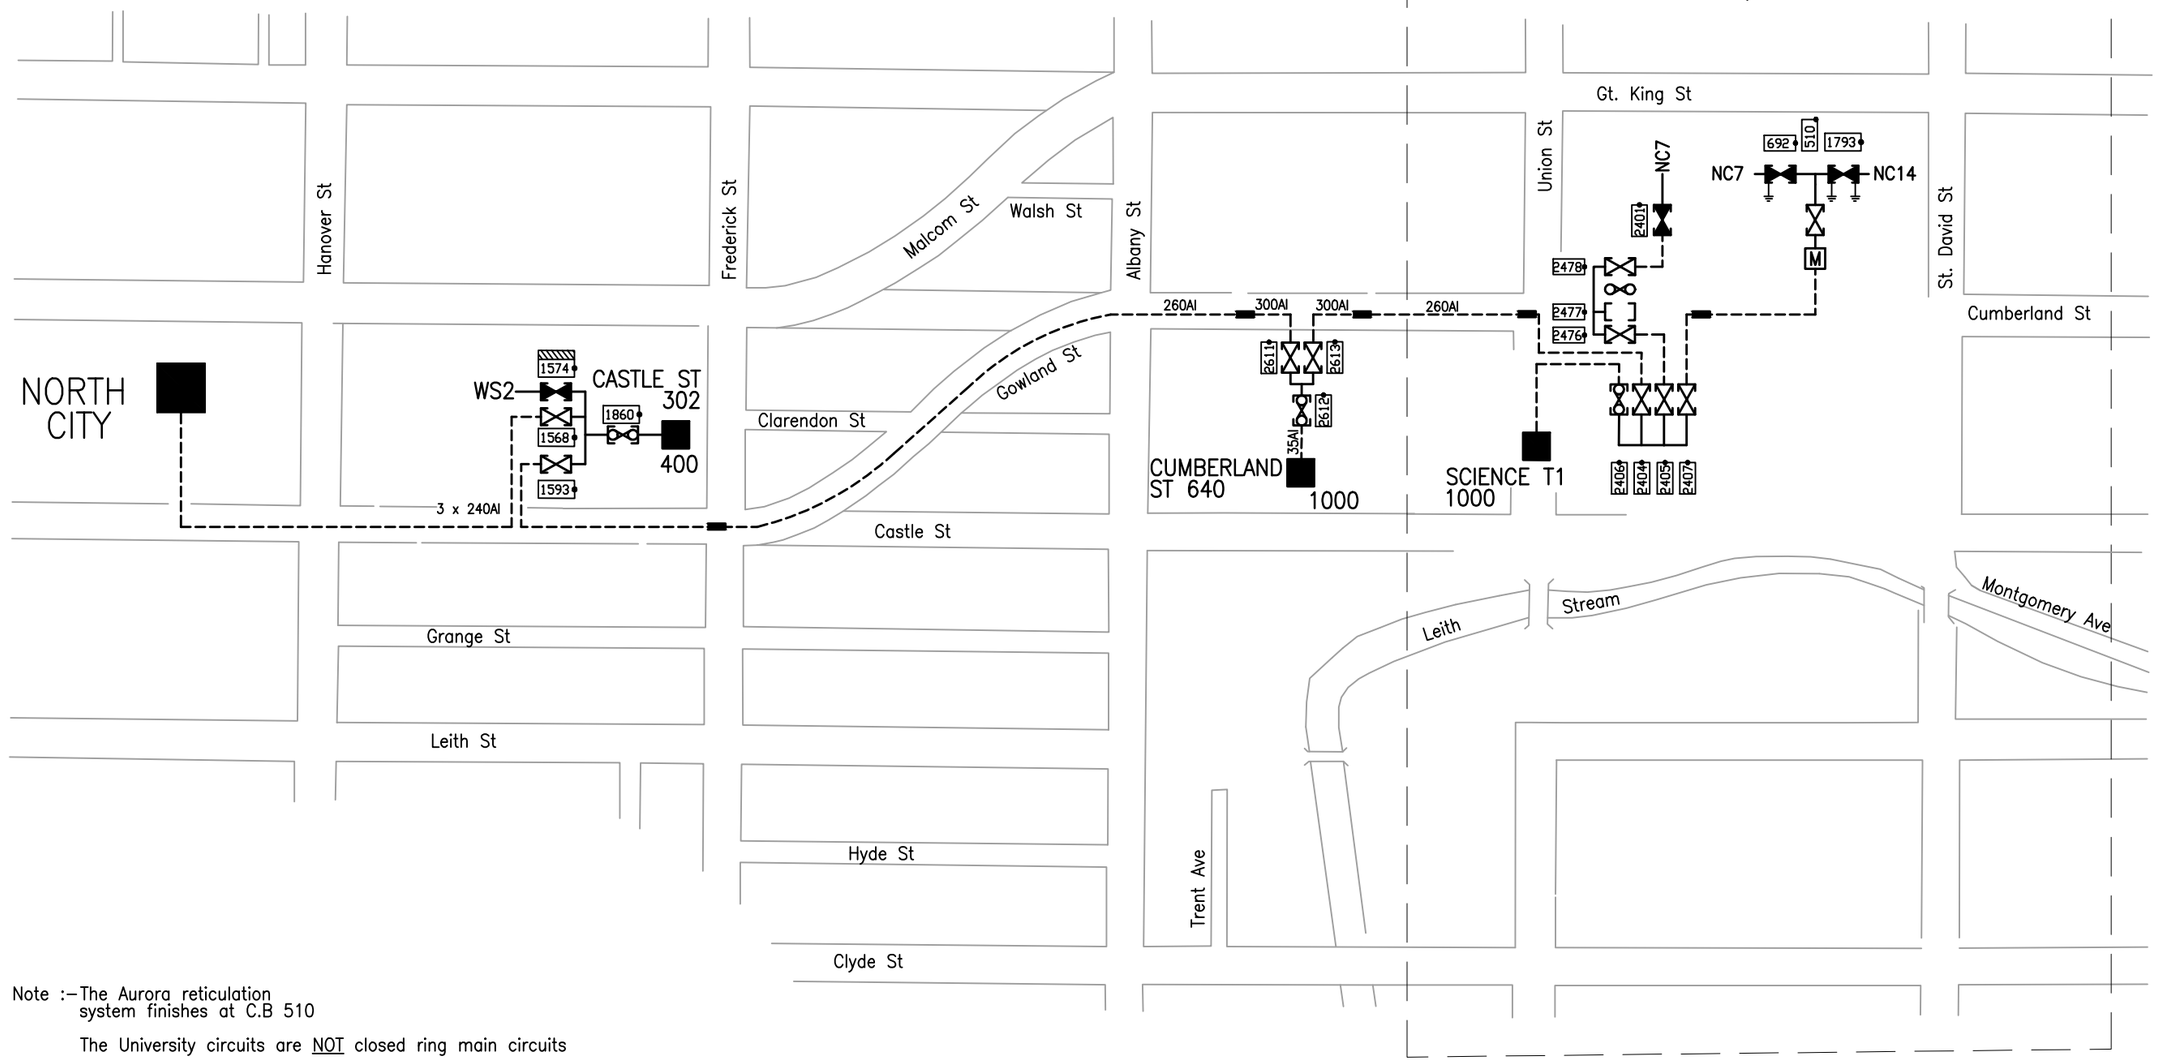

Note :–The Aurora reticulation system finishes at C.B 510

The University circuits are NOT closed ring main circuits

50 0 50 100 150 200 250 300 350 400
METRES

REVISION	Redrawn	A										DRAWN	E C	02/77	
COMP. NO	–	–										TRACED	C A S	02/07	
DATE	09/17	12/21										CHECKED			
CHECKED	JDP	NH										DES.ENG			

Aurora

NORTH CITY No 11 6.6kV FEEDER

DATE ISSUED 14/12/21

PAGE NC 11