




Note :- Any tie switch shown thus  &  must be used for parralleling only as indicated in Operating Instructions QP1601/32

Note: All sub names prefixed with UNIVERSITY



Note :-The Aurora reticulation system finishes at C.B 512
The University circuits are NOT closed ring main circuits

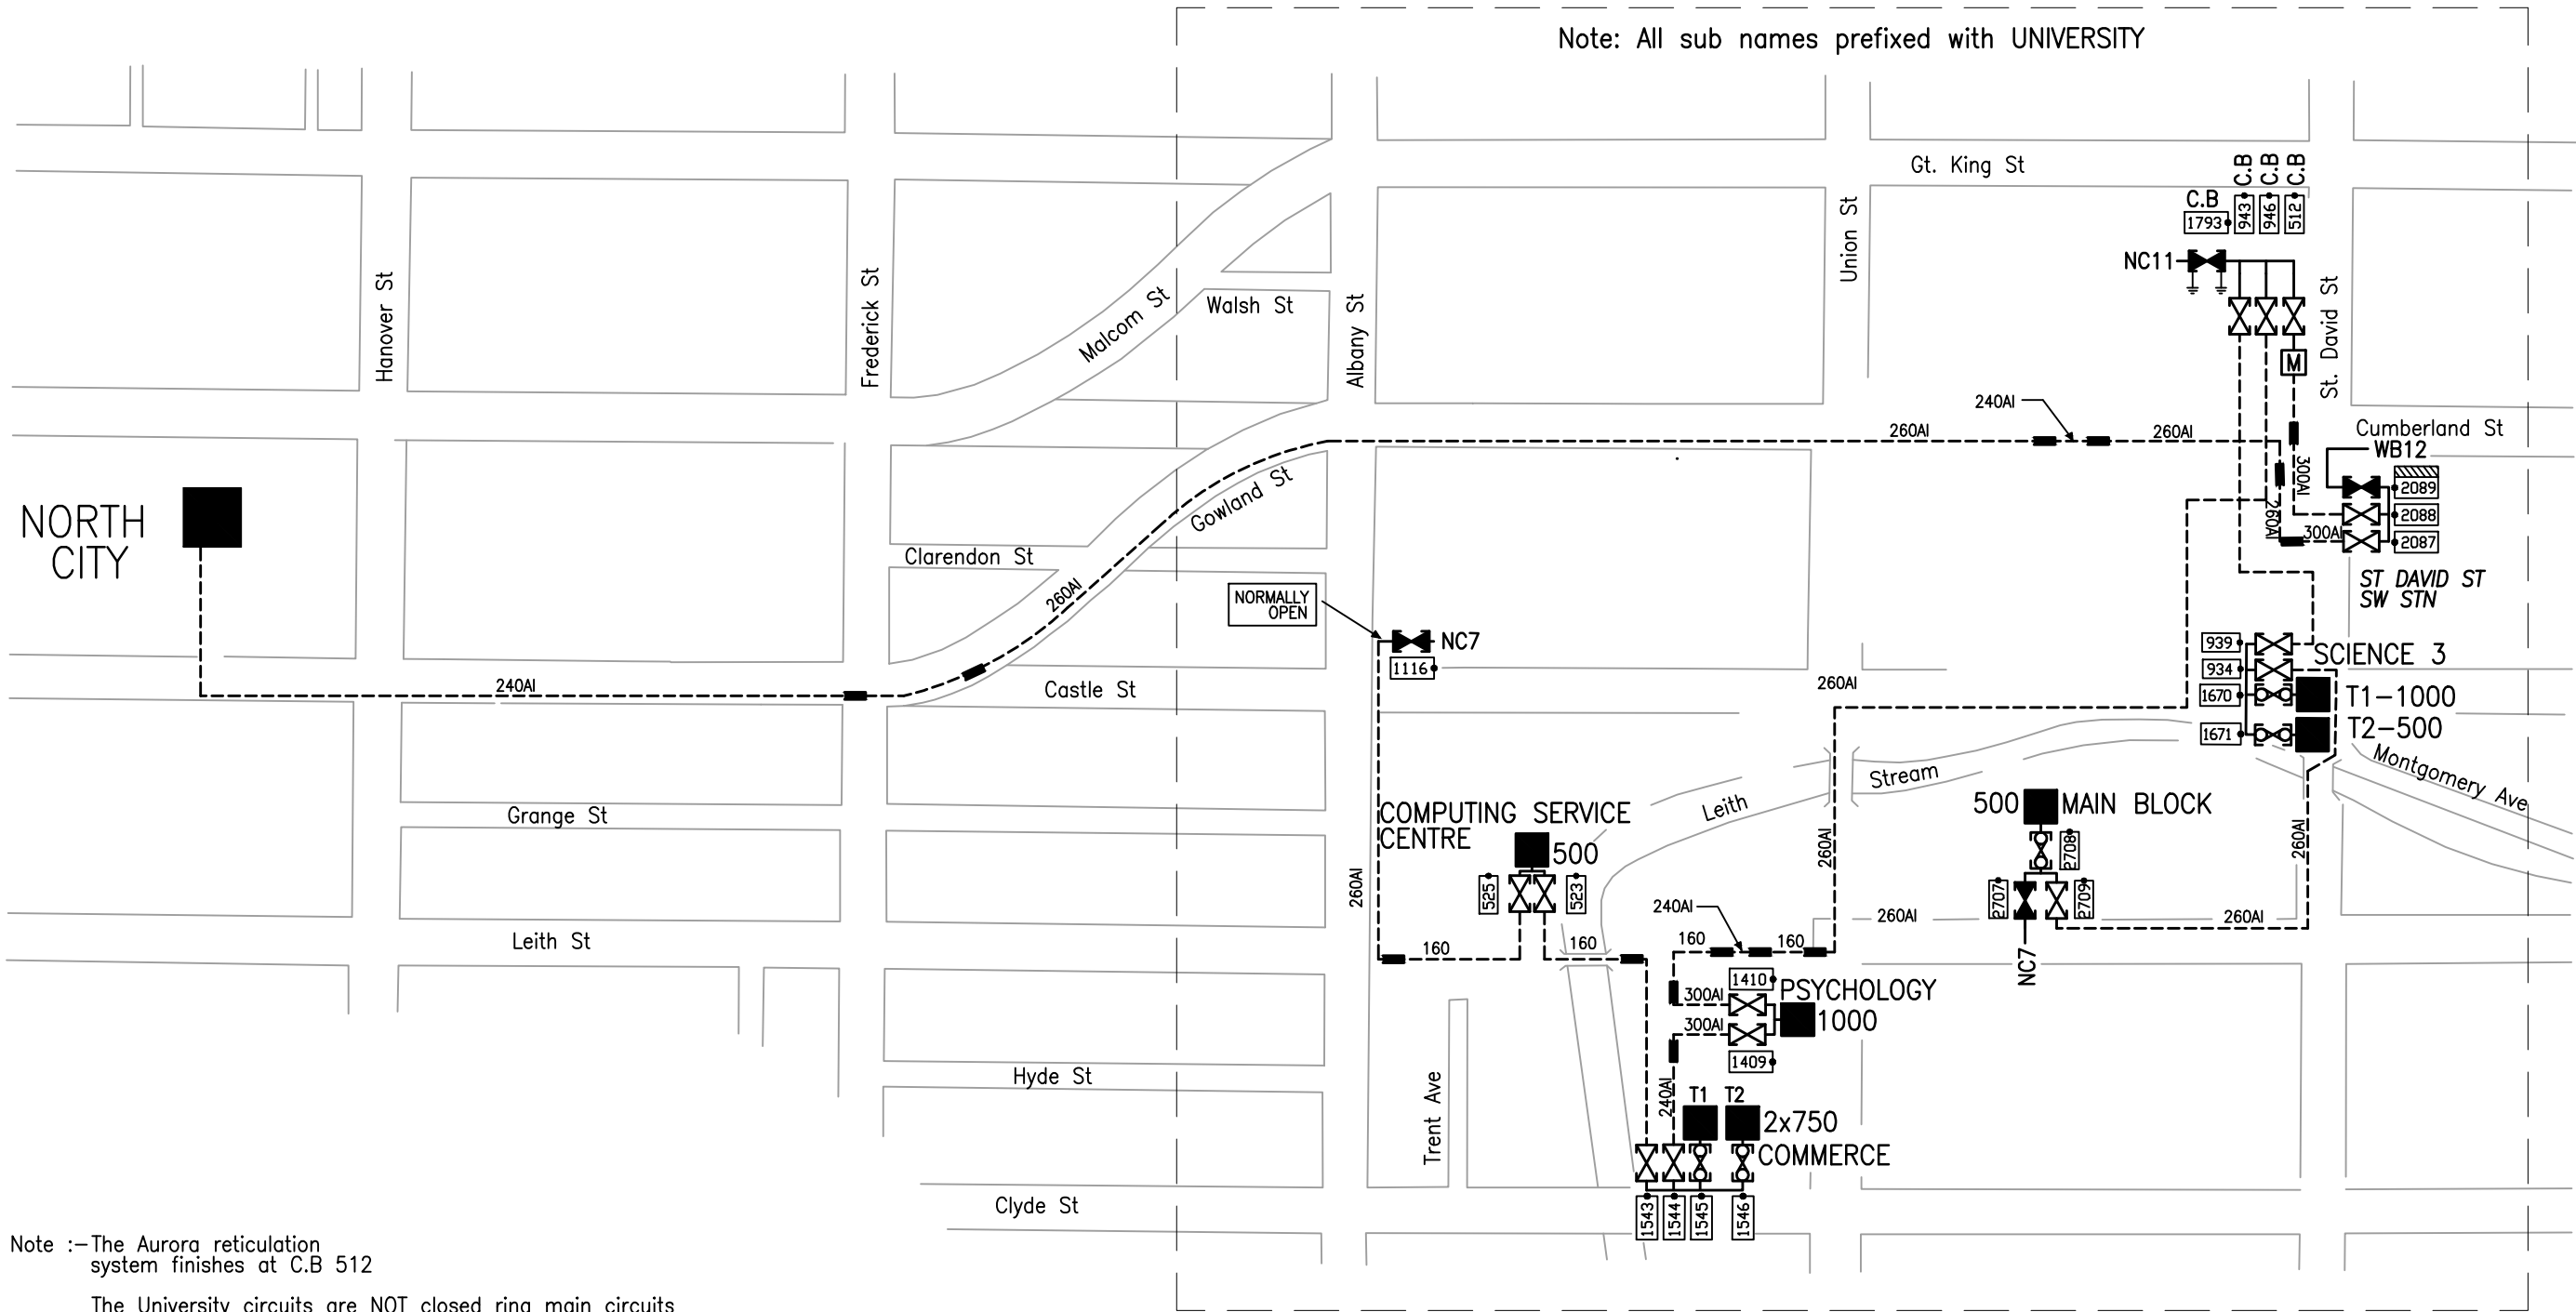

REVISION	Redrawn	A	B							DRAWN	E C	02/77
COMP. NO	-	-	CFR12290							TRACED	C A S	02/07
DATE	09/17	12/19	11/22							CHECKED		
CHECKED	JDP	CS	DCH							DES.ENG		



NORTH CITY No 14 6.6kV FEEDER

DATE ISSUED
25/11/22

PAGE
**NC
14**