Note :– Any tie switch shown thus 2679 must be used for paralleling only as indicated in Operating Instructions QP1601/32

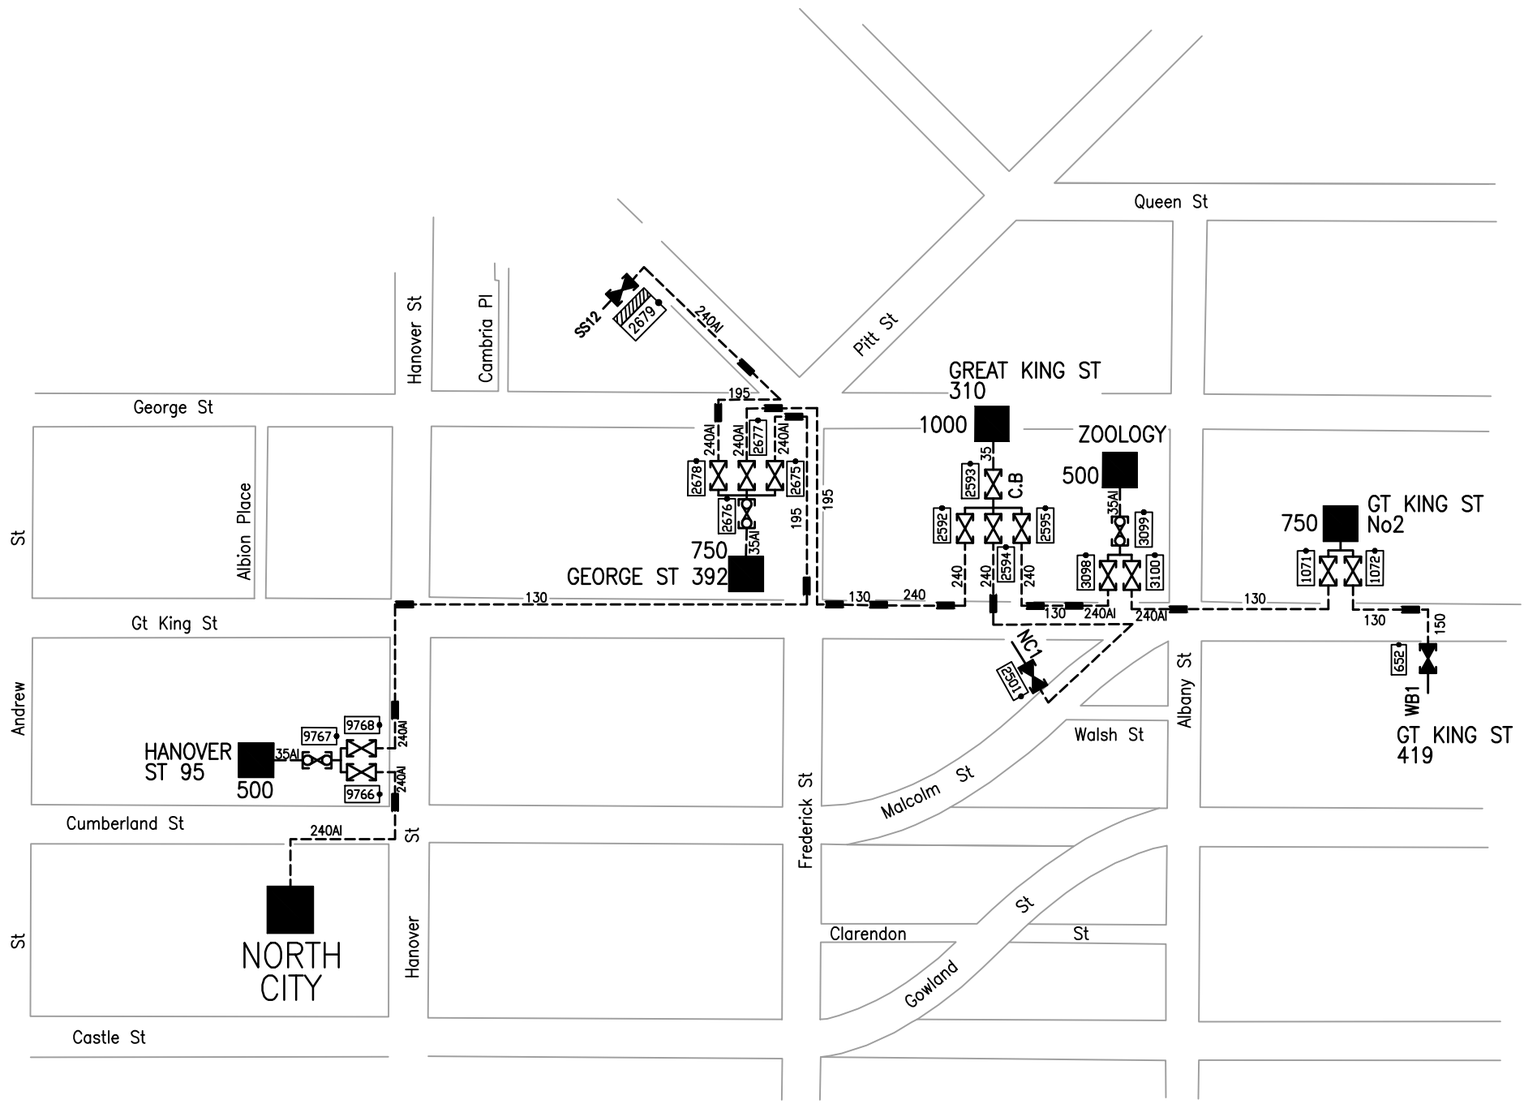

REVISION	O	P	Q	R	S	T	U	V	W		N	DRAWN E C	03/77
COMP. NO	–	–	–	–	–	SS OFFLOAD	SS OFFLOAD	CFR12633	SS RETURN		–	TRACED C A S	02/07
DATE	09/18	07/19	08/19	03/21	09/21	07/24	08/24	11/24	07/25		06/07	CHECKED	
CHECKED	JDP	CS	CS	CBP	MB	AC	AC	DCH	DCH			DES.ENG	

Aurora

NORTH CITY No5 6.6kV FEEDER

DATE ISSUED
24/07/25

PAGE
NC 5