Note :– DDO on all subs

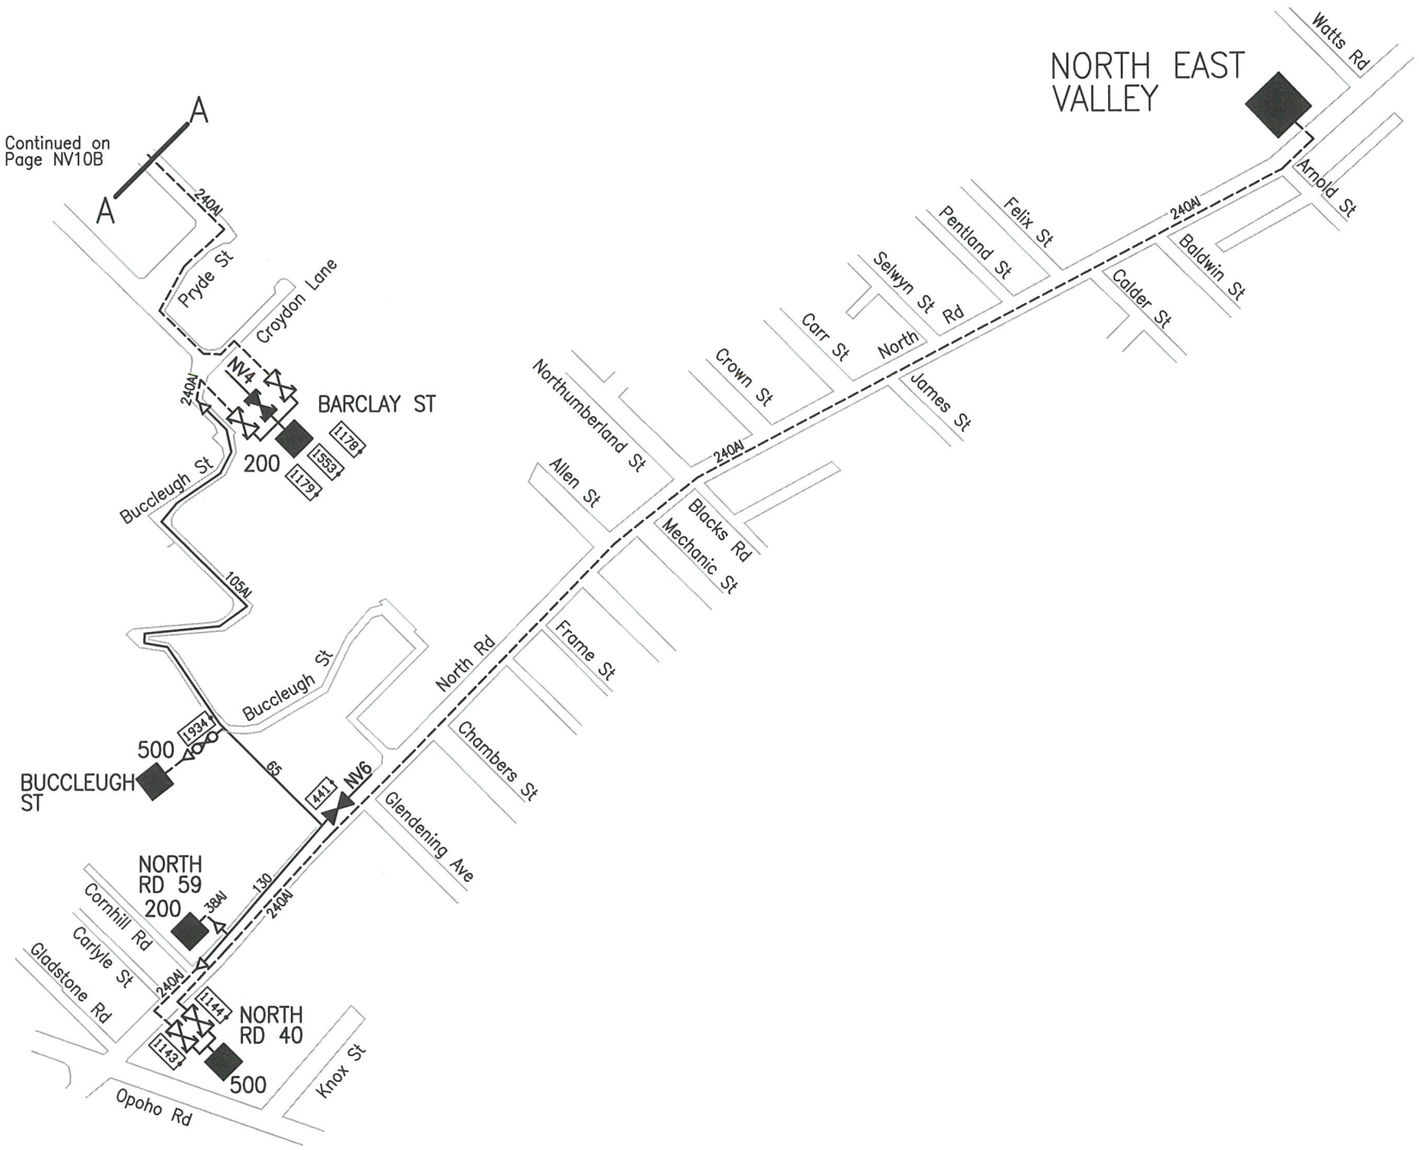

REVISION	A											DRAWN	I G P	–		
COMP. NO	CFR 3993											TRACED	C A S	02/07		
DATE	03/08											CHECKED				
CHECKED												DES.ENG				

Aurora

NORTH EAST VALLEY No10 6.6kV FEEDER

DATE ISSUED

PAGE NV 10A