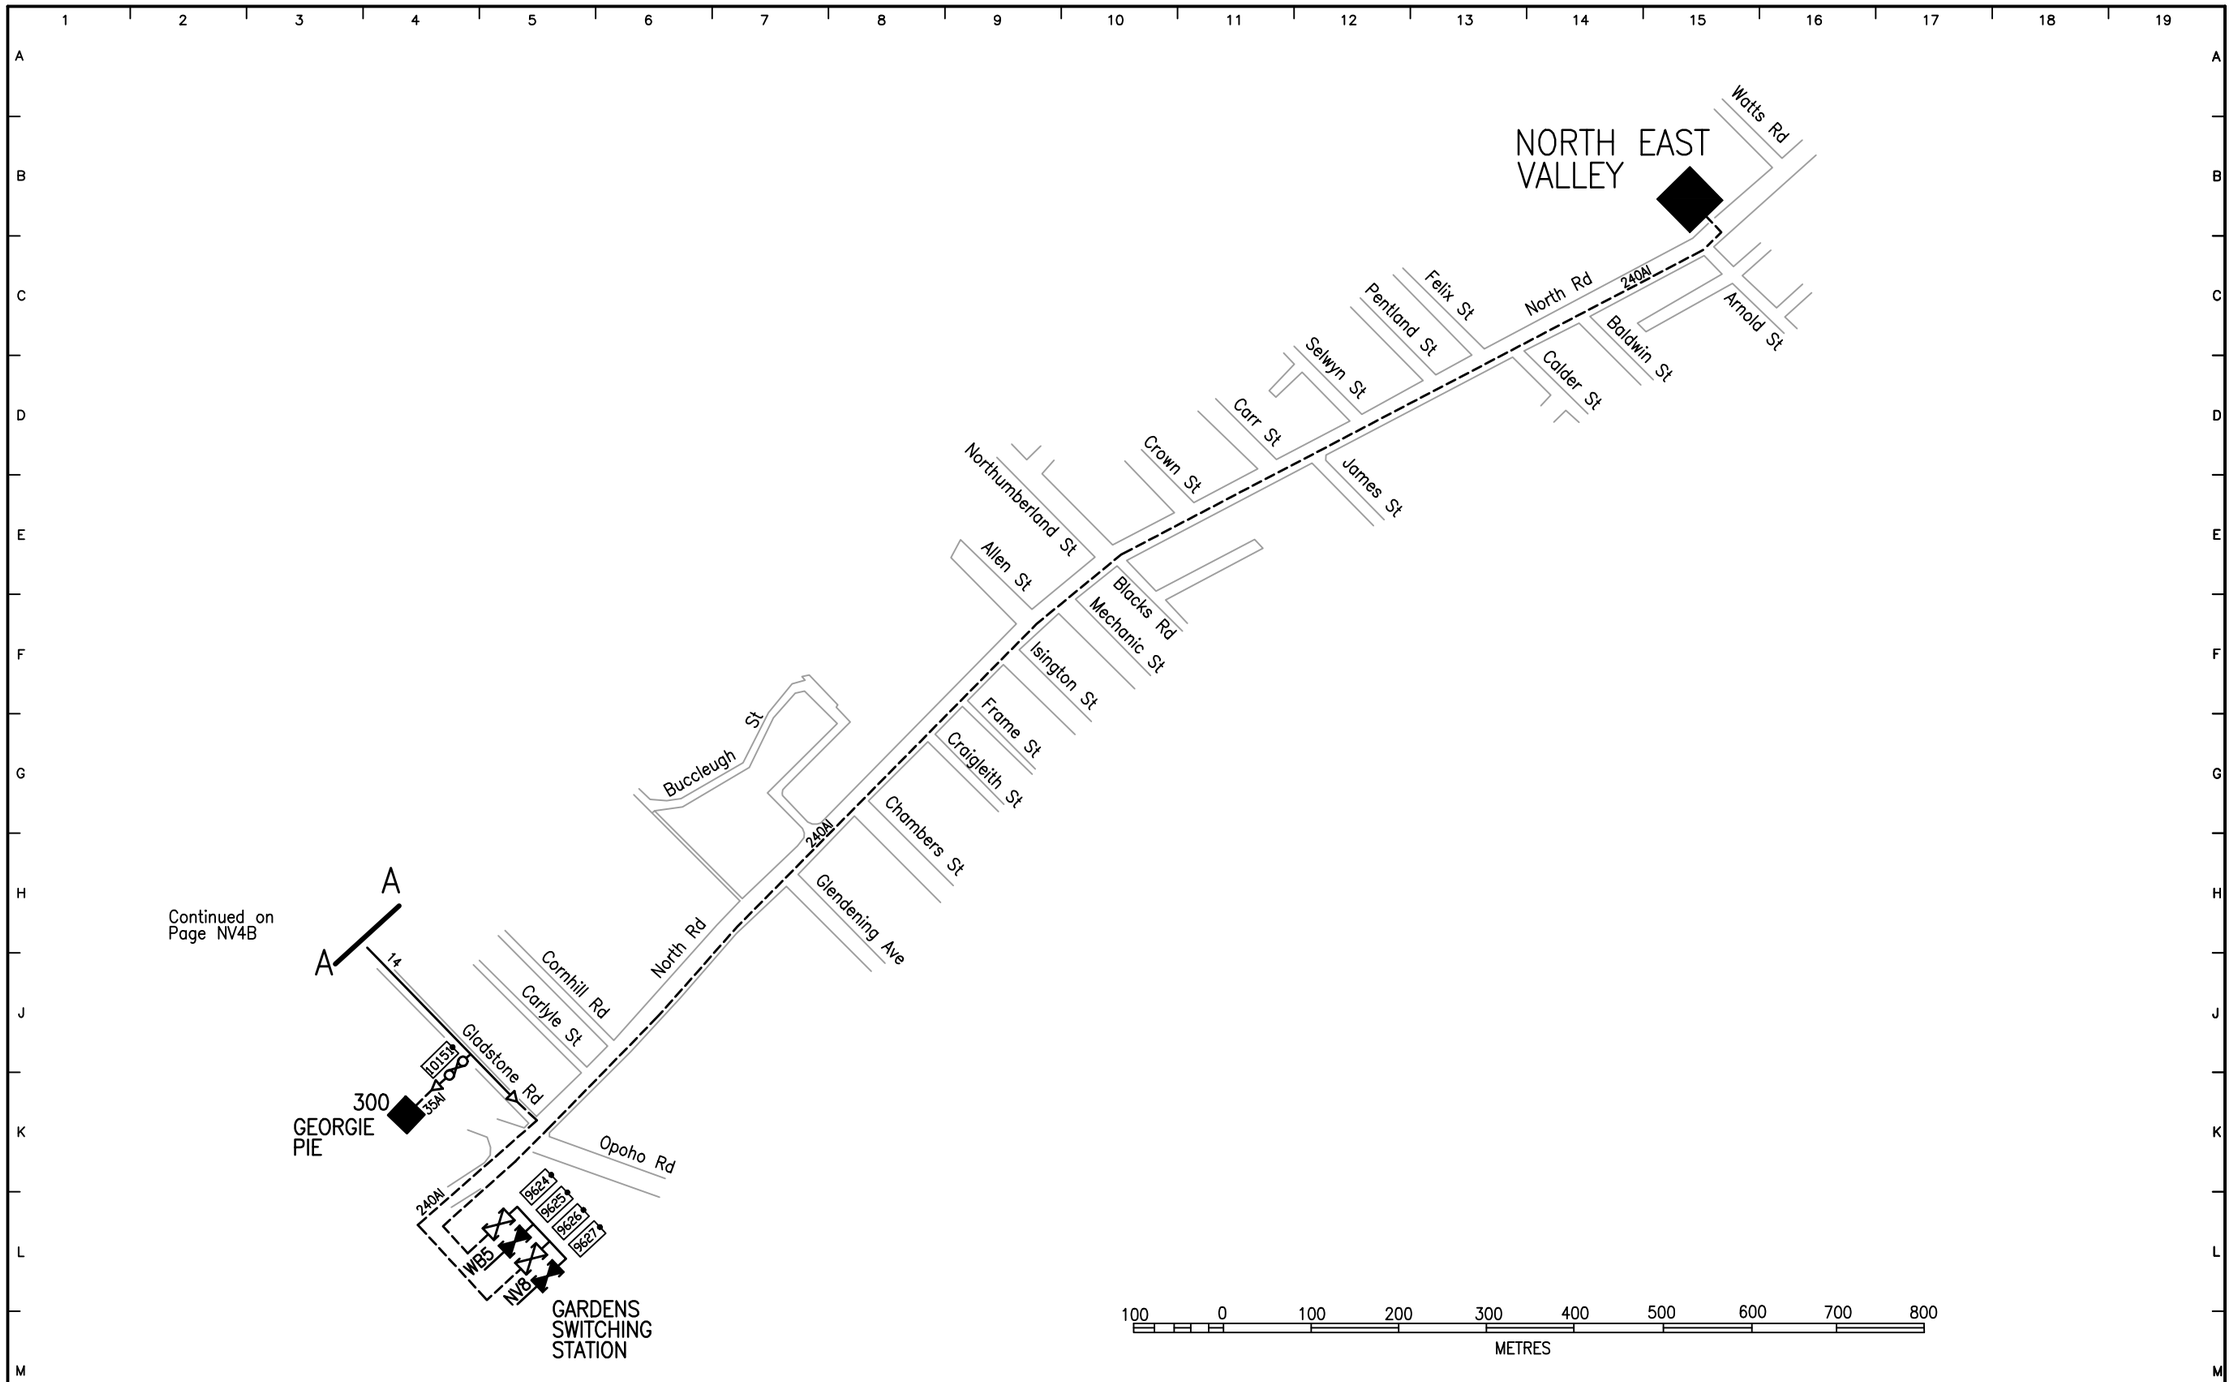

REVISION	A	B	C	D								DRAWN I G P	–
COMP. NO	206	–	CFR 11913	–								TRACED C A S	02/07
DATE	05/94	04/11	05/23	09/25								CHECKED	
CHECKED	DLP		NH	DCH								DES.ENG	

Aurora

NORTH EAST VALLEY No4 6.6kV FEEDER

DATE ISSUED
11/09/25

PAGE
NV 4A