


Note :- DDO on all subs



| | | | | | | | | | | | | | | |
|----------|-------|-------|----------|-------|-------|----------|-------|-----------|-------|--|--|---------|-------|-------|
| REVISION | A | B | C | D | E | F | G | H | I | | | DRAWN | I G P | 06/92 |
| COMP. NO | - | - | CFR 2955 | - | - | CFR 6687 | - | CFR 12461 | - | | | TRACED | T J A | 10/06 |
| DATE | 12/92 | 08/97 | 10/06 | 11/06 | 10/17 | 05/21 | 10/21 | 09/23 | 03/26 | | | CHECKED | | |
| CHECKED | DLP | DLP | SJM | SJM | CFCJ | CBP | NH | MB | DCH | | | DES.ENG | | |

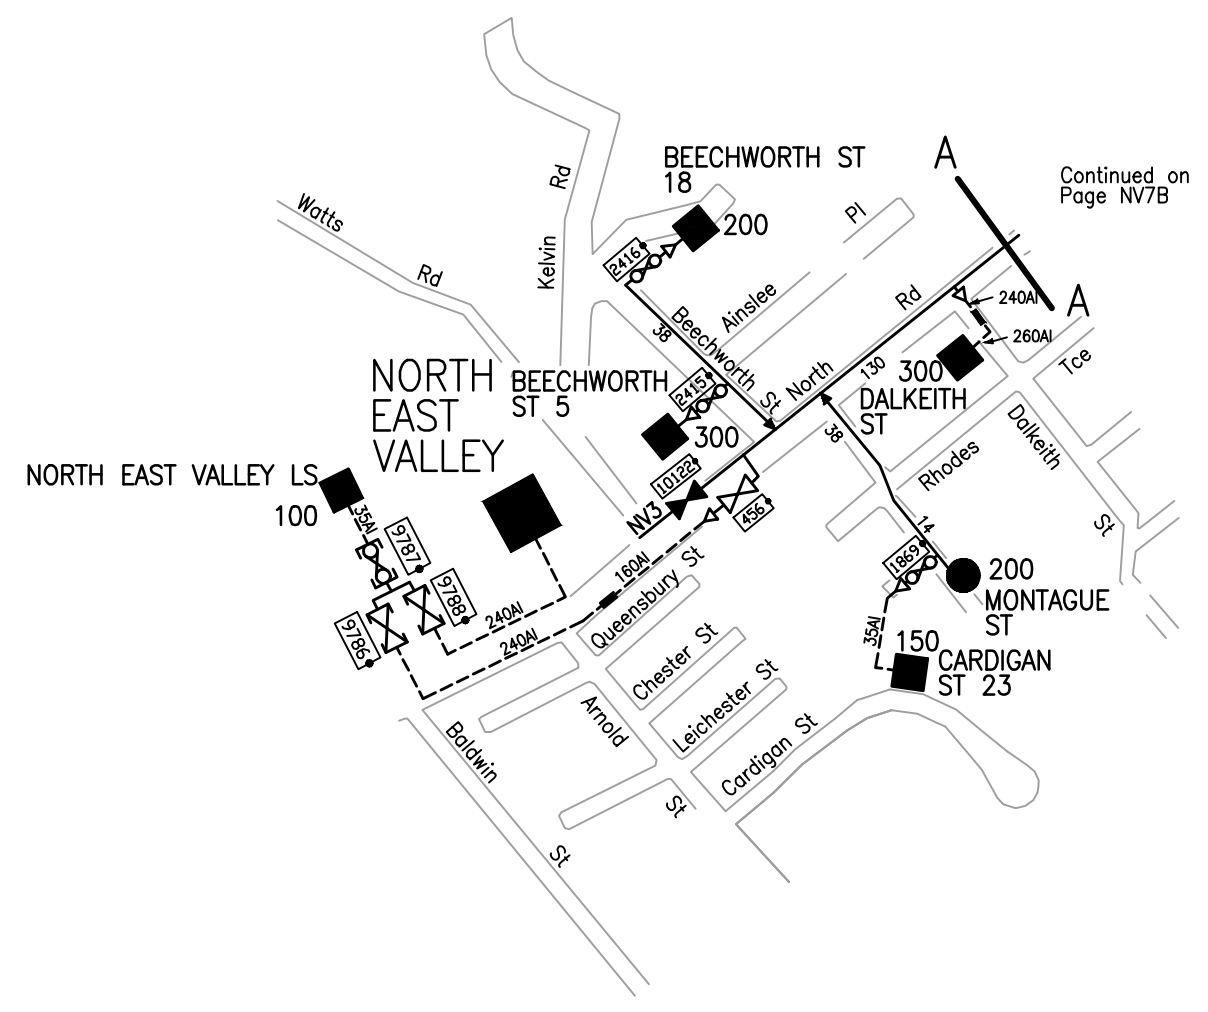

NORTH EAST VALLEY 7 6.6kV FEEDER

DATE ISSUED
3/03/26

PAGE
**NV
7A**