


Note :- Any tie switch shown thus [hatched box] must be used for paralleling only as indicated in QP1601/32

Note :- DDO on all subs

SW 464
L.B.

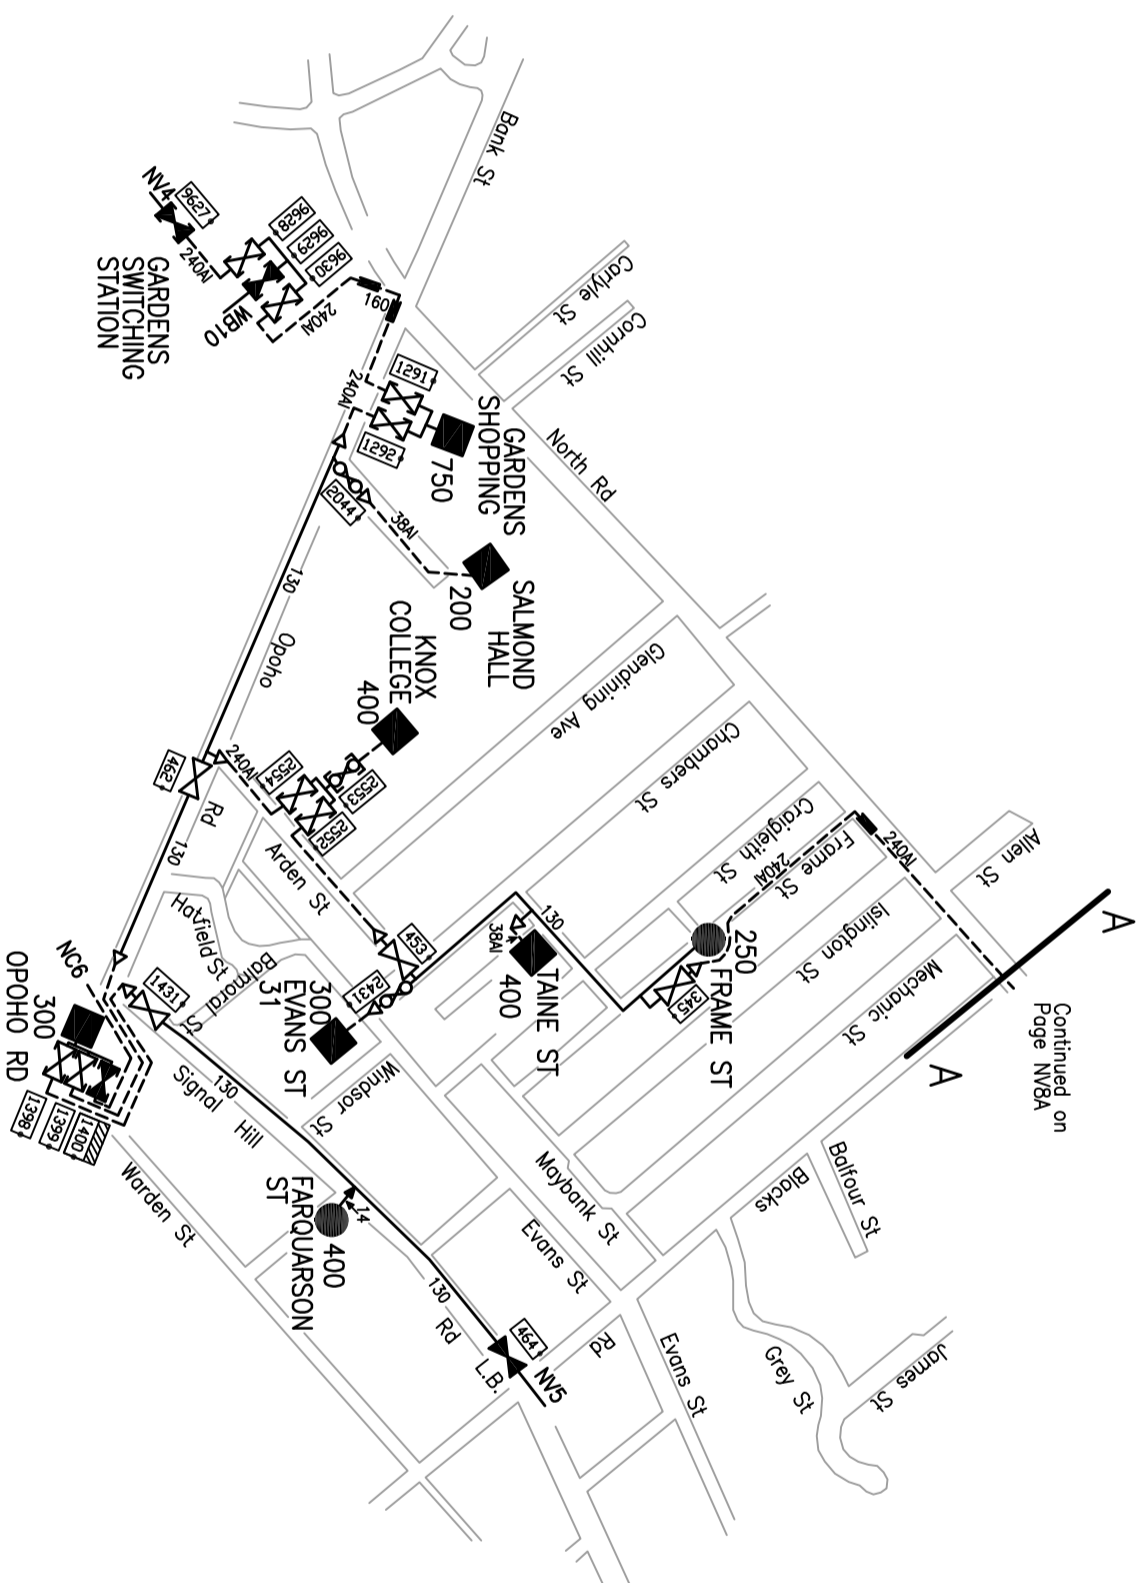

REVISION	A	B	C	D	E	F	G	H	I											
COMP. NO	585	-	CFR 5517	-	-	-	-	CFR 11913	-											
DATE	09/95	-	01/11	01/11	08/17	05/21	05/23	05/23	10/24											
CHECKED	DLP	-	DLP		JDP	CBP	MB	NH	MB											



NORTH EAST VALLEY No8 6.6KV FEEDER

DATE ISSUED
11/10/24

PAGE
NV 8B