Note :– DDO on all subs

UTL :– UTL Dialer

To Provide Discrimination Install Fuses As Below	
905	40 amp
996	15 amp
998	10 amp
999	10 amp

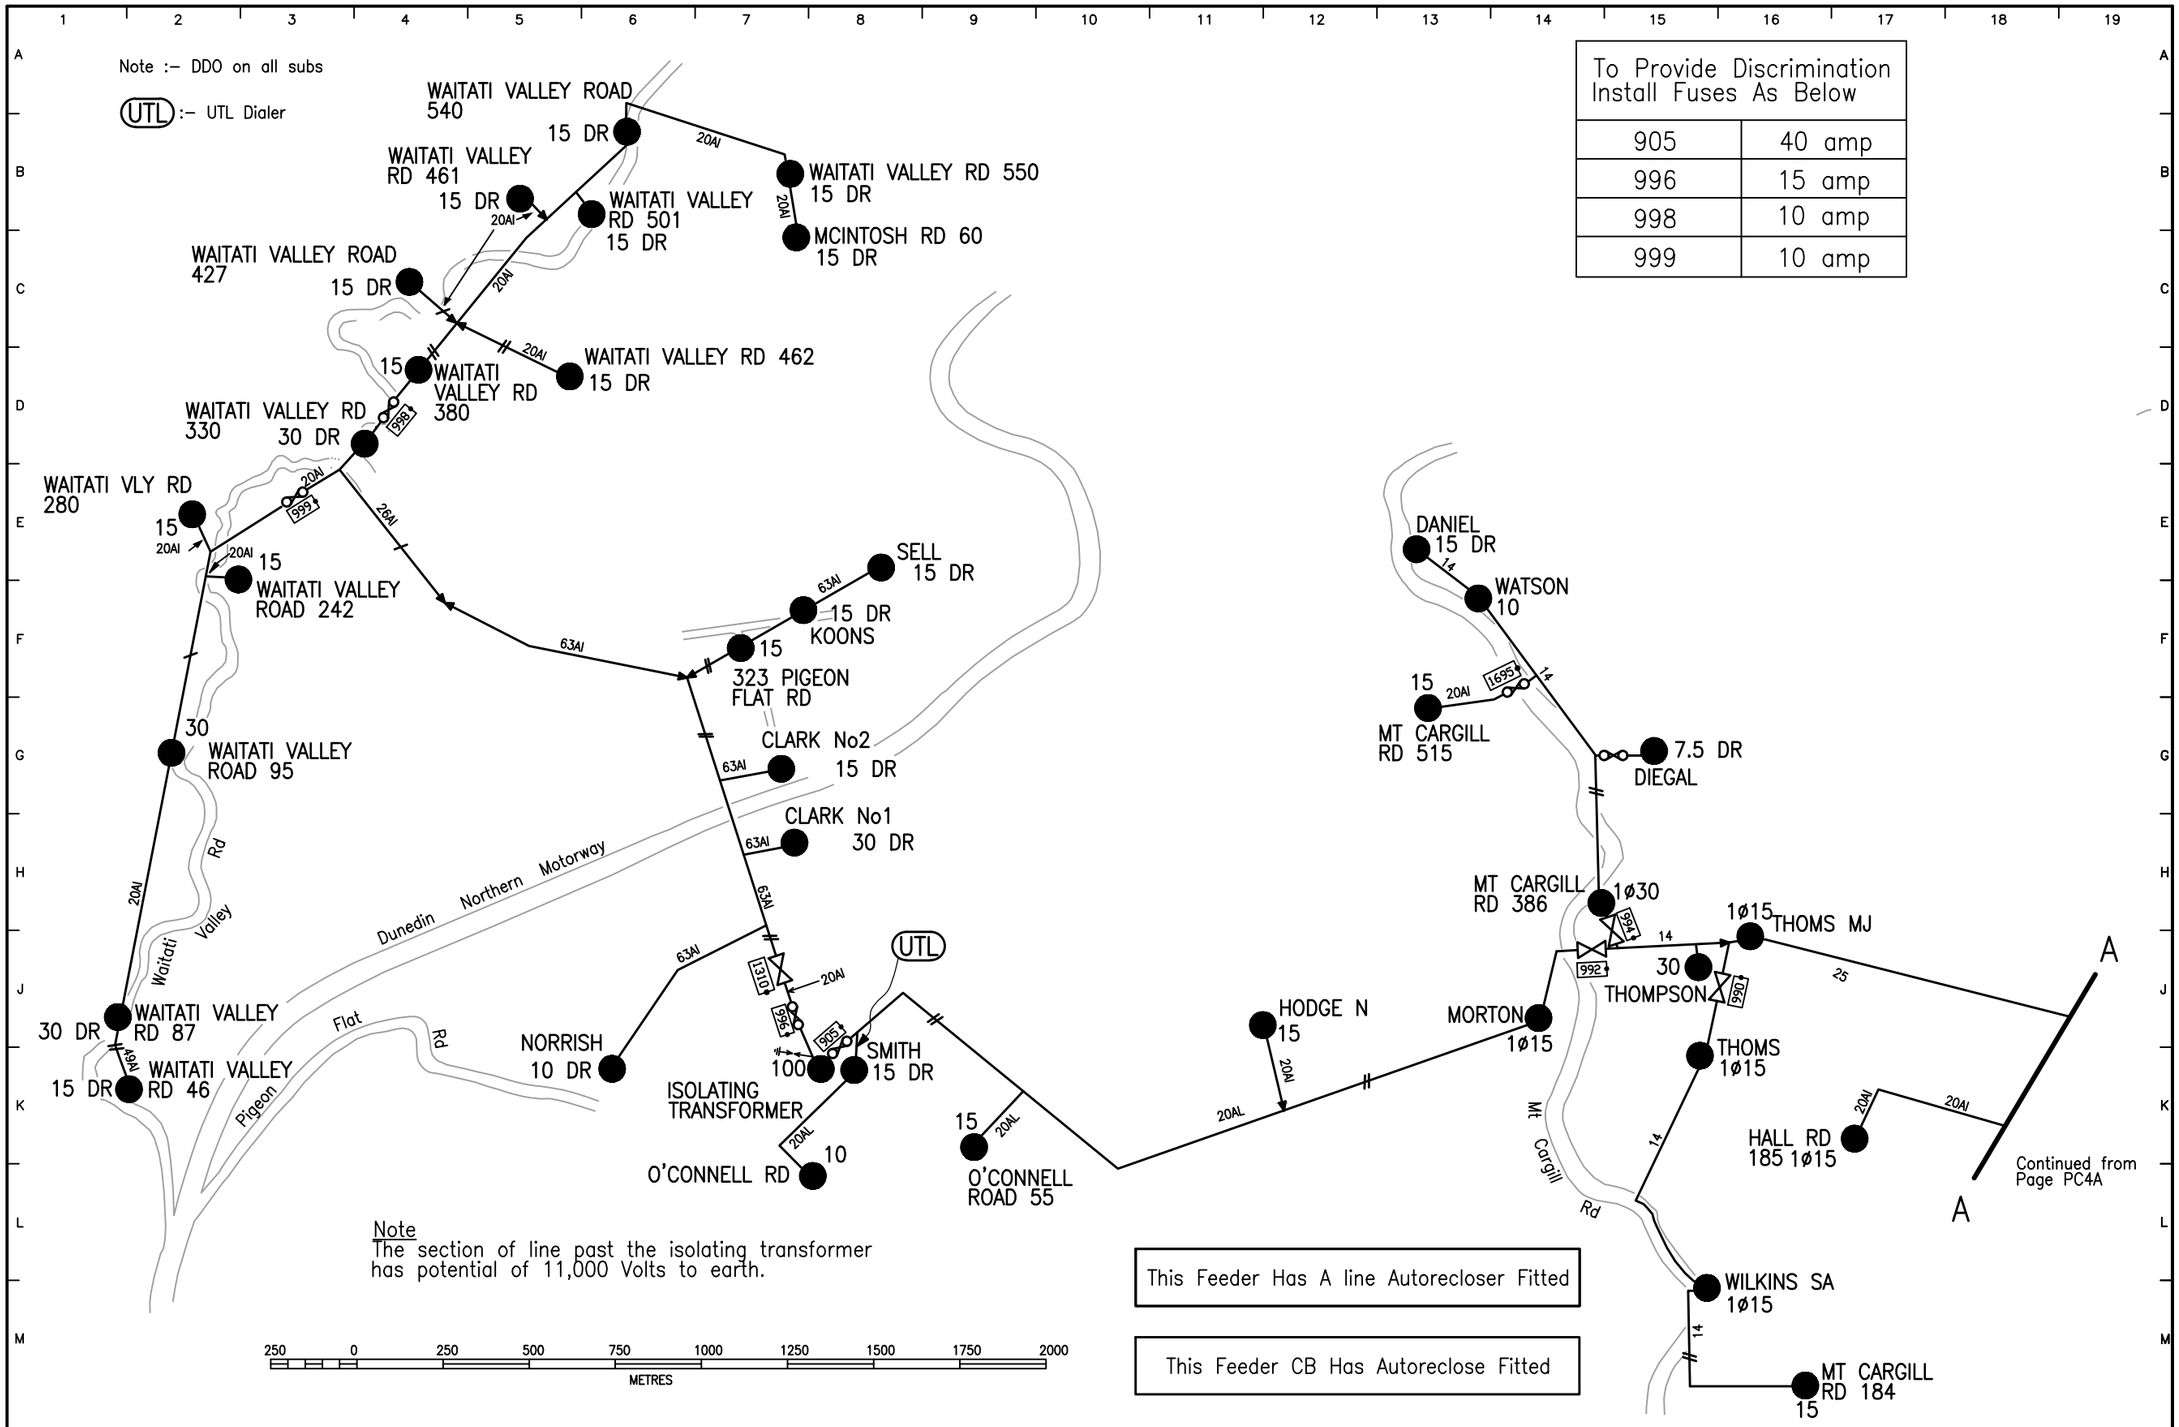

Note
The section of line past the isolating transformer has potential of 11,000 Volts to earth.

This Feeder Has A line Autorecloser Fitted

This Feeder CB Has Autoreclose Fitted

REVISION	AH	AI	AJ	AK	AL	AM	AN		AE	AF	AG	DRAWN I G P	06/80
COMP. NO	CFR 12150	–	CFR 11248	–	CFR 11945	–	–		CFR 7218	–	–	TRACED T J A	05/06
DATE	08/22	01/23	03/23	03/23	09/23	01/26	03/26		07/14	11/20	12/20	CHECKED	
CHECKED	NH	MB	DH/NH	MB	NH	LMW	MB		SJM	CS	CS	DES.ENG	

Aurora

PORT CHALMERS No4 11kV FEEDER

DATE ISSUED
06/03/26

PAGE
PC 4B