


Note :-Any tie switch shown thus  must be used for parralleling only as indicated in Operating Instructions QP1601/32



REVISION	M	N	O		F	G	H	I	J	K	L	DRAWN	G H	10/75
COMP. NO	CFR 11254	SS OFFLOAD	SS RETURN		3659	5382	6095	2642	-	-	-	TRACED	C A S	02/07
DATE	09/22	07/24	07/25		07/82	05/88	10/89	09/03	11/04	05/12	11/14	CHECKED		
CHECKED	MB	AC	MGB		MA	-	-	DLP	DLP		SJM	DES.ENG		

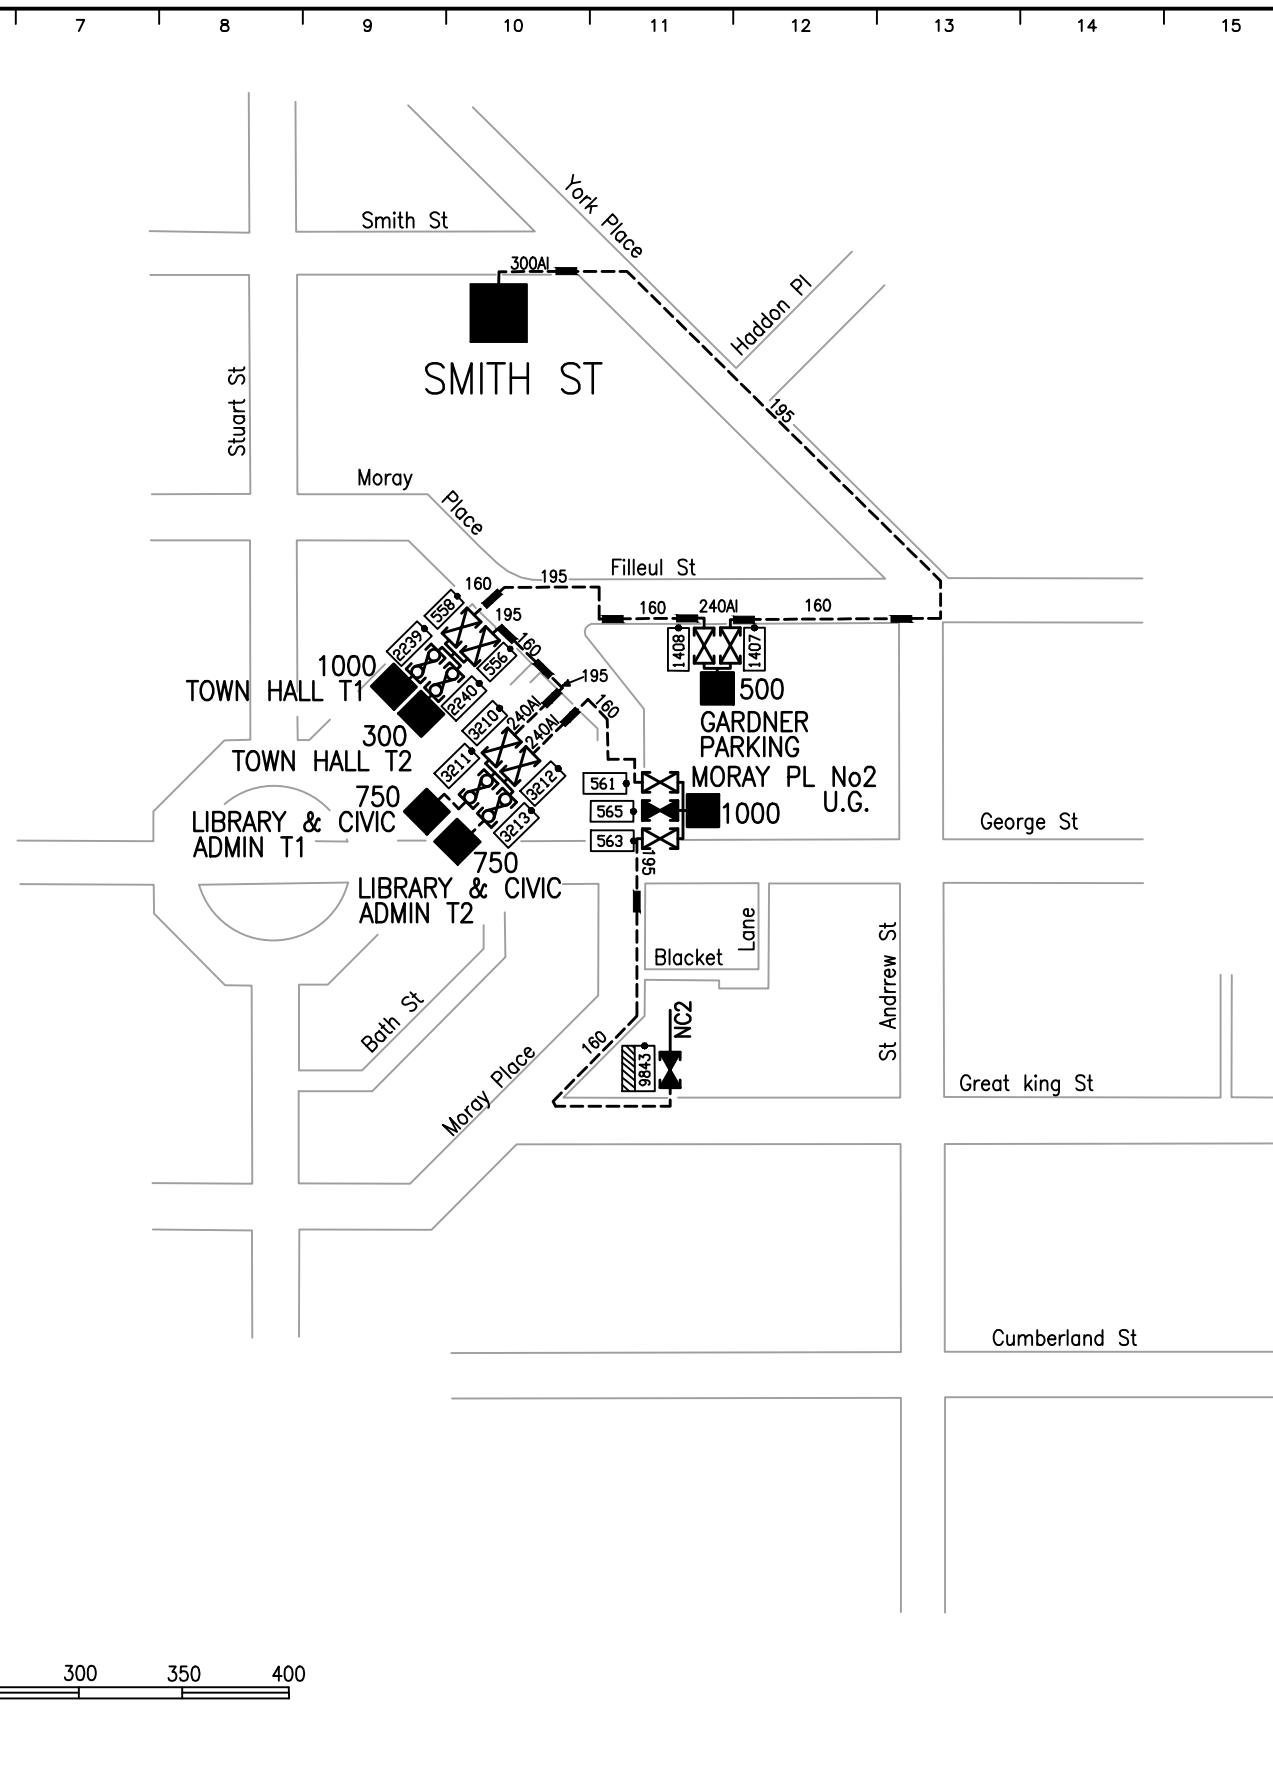

SMITH ST No10 6.6kV FEEDER

DATE ISSUED
24/07/25

PAGE
**SS
10**