Note :– Any tie switch shown thus 9853 & 2679 must be used for parralleling only as indicated in Operating Instructions QP1601/32

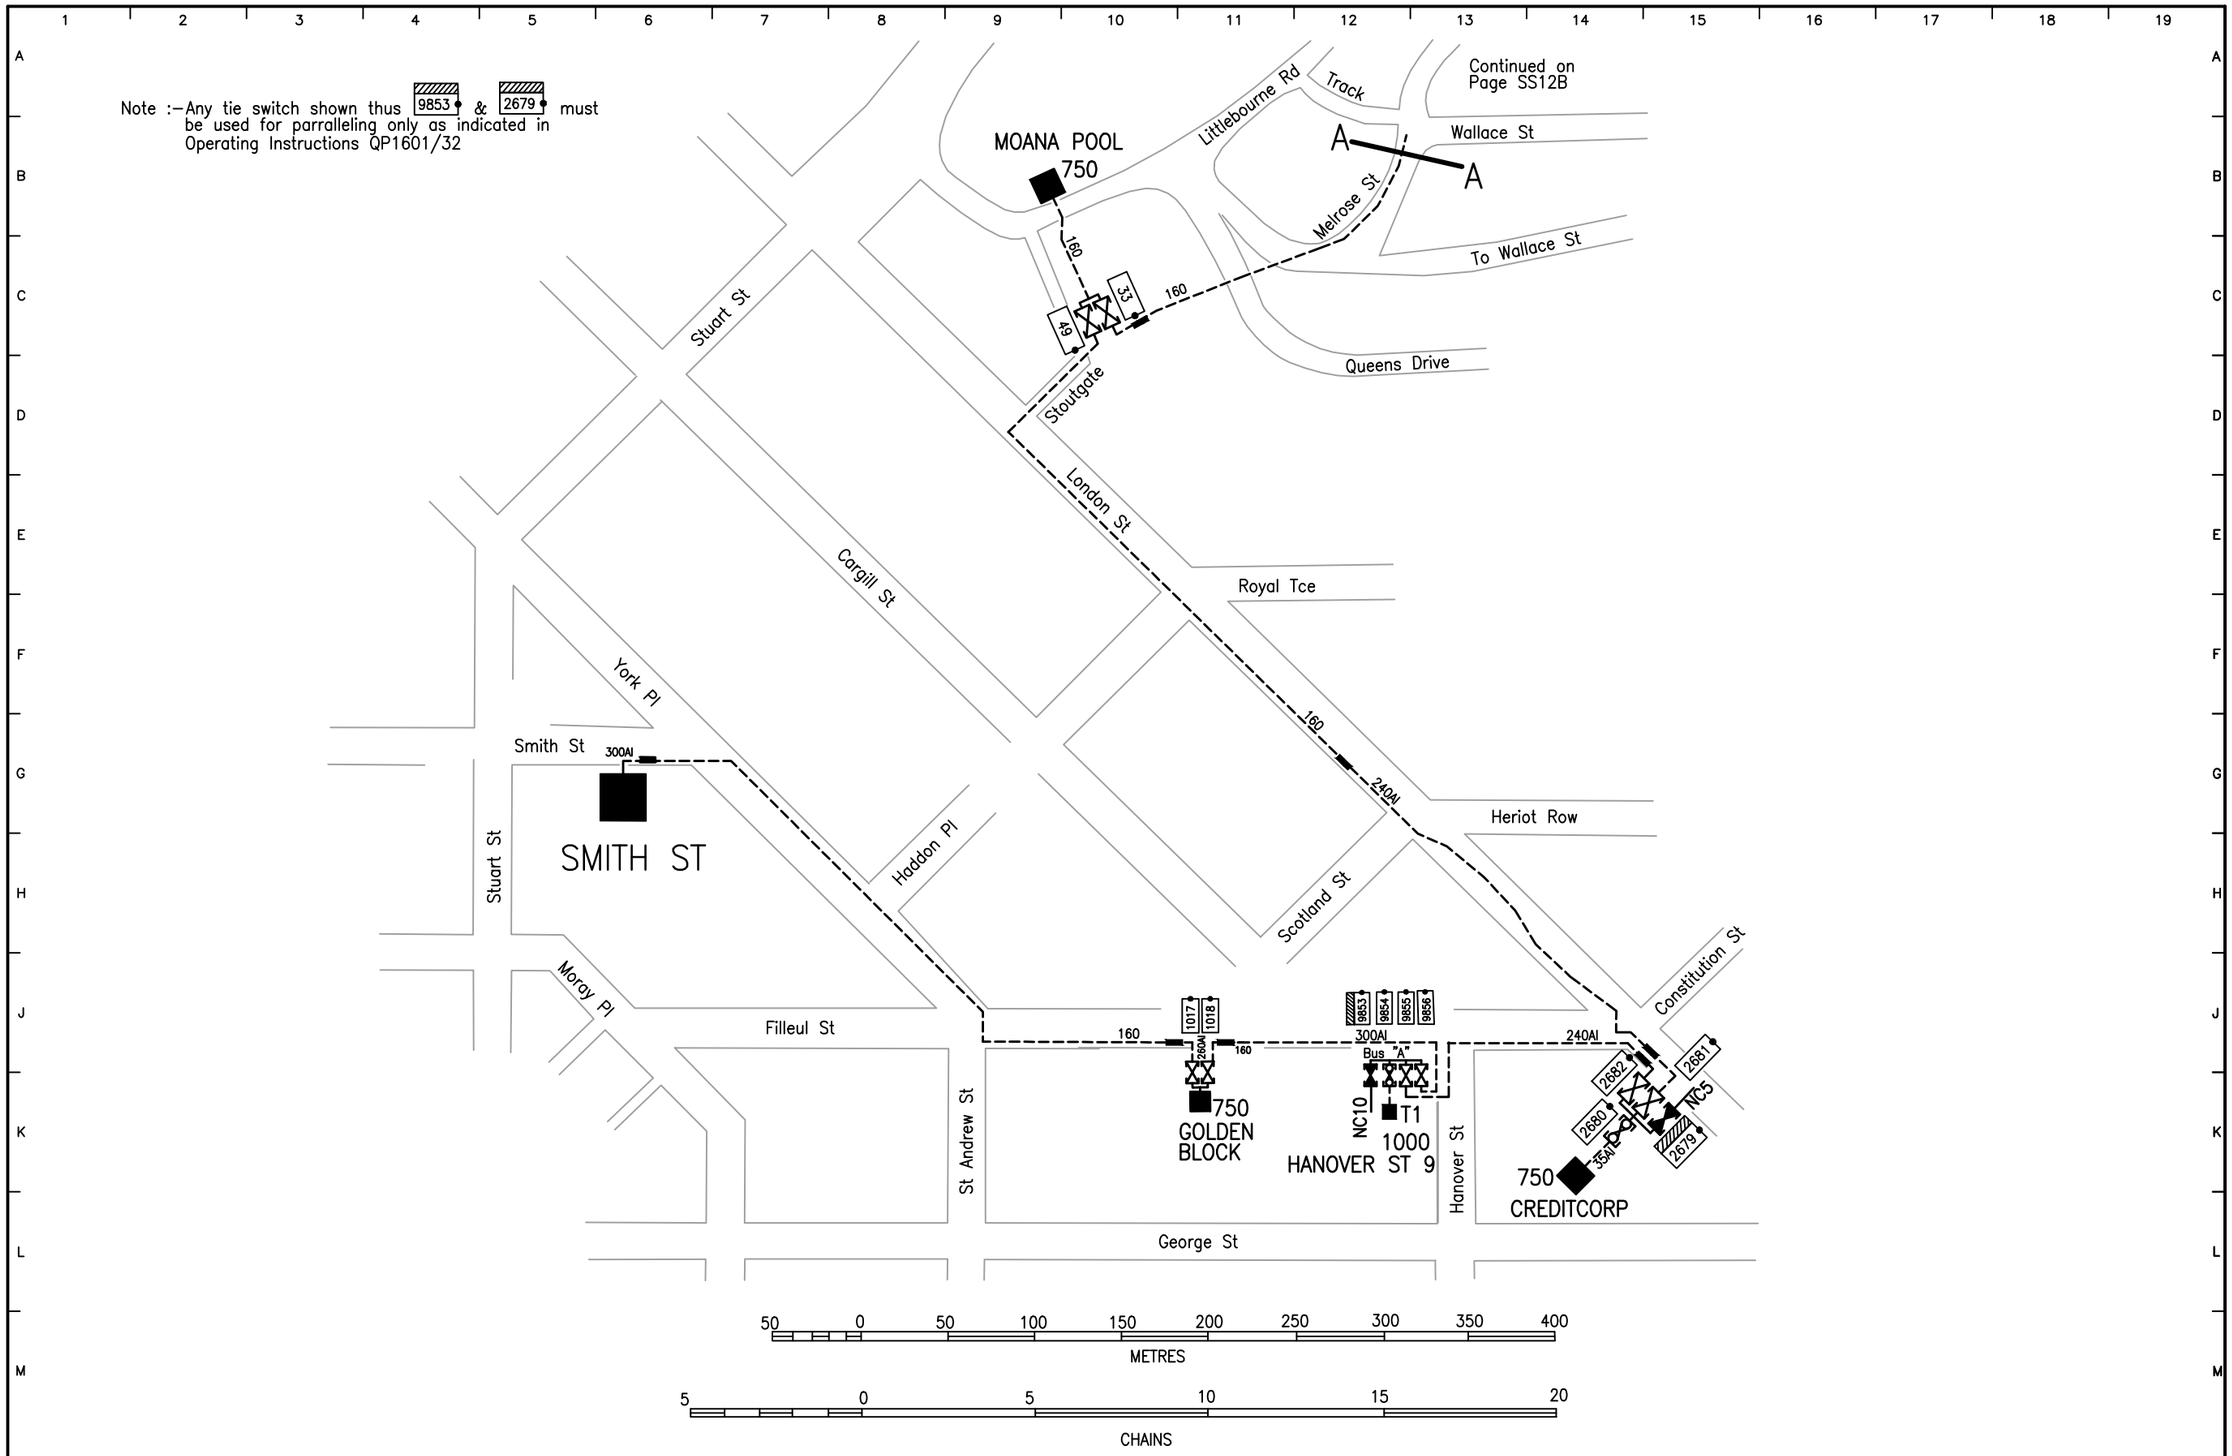

REVISION	T	U	V		M	N	O	P	Q	R	S	DRAWN E C	–
COMP. NO	–	SS OFFLOAD	SS RETURN		1060	1191	–	1273	2245	–	–	TRACED C A S	02/07
DATE	03/21	07/24	07/25		01/97	05/97	07/97	04/97	10/00	–	11/14	CHECKED	
CHECKED	CBP	AC	DCH		DLP	DLP	DLP	DLP	KTB	–	SJM	DES.ENG	

Aurora

SMITH ST No12 6.6kV FEEDER

DATE ISSUED
24/07/25

PAGE
SS 12A