



Note :-Any tie switch shown thus  must be used for paralleling only as indicated in Operating Instructions QP1601/32



REVISION	L	C	D	E	F	G	H	I	J	K	DRAWN	G H	11/75
COMP. NO	-	3840	5021	6631	2719	-	-	CFR 6974	-	-	TRACED	C A S	02/07
DATE	07/24	04/83	12/86	09/90	01/05	-	05/13	08/14	03/21	03/22	CHECKED		
CHECKED	TJA	MA	LRM	-	DLP		SJM	SJM	CBP	NH	DES.ENG		

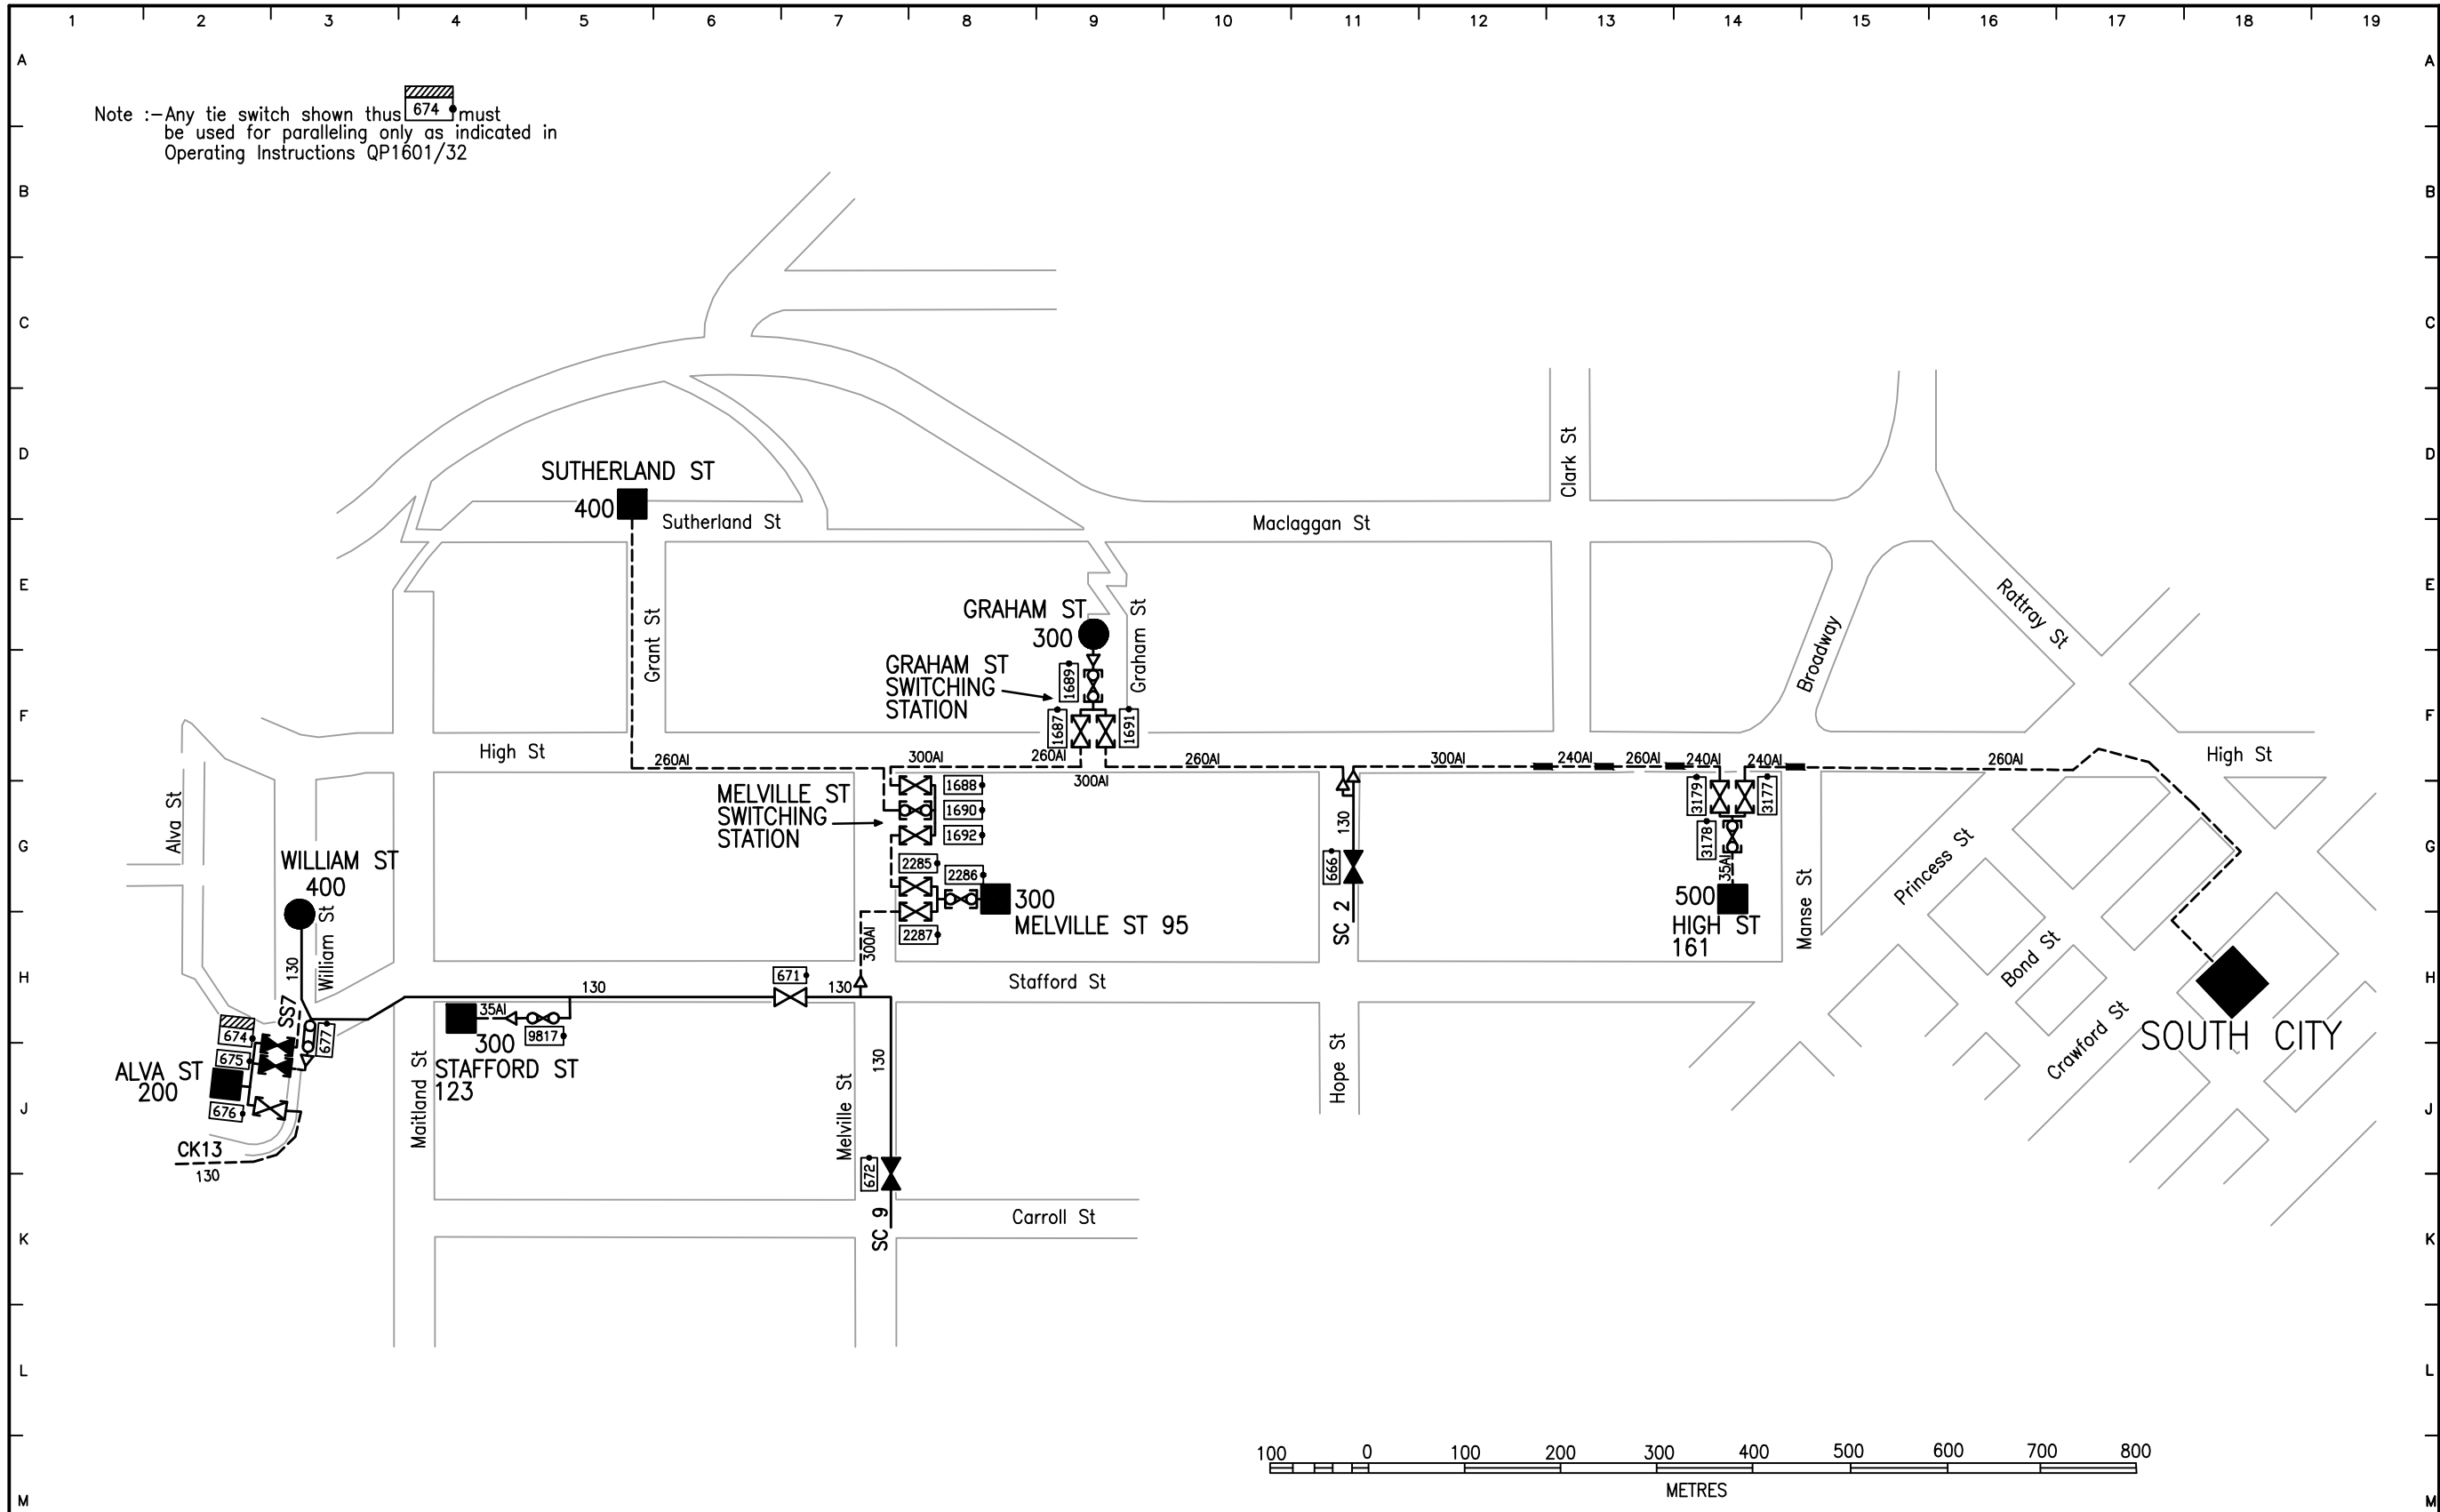

SOUTH CITY No12 6.6kV FEEDER

DATE ISSUED	PAGE
17/07/24	SC 12