
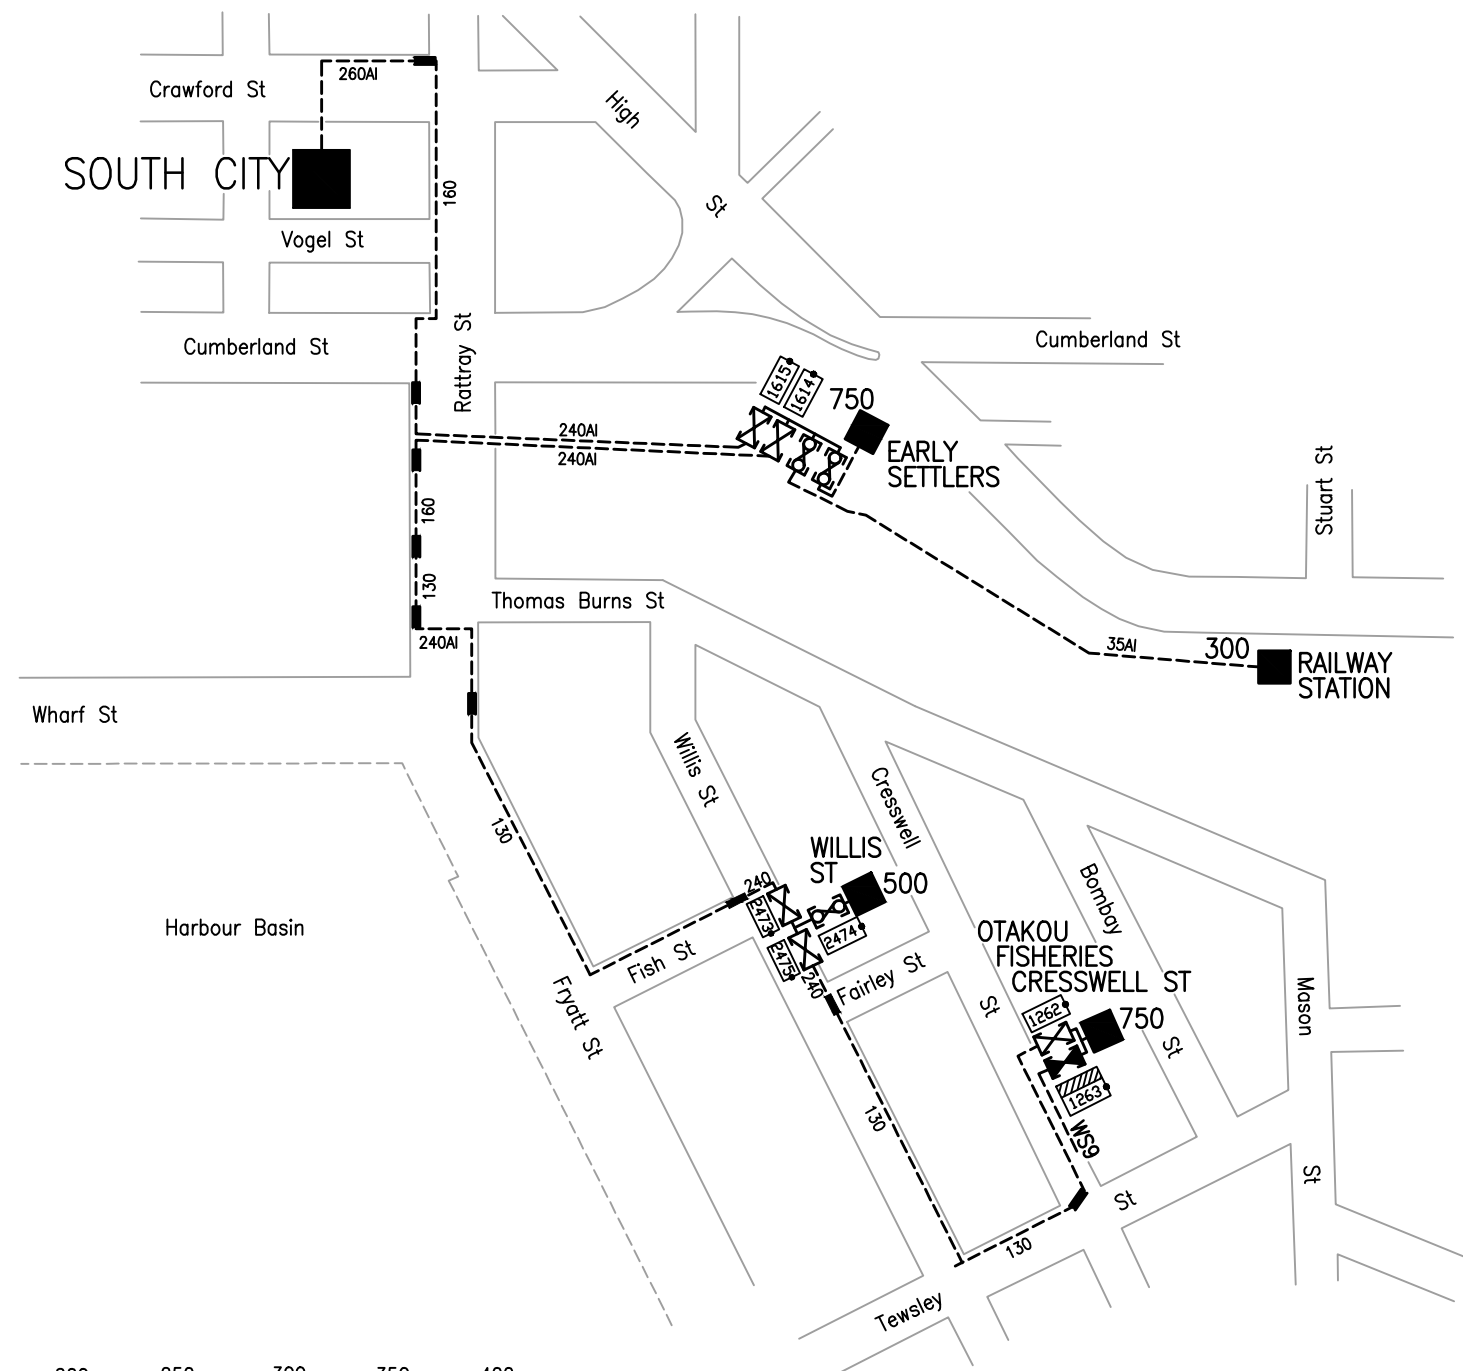


Note :-Any tie switch shown thus  must be used for paralleling only as indicated in Operating Instructions AE-OW02-S



REVISION	A	B	C	D	E	F	Temp	G	H	I		DRAWN	G H	11/75
COMP. NO	6881	4994	10384	227	083	0970	Temp Issue	CFR 5176	CFR 8514	CFR 13687		TRACED	C A S	02/07
DATE	12/76	11/86	05/93	07/94	09/94	09/96	02/10	09/10	10/17	10/25		CHECKED		
CHECKED	-	LRM	DLP	DLP	DLP	DLP	SJM		JDP	DCH		DES.ENG		



SOUTH CITY No6 6.6kv FEEDER

DATE ISSUED
9/10/25

PAGE
**SC
6**