


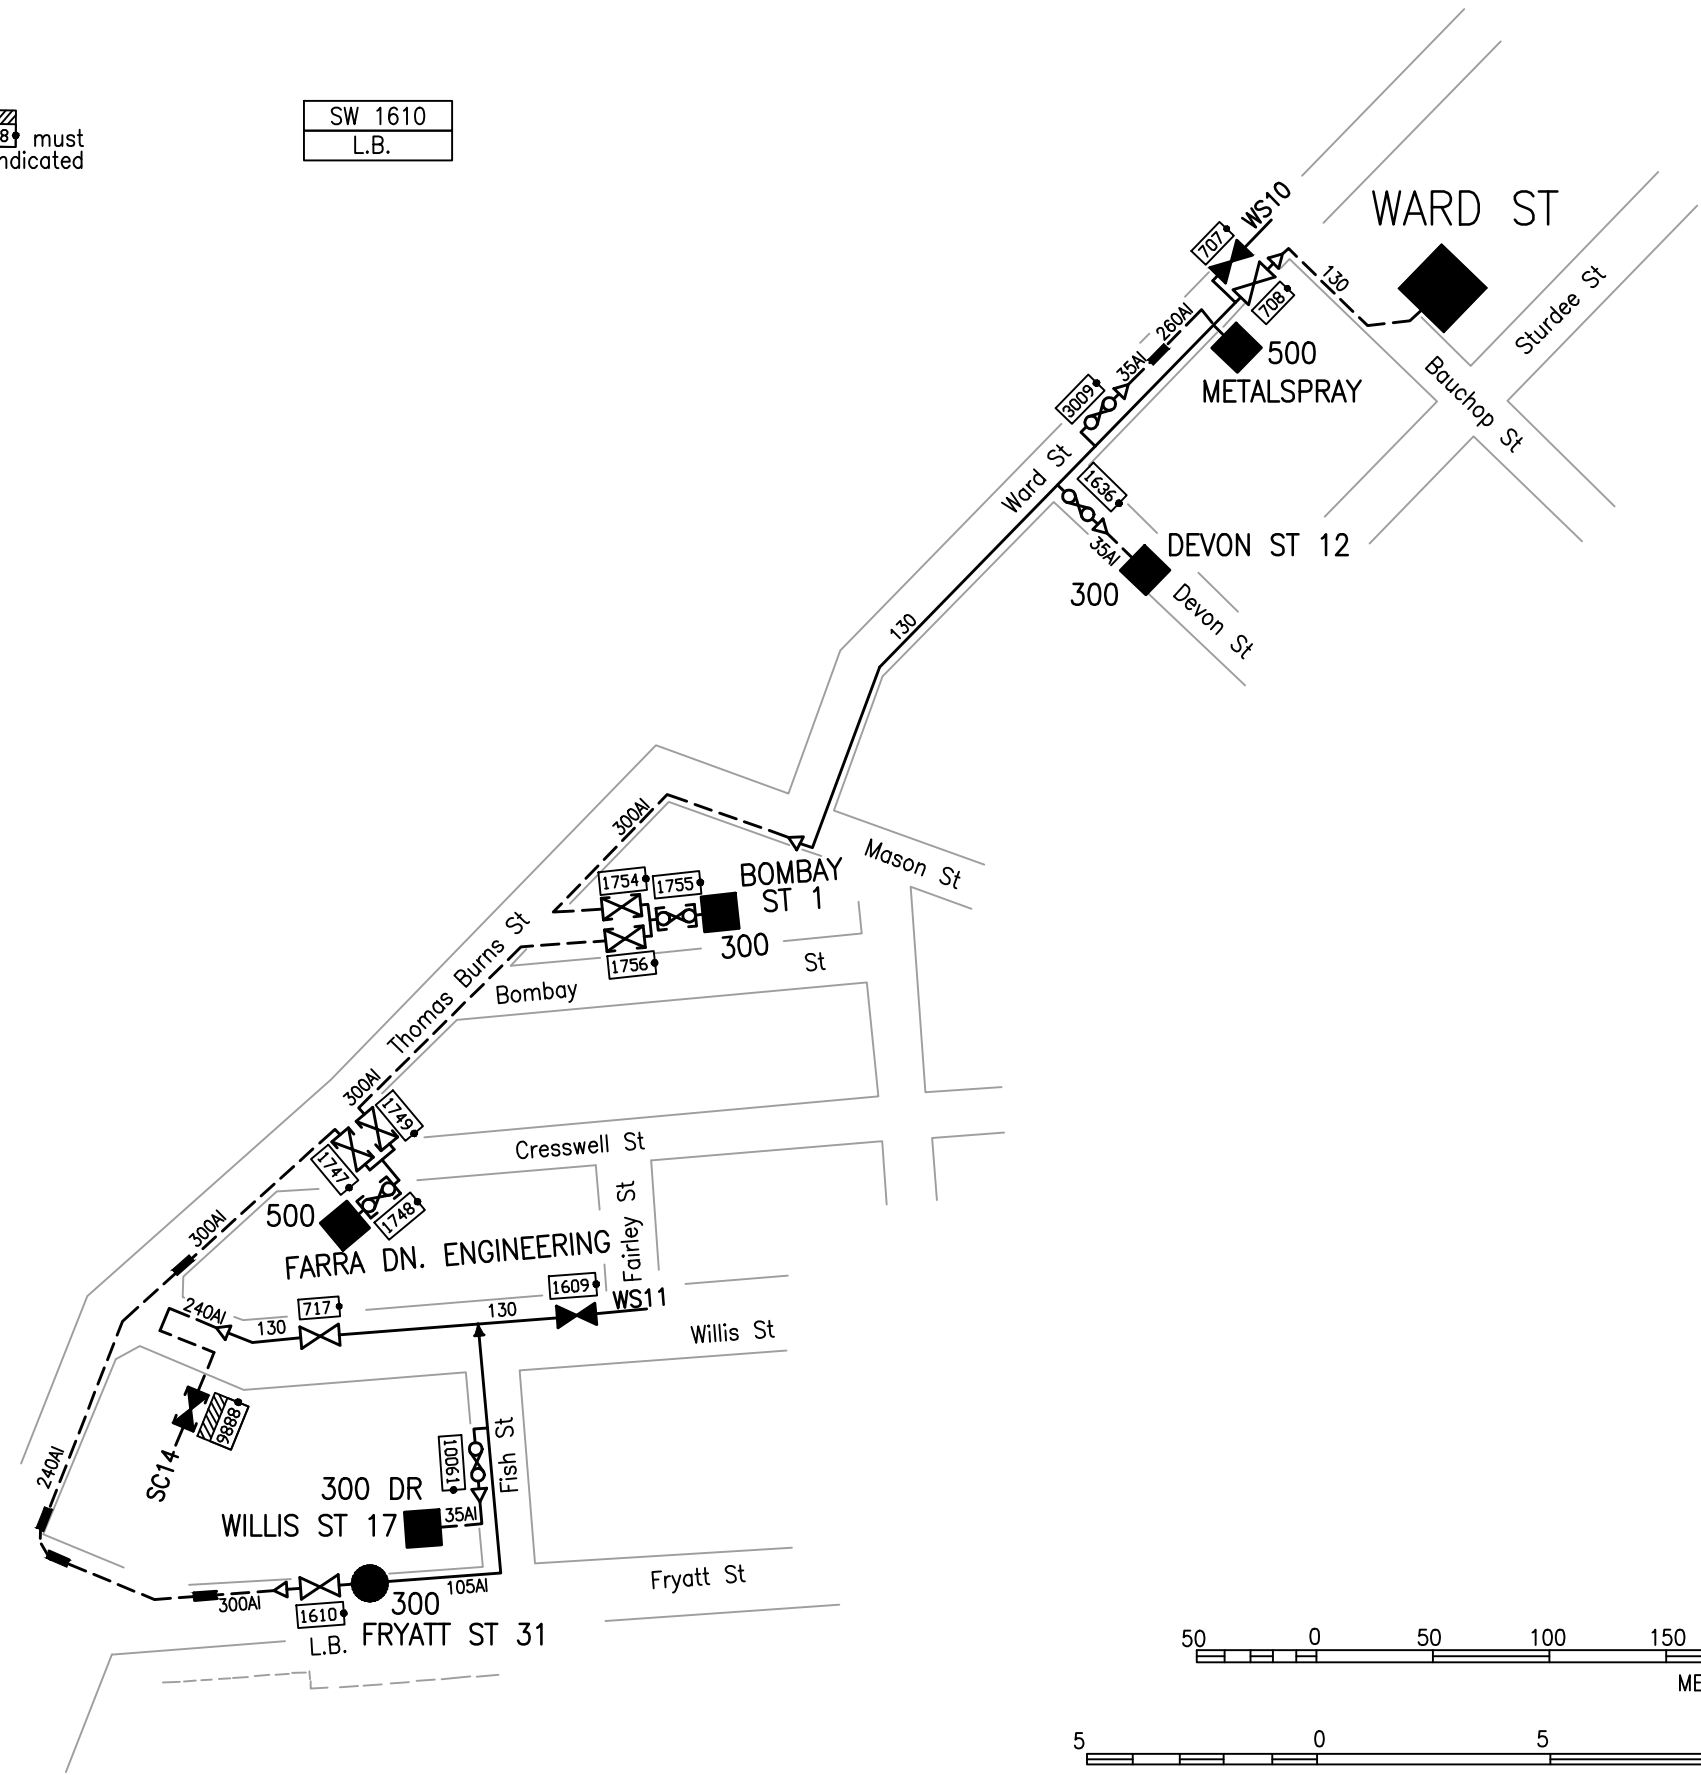


Note :-Any tie switches shown thus  must be used for paralleling only as indicated in Operating Instructions 5/10

SW 1610
L.B.



REVISION	O	P	Q	R	S		L	M	N	Temp	Temp2	DRAWN	G H	12/75
COMP. NO	CFR 5176	-	-	-	-		0880	2516	CFR 2129	Temp Issue	Temp Issue	TRACED	C A S	03/07
DATE	09/10	05/21	03/25	03/25	05/26		08/96	07/02	12/04	02/10	05/10	CHECKED		
CHECKED		NH	DCH	DCH	LMW		KTB	KTB	DLP	SJM	SJM	DES.ENG		



WARD ST No12 6.6kV FEEDER

DATE ISSUED
01/05/26

PAGE
**WS
12**