





Note :-Any tie switches shown thus  &  must be used for parralleling only as indicated in QP 1601/32



REVISION	K	L	M	N		Temp	F	G	H	I	J	DRAWN	I G P	02/85
COMP. NO	-	-	CFR 11960	-		Temp Issue	CFR 5176	-	-	-	-	TRACED	C A S	03/07
DATE	08/19	10/22	04/23	04/26		02/10	09/10	03/11	07/16	09/18	11/18	CHECKED		
CHECKED	CS		TD	MGB		SJM	SJM	SJM	SJM	JDP	JDP	DES.ENG		

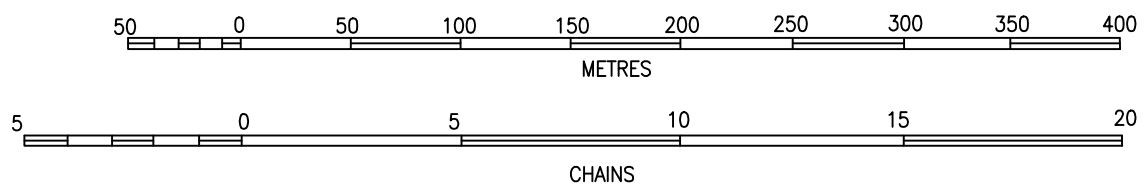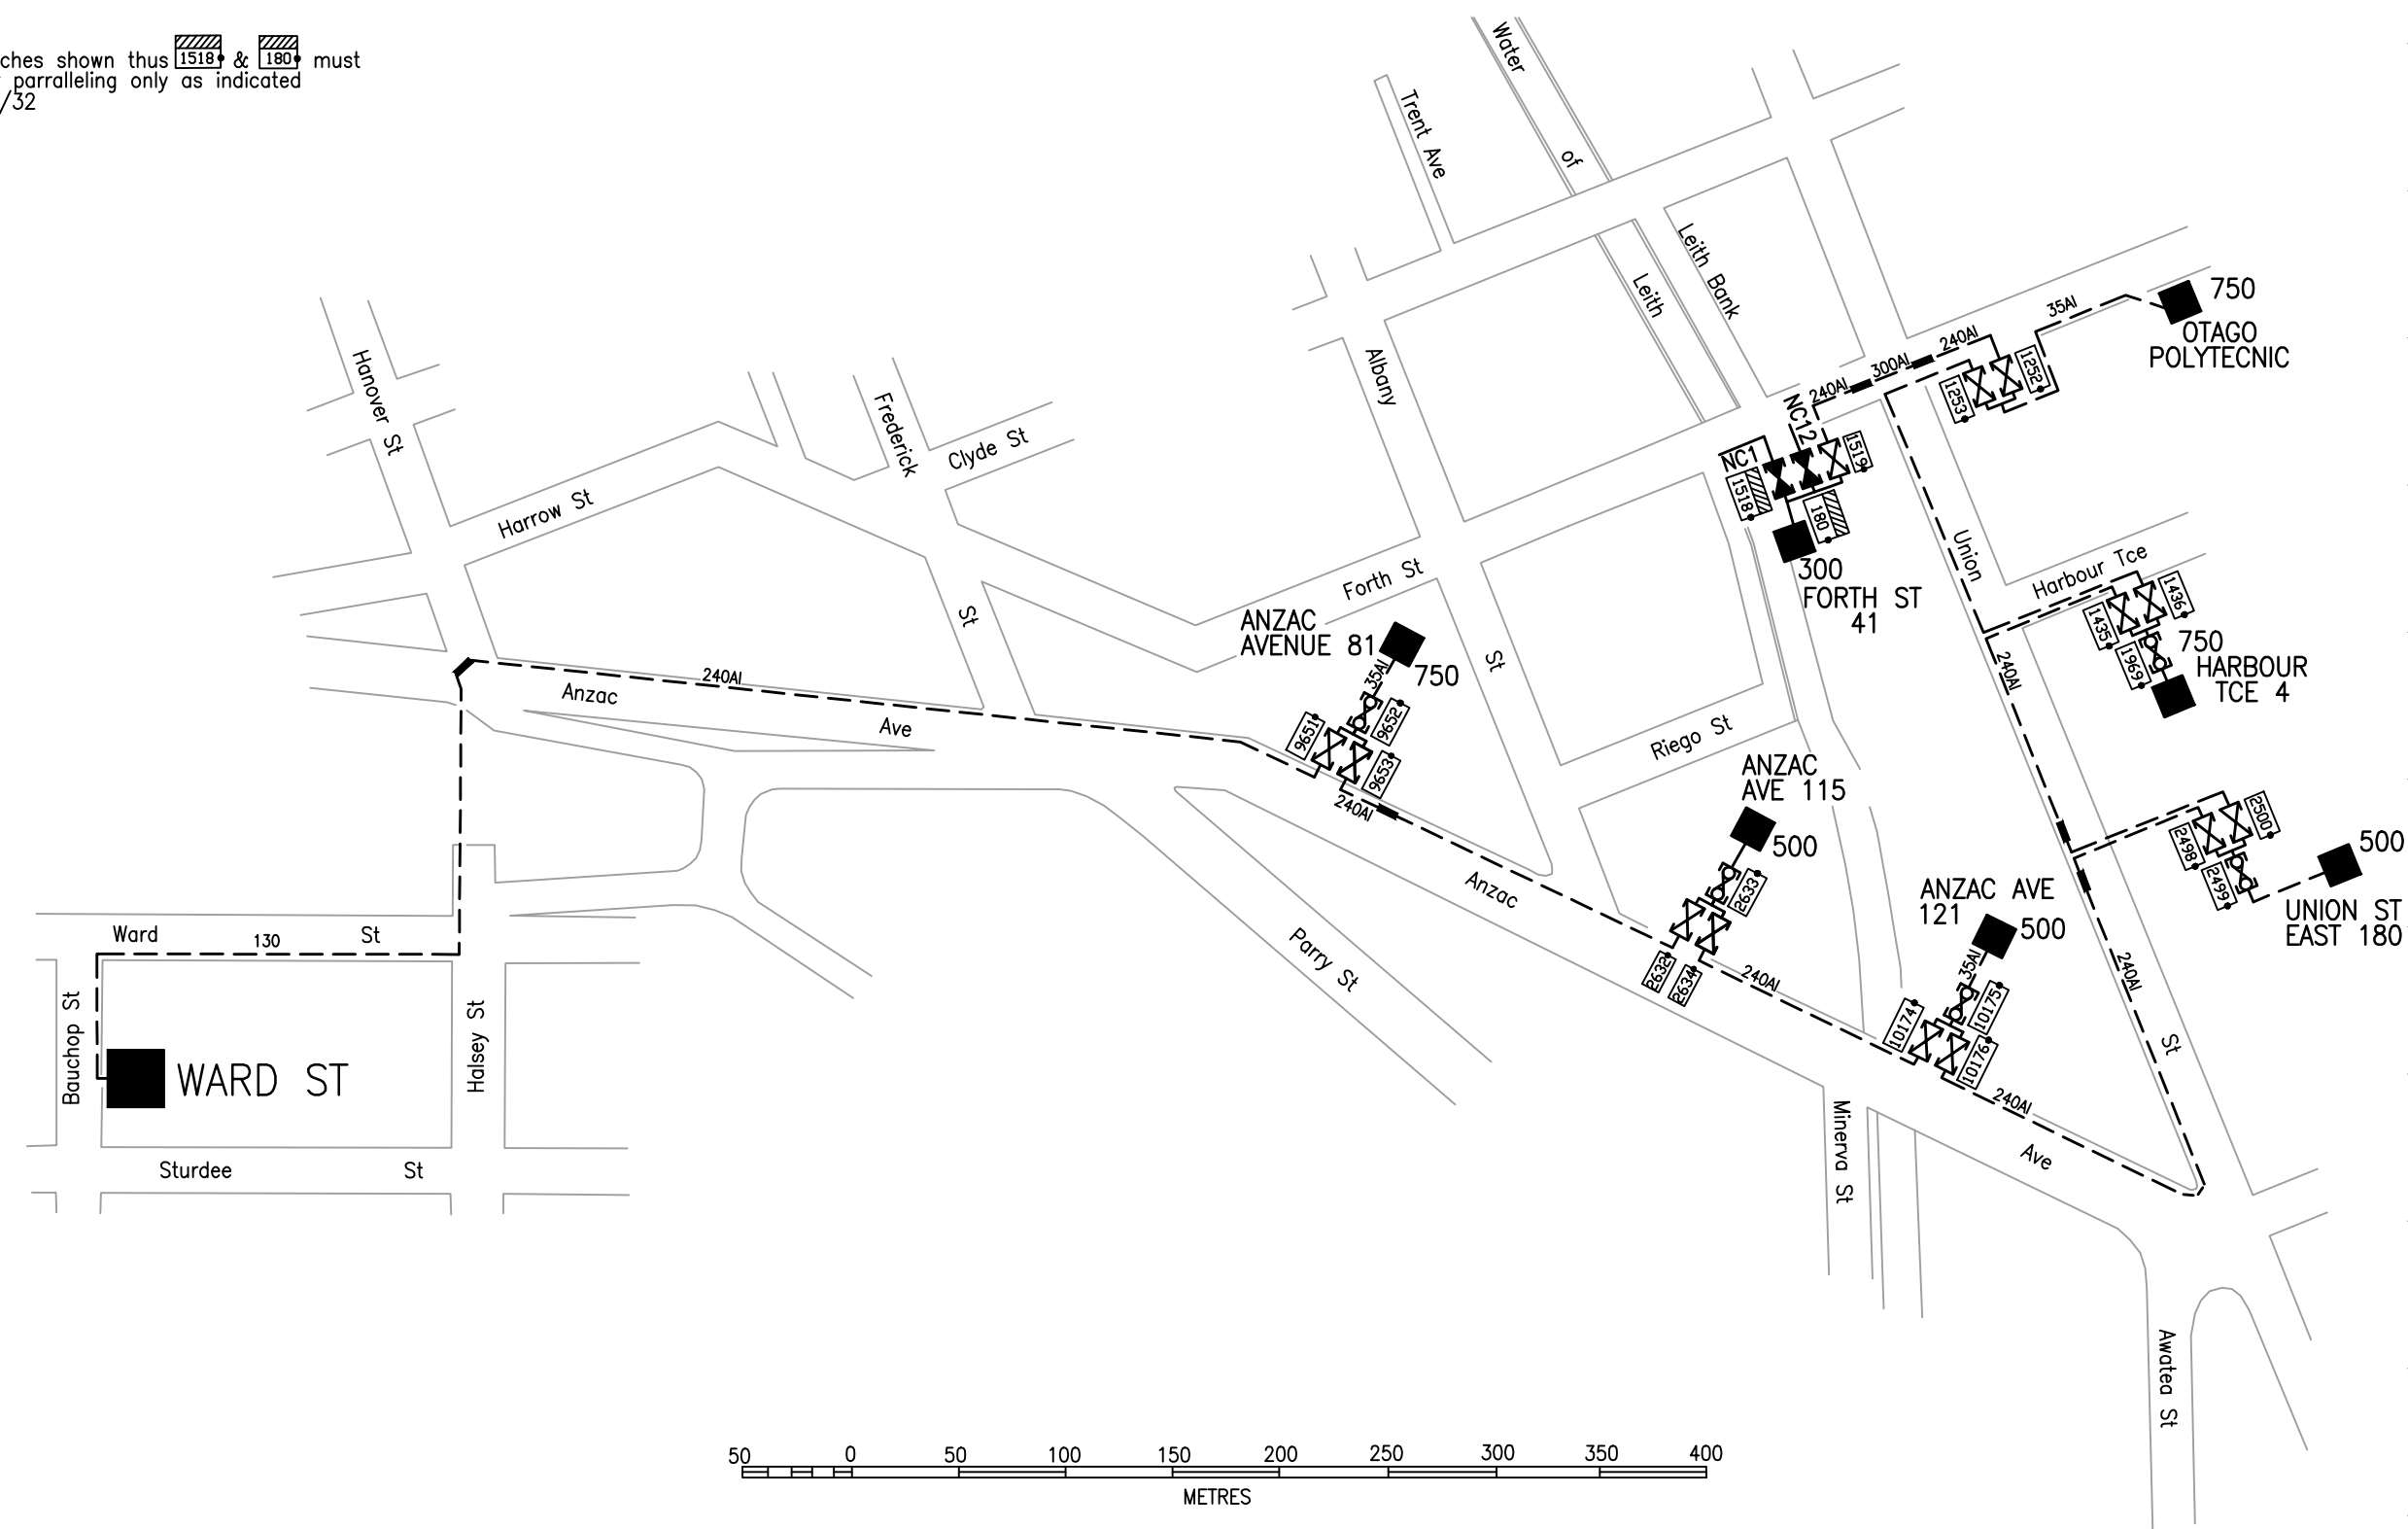

WARD ST No5 6.6kV FEEDER

DATE ISSUED
24/04/26

PAGE
**WS
5**