
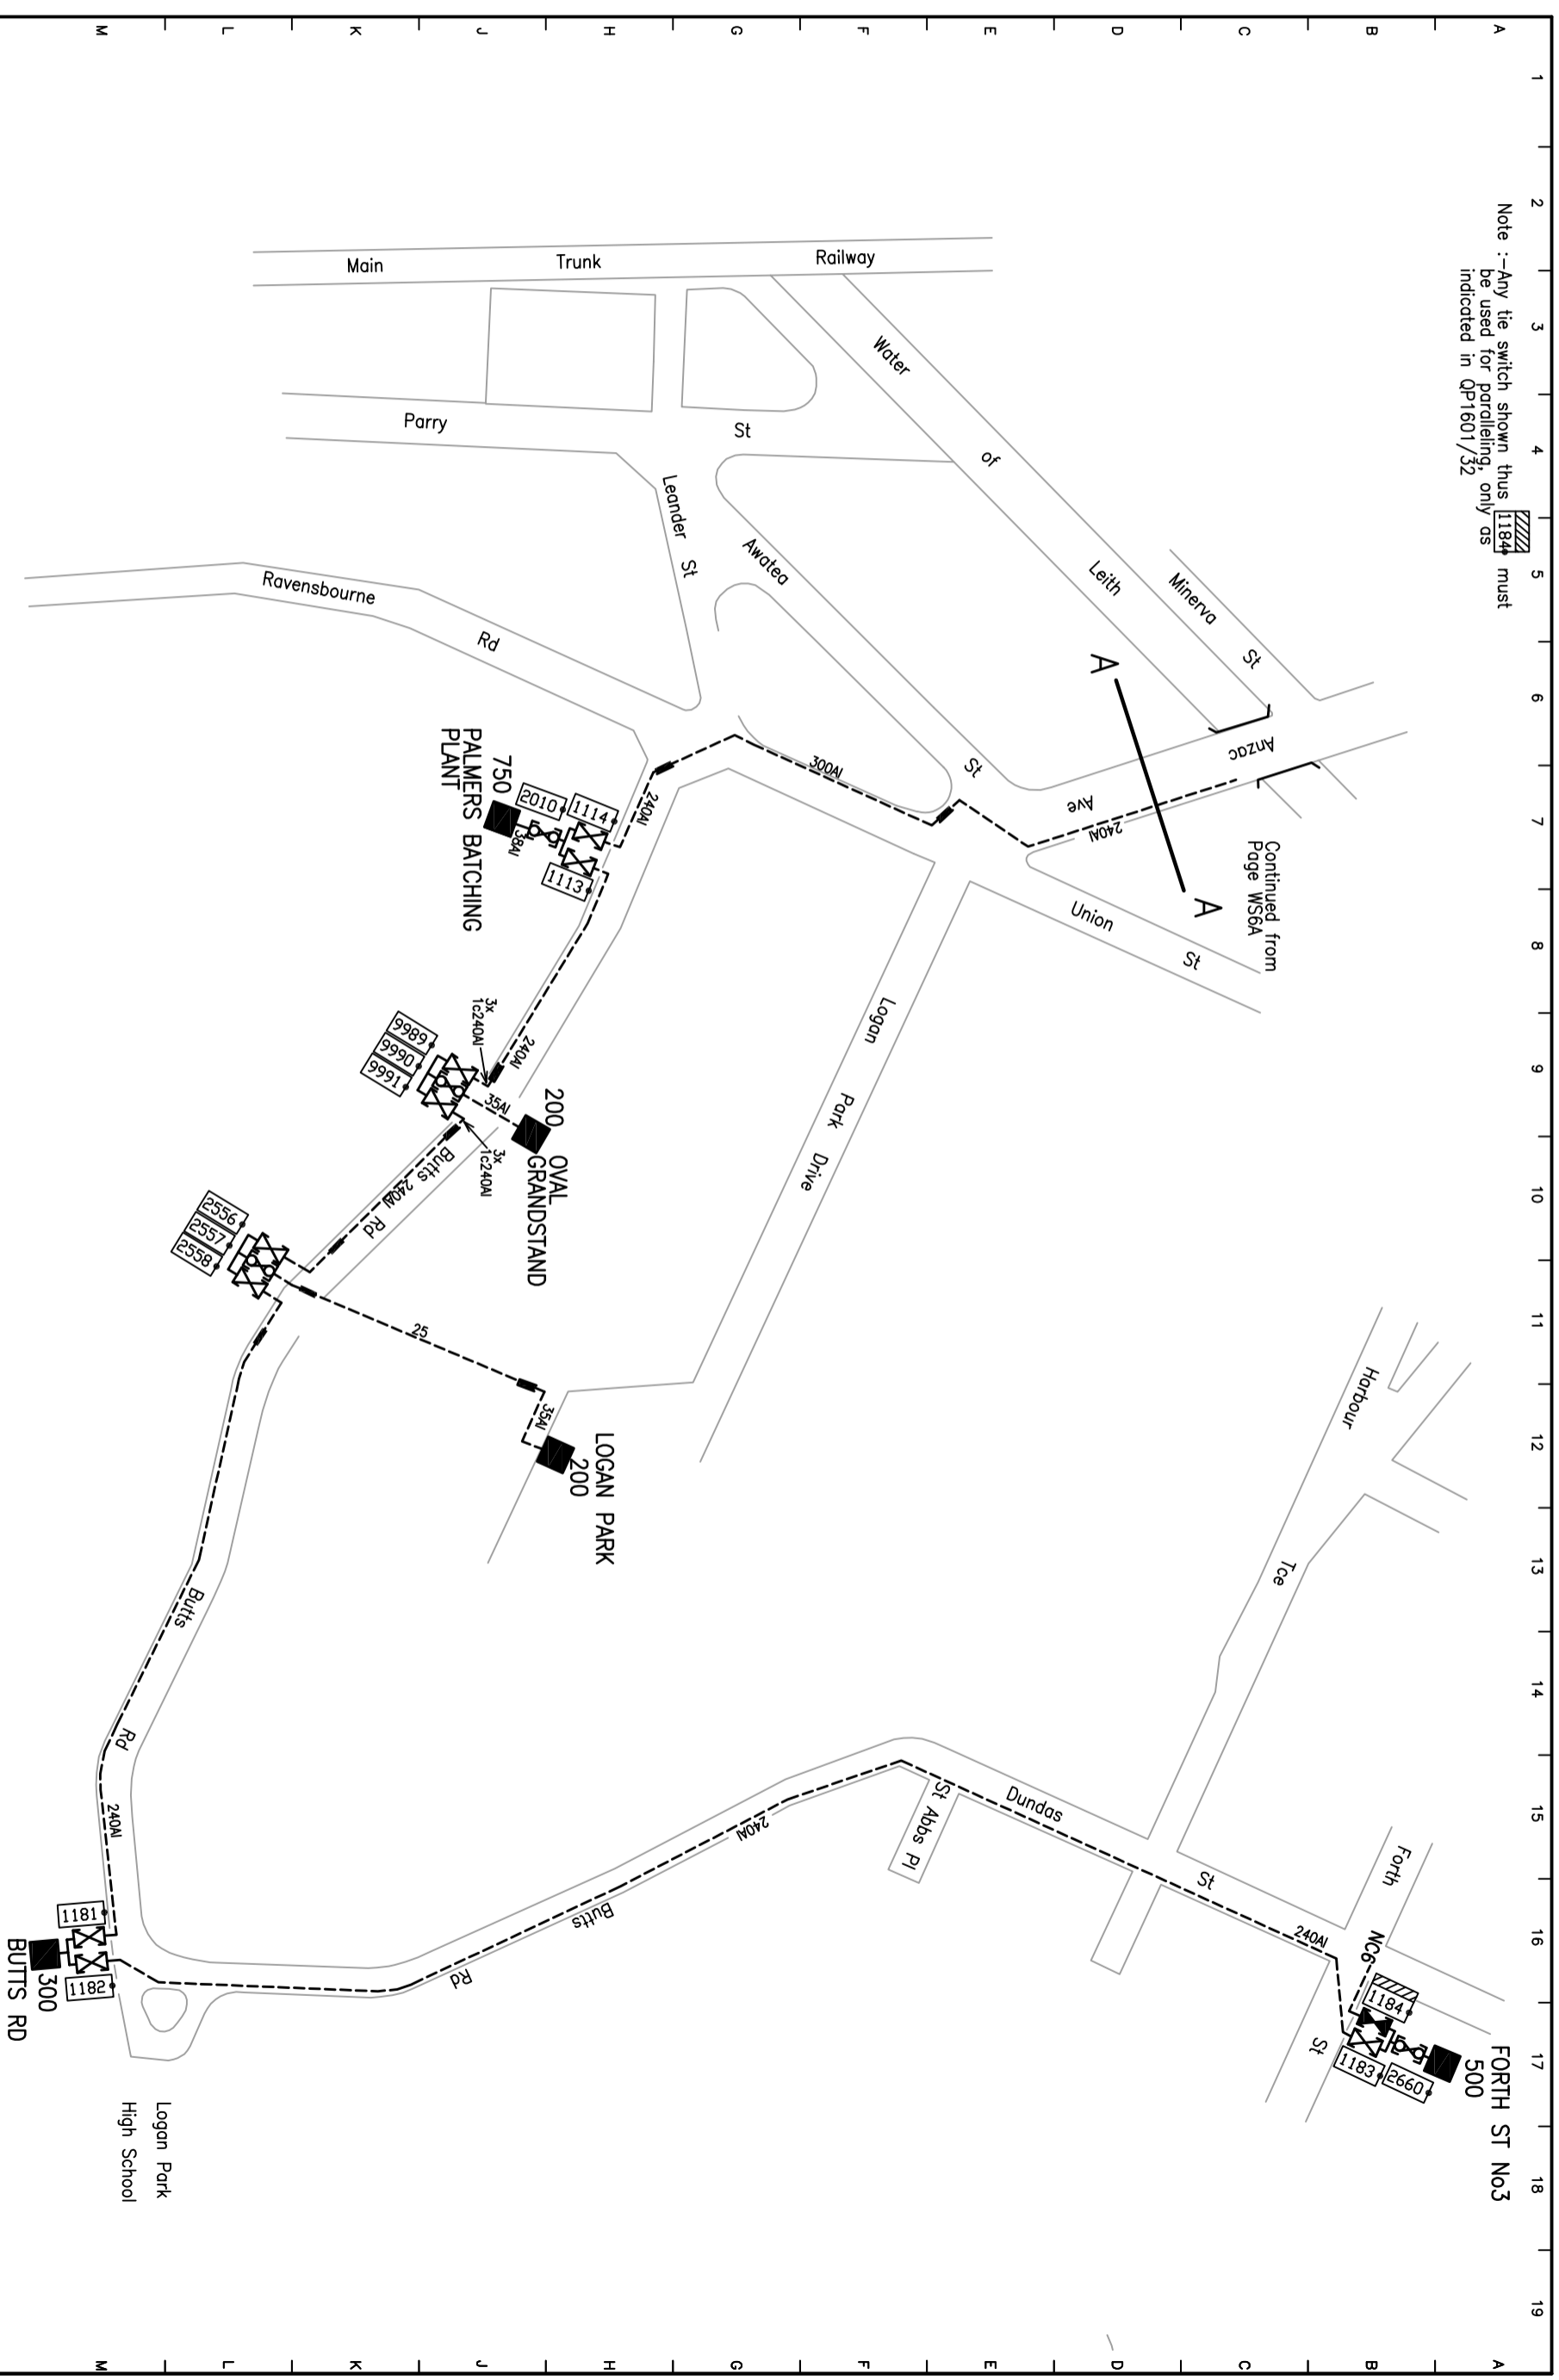


Note :- Any tie switch shown thus  must be used for paralleling, only as indicated in QP1601/32



REVISION	W	X	P	Q	R	S	Temp	T	U	V	DRAWN	I G P	11/84
COMP. NO	-	CFR 13177	CFR 4935	-	CFR 4929	CFR 4936,5072	Temp Issue	CFR 5176	CFR 5311	CFR 10012	TRACED	T J A	12/05
DATE	10/20	11/24	07/09	08/09	10/09	11/09	02/10	09/10	11/10	05/19	CHECKED		
CHECKED	CS	DCH	SIM	SIM	SIM	SIM	SIM	RMO		CS	DES.ENG		



WARD ST No6 6.6KV FEEDER

DATE ISSUED
29/11/24