


Note :- DDO on All subs
 :- Leith Valley Booster Pump is configured to supply 400V

LINE FUSE RATING	
433	30 Amp
2016	30 Amp

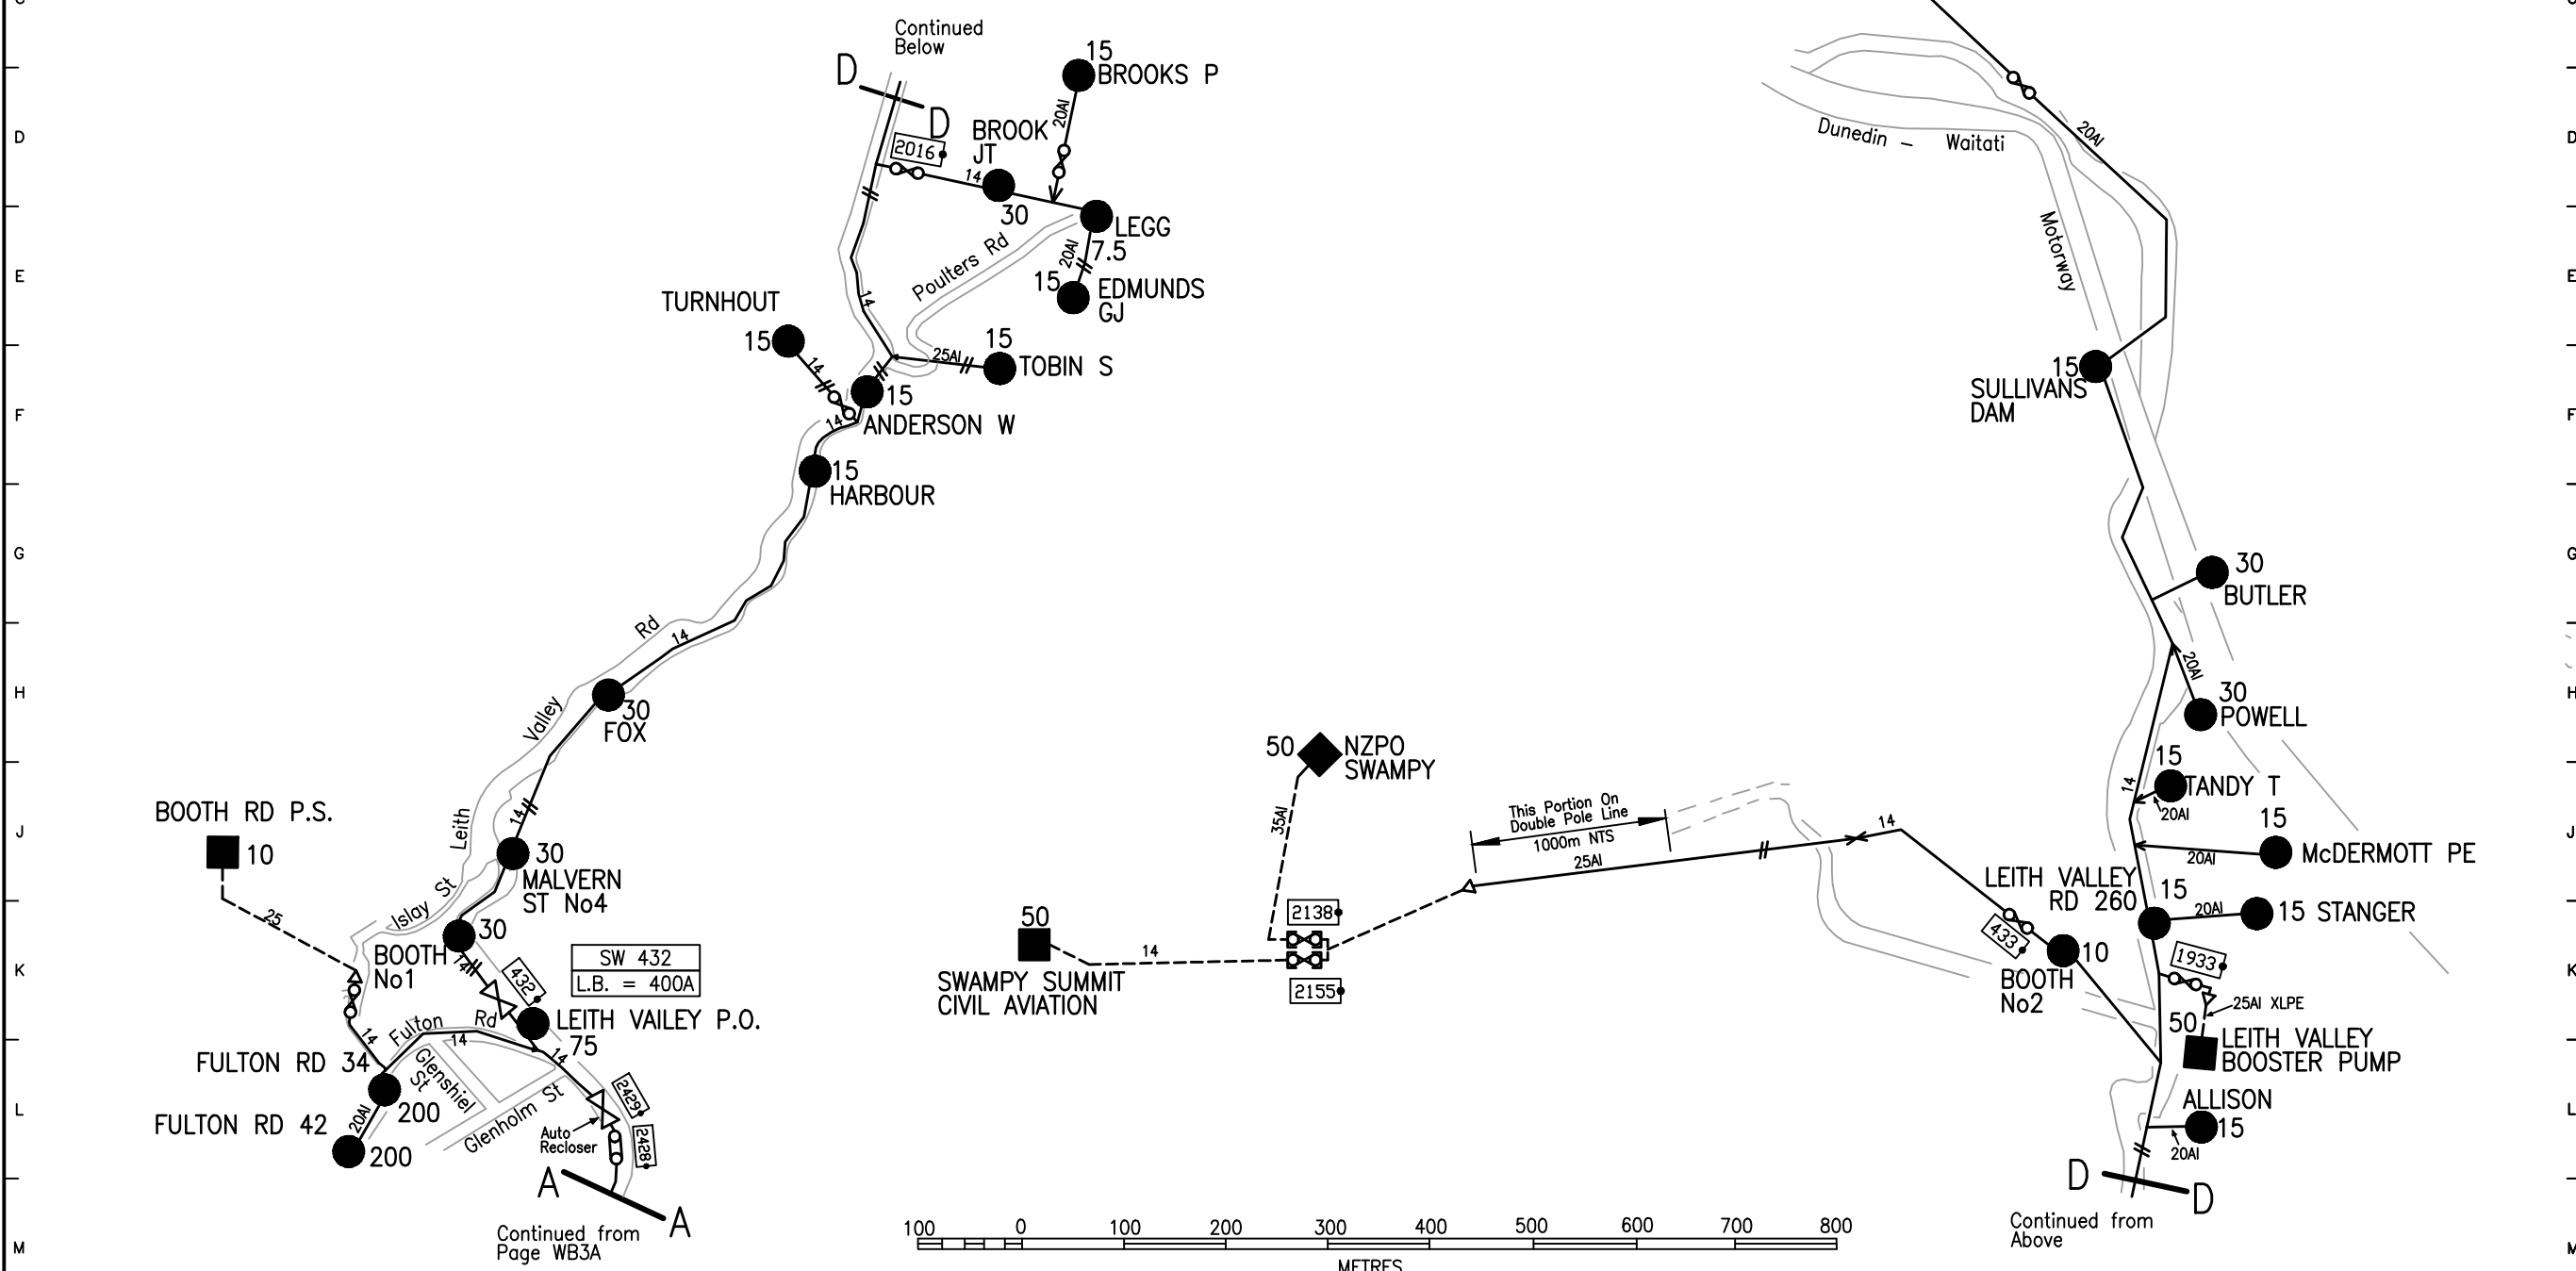

This Feeder Has A line Autorecloser Fitted

REVISION	X	Y	Z	Q	R	S	T	U	V	W	DRAWN	M	D	G	11/79
COMP. NO	5236	-	-	CFR 4140	-	-	-	-	-	-	TRACED	T	J	A	04/06
DATE	07/11	07/18	03/23	01/08	03/08	04/09	05/09	08/09	11/09	04/11	CHECKED				
CHECKED		JDP	LWS	RO	RO	SJM	RWO	SJM	DLP	SJM	DES.ENG				



WILLOWBANK No3 6.6kV FEEDER

DATE ISSUED
06/04/23
 PAGE
WB 3B